




(RESCUE CRAFT
SHED BELOW)

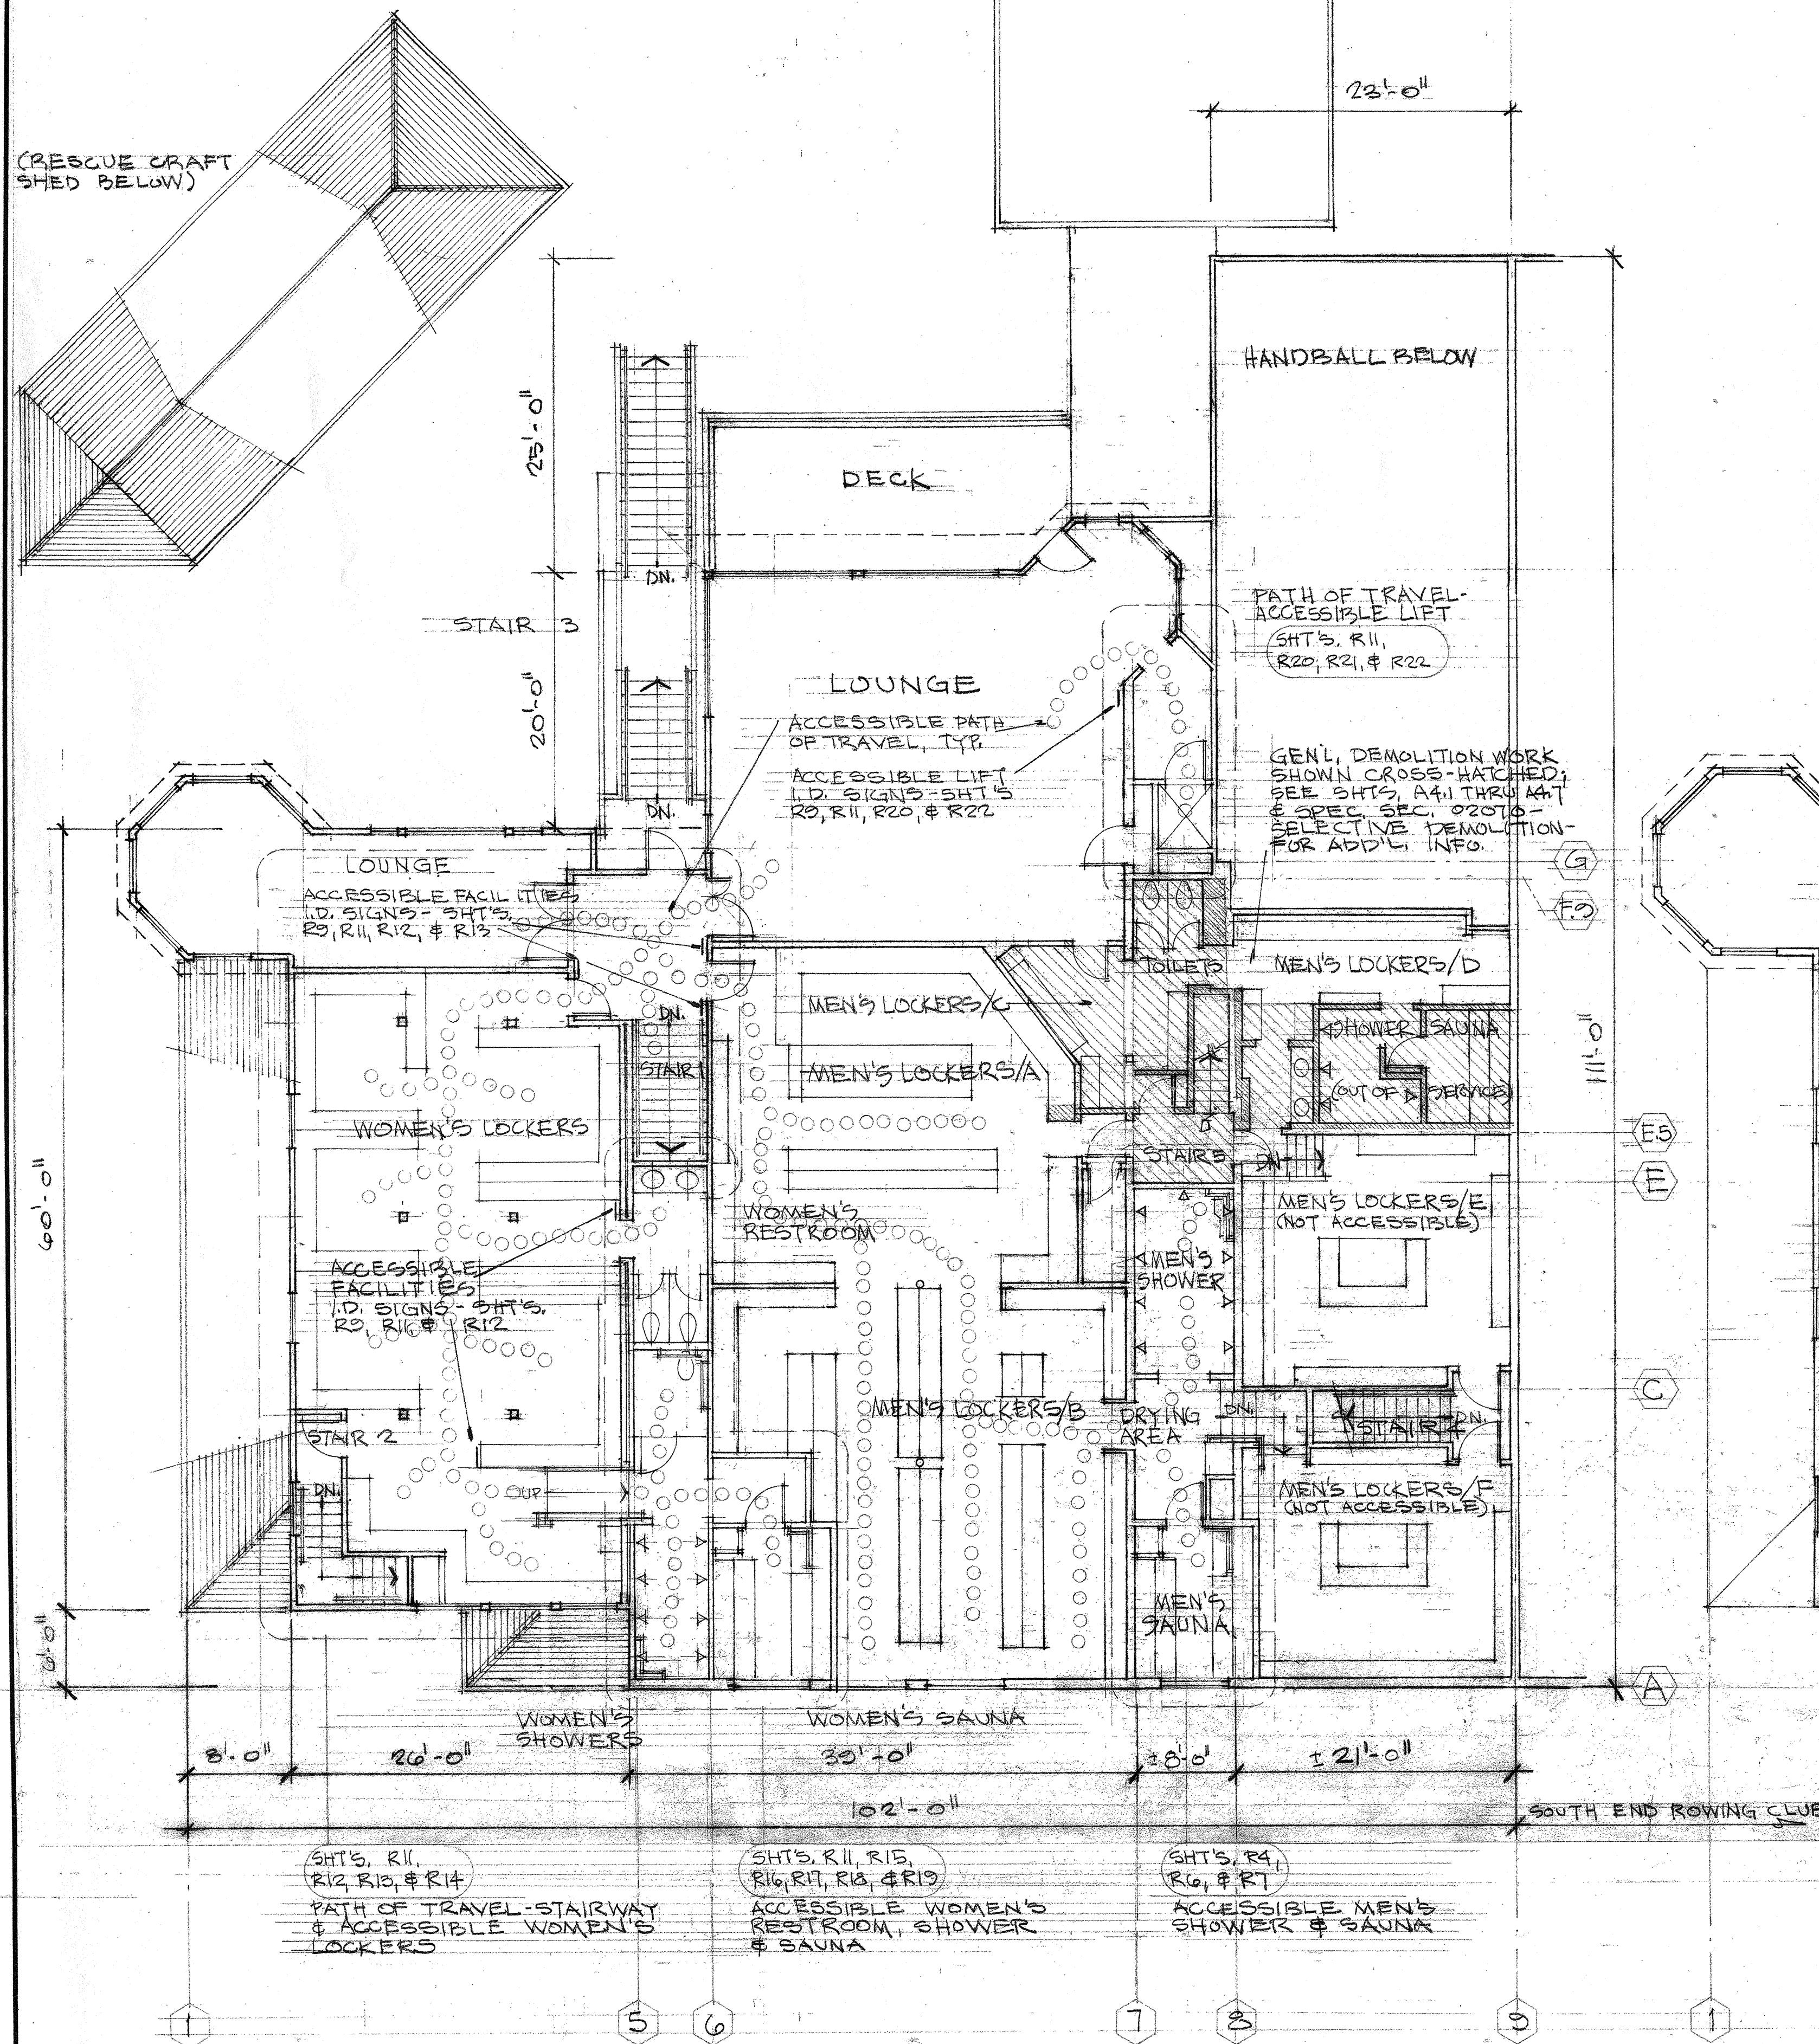

SECOND FLOOR PLAN - EXISTING/DEMOLITION

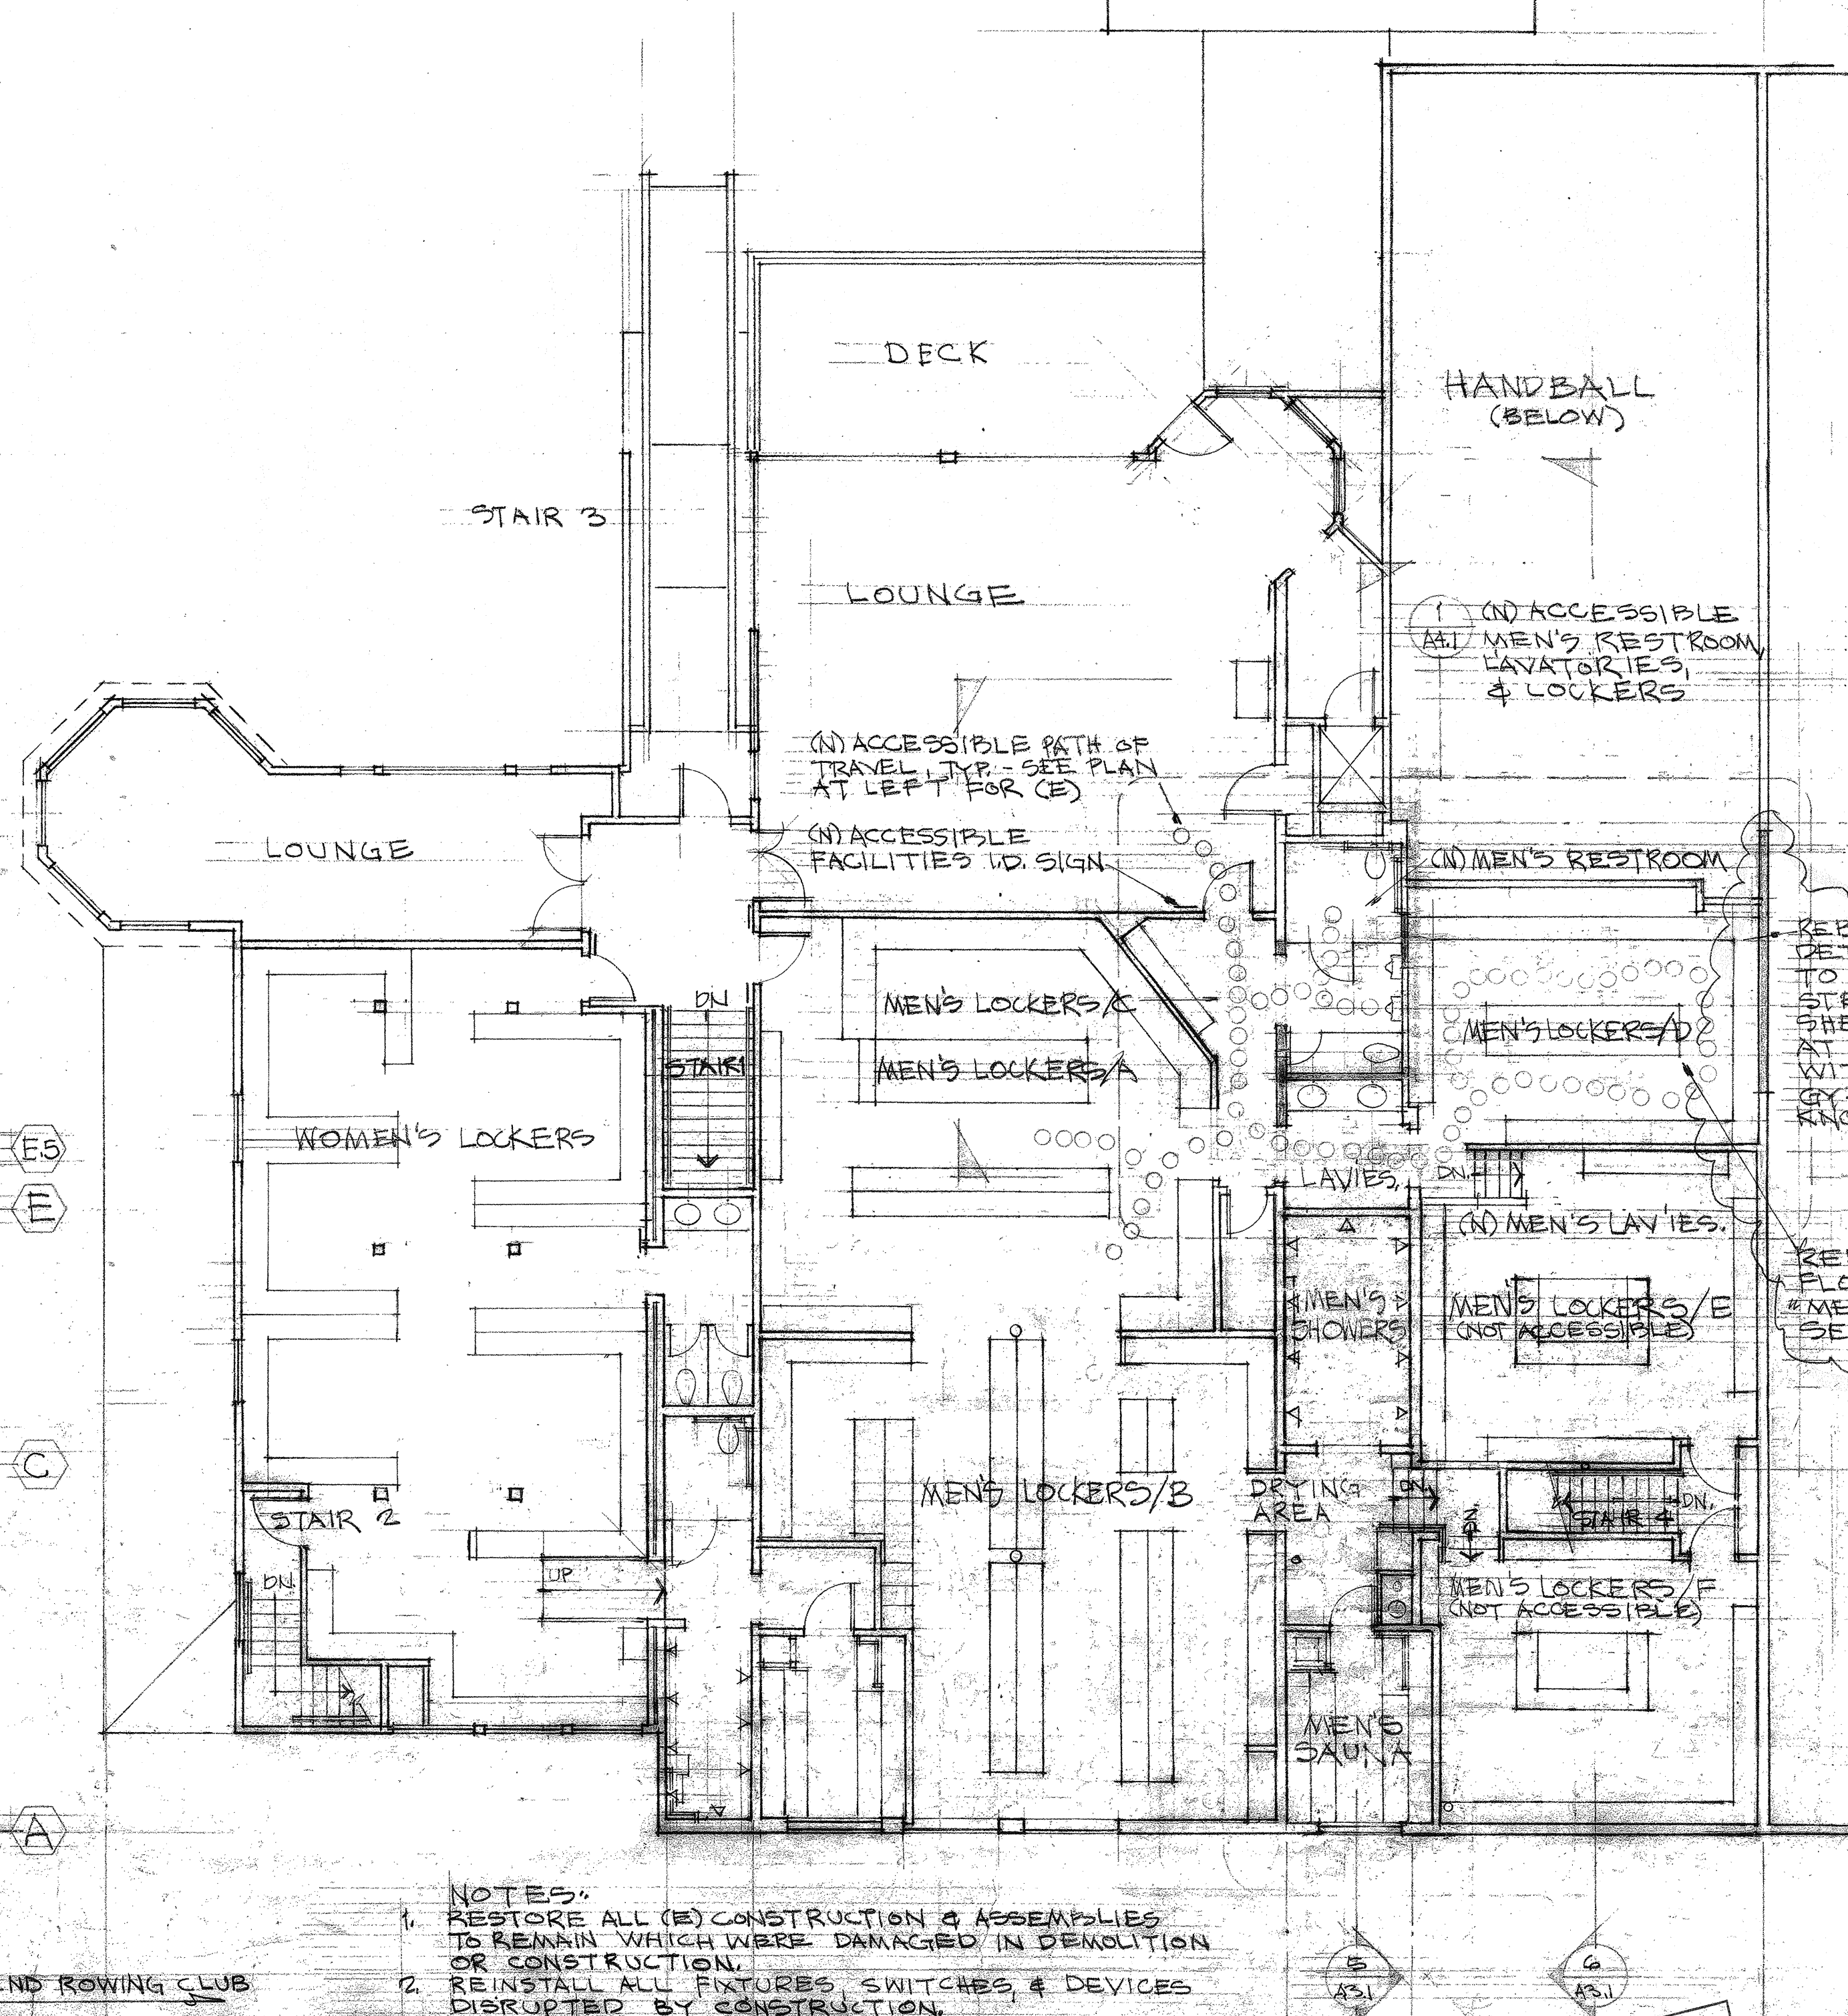

SECOND FLOOR PLAN - PROPOSED

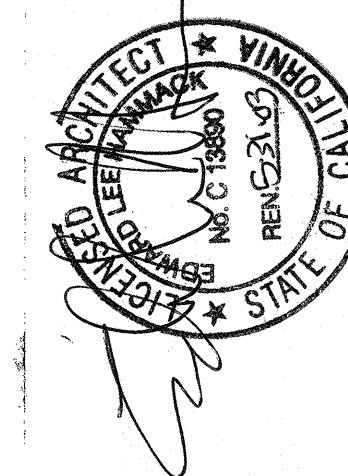

APPROVED
DEPARTMENT OF BUILDING INSPECTION

SEP 17 2001

FRANK Y. CHIU, DIRECTOR

REBUILD (E) WALL
DETERIORATED DUE
TO DRY ROT - SEE
STR'L DRWG'S -
BREATH EXPOSED STUD
AT DOLPHIN SIDE
WITH 5/8" TYPE X
GYR BD - SPRAY
KNOCK DOWN FINISH

REPLACE (E) ROTTED
FLOOR JOISTS IN
MEN'S LOCKERS/D -
SEE STR'L DRWG'S

NOTES:
1. RESTORE ALL (E) CONSTRUCTION & ASSEMBLIES
TO REMAIN WHICH WERE DAMAGED IN DEMOLITION
OR CONSTRUCTION.
2. REINSTALL ALL FIXTURES, SWITCHES & DEVICES
DISRUPTED BY CONSTRUCTION.

RECEIVED
SEP 10 2001
DEPT. OF BUILDING INSPECTION
THIS PLAN MEETS THE QUALITY
STANDARD FOR MICROFILMING
ACCEPT

SCALE: 1/8" = 1'-0"

REVISIONS	BY
1	DRY ROT REPAIR 27 AUG 01

DOLPHIN CLUB
SWIMMING & BOATING
ORGANIZED 1977
SAN FRANCISCO
LOCKER ROOM & SHOWER EXPANSION

EDWIN LEE HAMMACK, ARCHITECT
Ca. Reg. No. C-15899
San Francisco, CA 94110
415.382.9428
2077 Mission Street


PERMIT
Date: DEC 2000
Scale: AS NOTED
Drawn:
Job:
Sheet
A23
Of
3



APPROVED
SEP 17 2001
DEPARTMENT OF BUILDING INSPECTION
FRANK J. CHILDS
VLS NAREN & ASSOCIATES
Consulting Civil and Structural Engineers
460 Highland Way
Oakland, CA 94610
(510) 653-0675 Fax: 653-2727

1ST FLR. & MEZZANINE
FRAMING: GENERAL
NOTES: TYP. DETAILS

Date: PERMIT DEC 2000
Scale: AS NOTED
Drawn:
Job:
Sheet:
S1
Of 3 Sheets

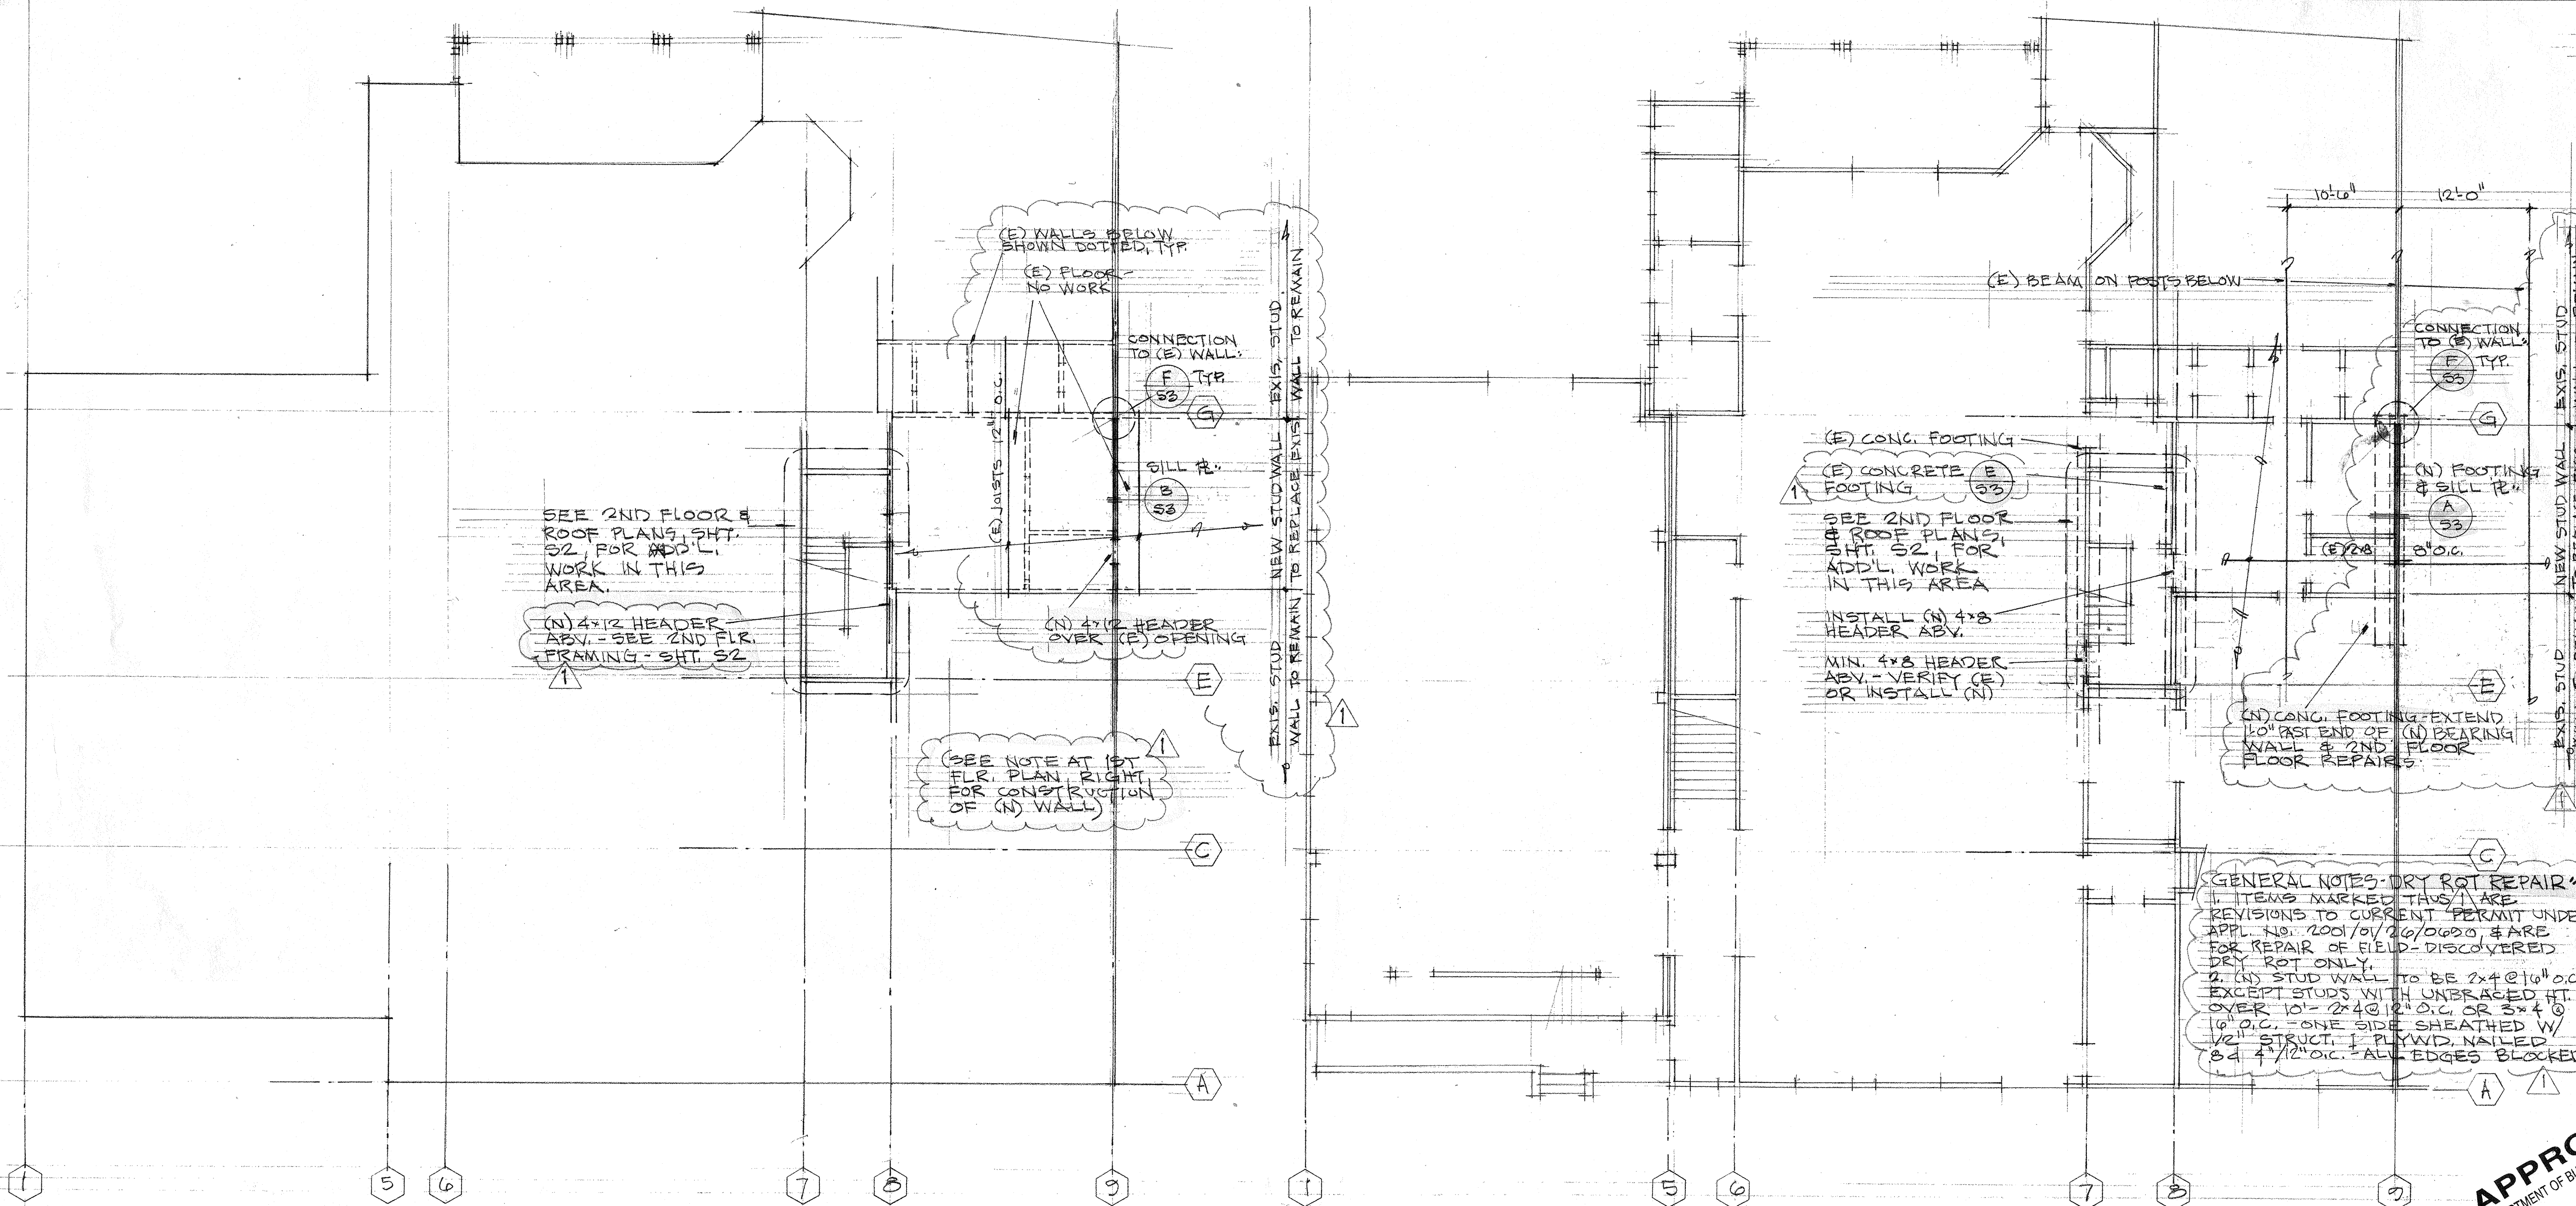


MEZZANINE LEVEL FRAMING PLAN
1/8" = 1'-0"


1ST FLOOR FRAMING/FOUNDATION PLAN
1/8" = 1'-0"

- GENERAL STRUCTURAL NOTES**
- GENERAL:**
 - DESIGN IS PER 1998 SBC
 - TEMPORARY SHORING AND BRACING NECESSARY TO SUPPORT THE INCOMPLETE STRUCTURE IS THE RESPONSIBILITY OF THE CONTRACTOR
 - DO NOT SCALE STRUCTURAL DRAWINGS
 - CONTRACTOR SHALL VERIFY ALL DIMENSIONS BEFORE COMMENCING WORK AND NOTIFY ENGINEER OF ANY DISCREPANCIES. ALL DIMENSIONS FOR EXISTING CONSTRUCTION ARE APPROXIMATE AND MUST BE VERIFIED
 - THE CONTRACTOR SHALL PROVIDE AND BE RESPONSIBLE FOR DETERMINATION AND EXECUTION OF THE METHODS OF CONSTRUCTION AND FOR ALL SAFETY PRECAUTIONS TAKEN DURING CONSTRUCTION. SITE VISITS BY THE STRUCTURAL ENGINEER WILL NOT INCLUDE INSPECTION OF THE MEANS OF CONSTRUCTION.
 - WOOD:**
 - ALL FRAMING LUMBER SHALL BE DOUGLAS FIR LARCH (COAST REGION) GRADED AND MARKED IN ACCORDANCE WITH THE STANDARD GRADING RULES NUMBER 16 OF THE WEST COAST LUMBER INSPECTION BUREAU.
 - 2 X AND 4 X MEMBERS - DOUG-FIR LARCH NO. 2 OR BETTER UON
 - 6 X MEMBERS - DOUG-FIR LARCH NO. 1 OR BETTER UON
 - POSTS - DOUG-FIR LARCH NO. 1 OR BETTER UON
 - MUD SILLS - PRESSURE TREATED OR FOUNDATION GRADE REDWOOD
 - USE 4 X 10 WINDOW OR DOOR HEADERS UNLESS NOTED OTHERWISE
 - NAILING SHALL COMPLY WITH TABLE NO. 23-II-B-1 OF THE UBC UNLESS NOTED OTHERWISE. USE COMMON NAILS UNLESS NOTED OTHERWISE. SHORT NAILS MAY BE USED PROVIDED THEY HAVE COMMON CODE SPECIFIED MINIMUM EMBEDMENT. WHERE WOOD TENDS TO SPLIT, PRE-DRILL NAIL HOLE.
 - SHEAR WALL NAILING MAY NOT BE OVERDRIVEN OR COUNTERSUNK UNDER ANY CIRCUMSTANCES. IF ANY OVERDRIVEN NAILS ARE OBSERVED, THOSE NAILS WILL BE IGNORED AND ADDITIONAL NAILS MUST BE ADDED.
 - ROOF SHEATHING SHALL BE 1/2" THICK, 5-PLY, WITH PANEL RATING OF 24/0. FLOOR SHEATHING SHALL BE 1-1/8" THICK, TONGUE AND GROOVE, WITH PANEL SPAN RATING OF 40/20.
 - PRE-FABRICATED CONNECTORS SHALL BE SIMPSON OR APPROVED EQUAL (2000 SCHEDULE).
 - USE BC OR EQUAL AT ALL POST/BEAM CONNECTIONS UON
 - USE 2 X 2 POST UNDER ALL BEAMS SHOWN UON
 - LAP SPICE TOP PLATES 4 FEET WITH 15-16d MINIMUM

- 3. SYMBOLS AND ABBREVIATIONS:**
- | | |
|------|------------------------|
| AB | ANCHOR BOLT |
| BLKG | BLOCKING |
| CJ | CEILING JOIST |
| CONC | CONCRETE |
| EA | EACH |
| FTG | FOOTING |
| MB | MACHINE BOLT |
| MAX | MAXIMUM |
| @ | AT |
| OC | ON CENTER |
| PT | PRESSURE TREATED |
| UON | UNLESS NOTED OTHERWISE |
| (E) | EXISTING |
| (N) | NEW |
- 4. CONCRETE:**
- CONCRETE AND ITS PLACEMENT SHALL CONFORM TO ACI-301, ACI-318, ASTM C-94 AND ASTM C-33
 - REINFORCEMENT: ASTM A615 GRADE 40 DEFORMED BARS FOR NUMBER 4 REINFORCEMENT AND SMALLER, GRADE 60 FOR LARGER
 - MAINTAIN A MINIMUM OF CONCRETE COVER ON ALL REINFORCING AS FOLLOWS: BOTTOM AND SIDES - 3"; SIDES FORMED - 2" UON
 - CONCRETE STRENGTH AT 28 DAYS SHALL BE MINIMUM OF 2500 PSI WITH A 5.5 SACK MIX, SEE SPECS FOR MIX DESIGN OF SHOWER AND SAUNA SLABS
 - LAP SPICE ALL REINFORCEMENT 40 DIAMETERS MINIMUM UON.
 - AGGREGATE TO CONFORM WITH ASTM C330. MAX AGG. SIZE OF 3/4", SEE SPECS FOR AGG. SIZE OF SHOWER AND SAUNA SLABS
 - CEMENT: ASTM C150 TYPE II, MAX SLUMP = 4 INCHES.
 - NO CALCIUM CHLORIDE PERMITTED IN ANY CONCRETE.

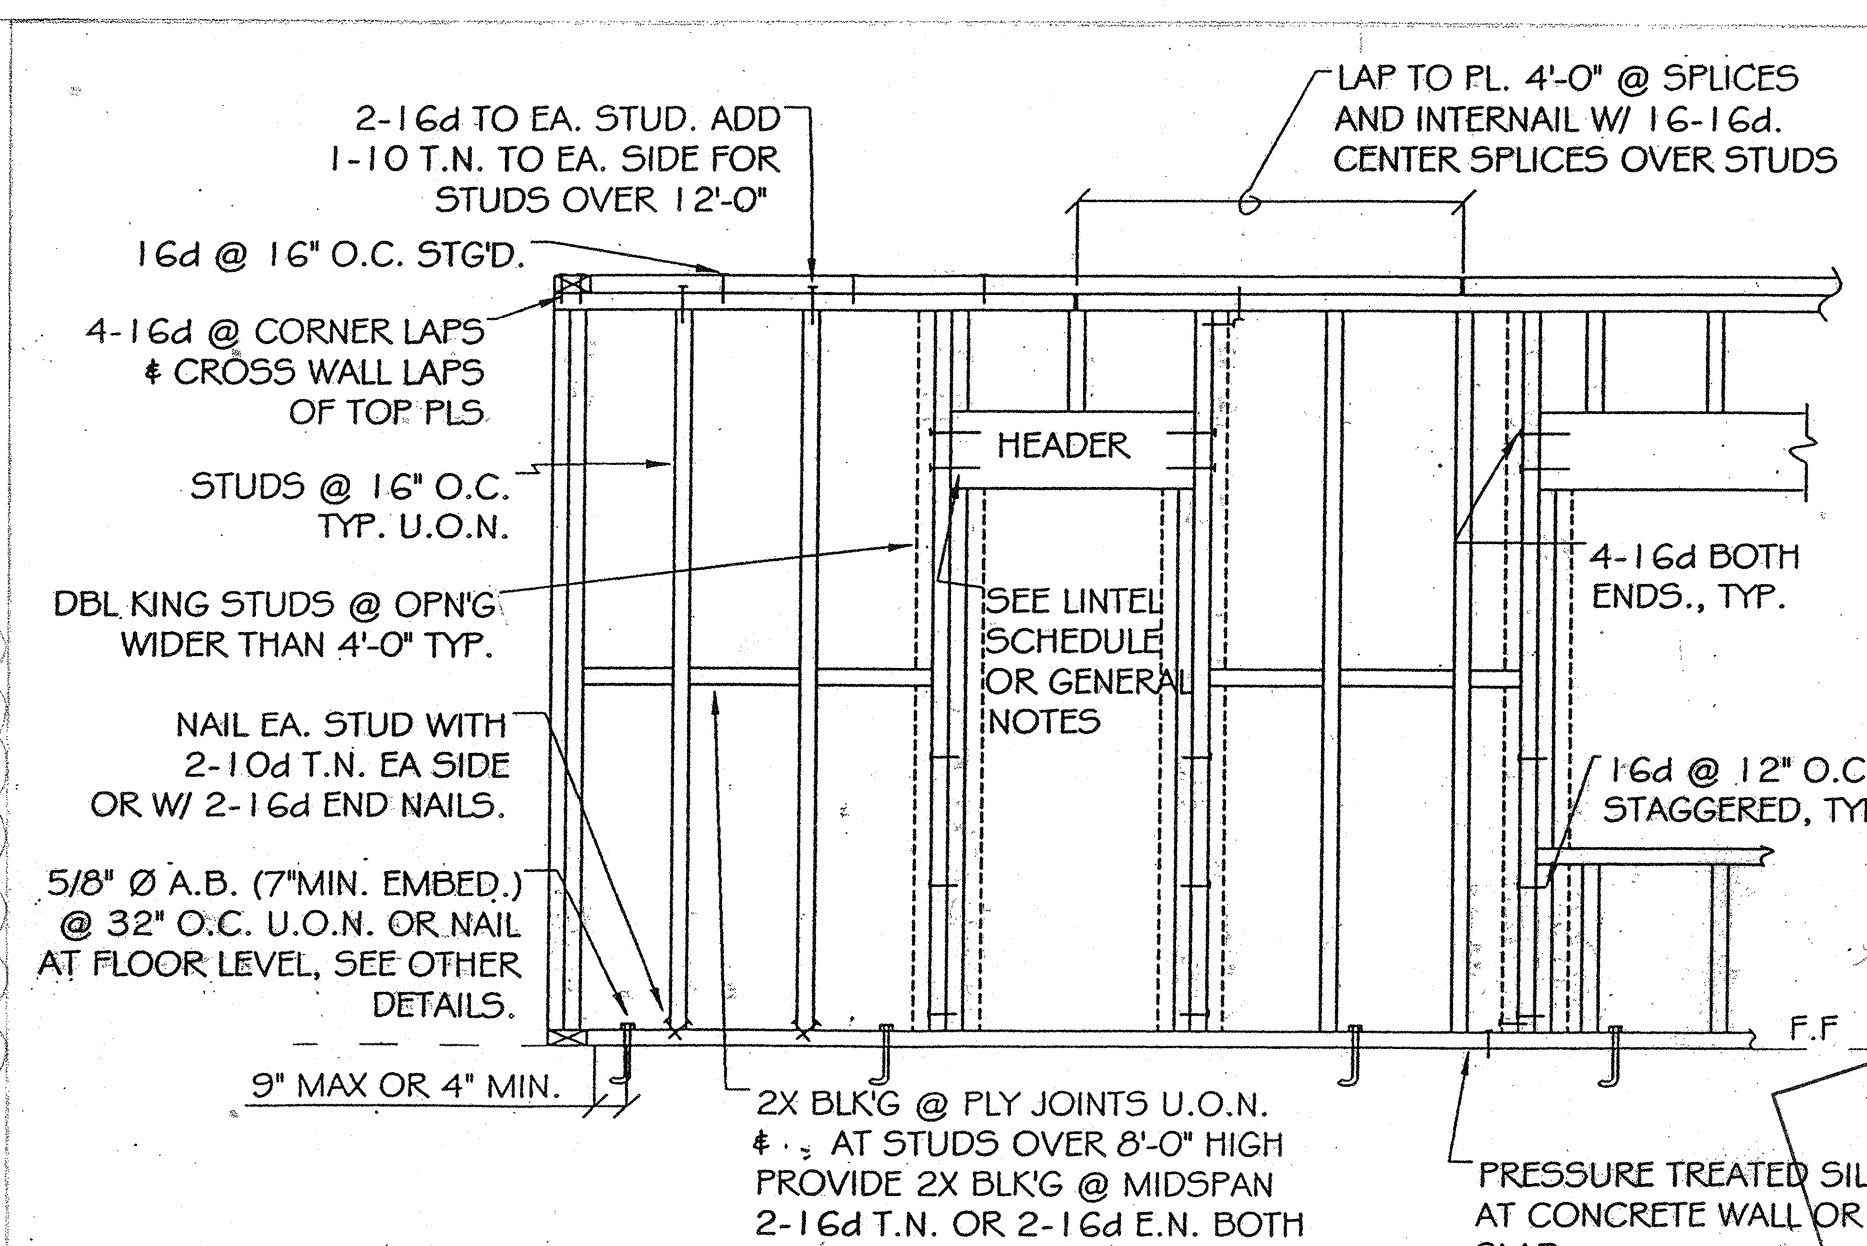

(B) TYPICAL STUD WALL FRAMING DETAILS
NTS

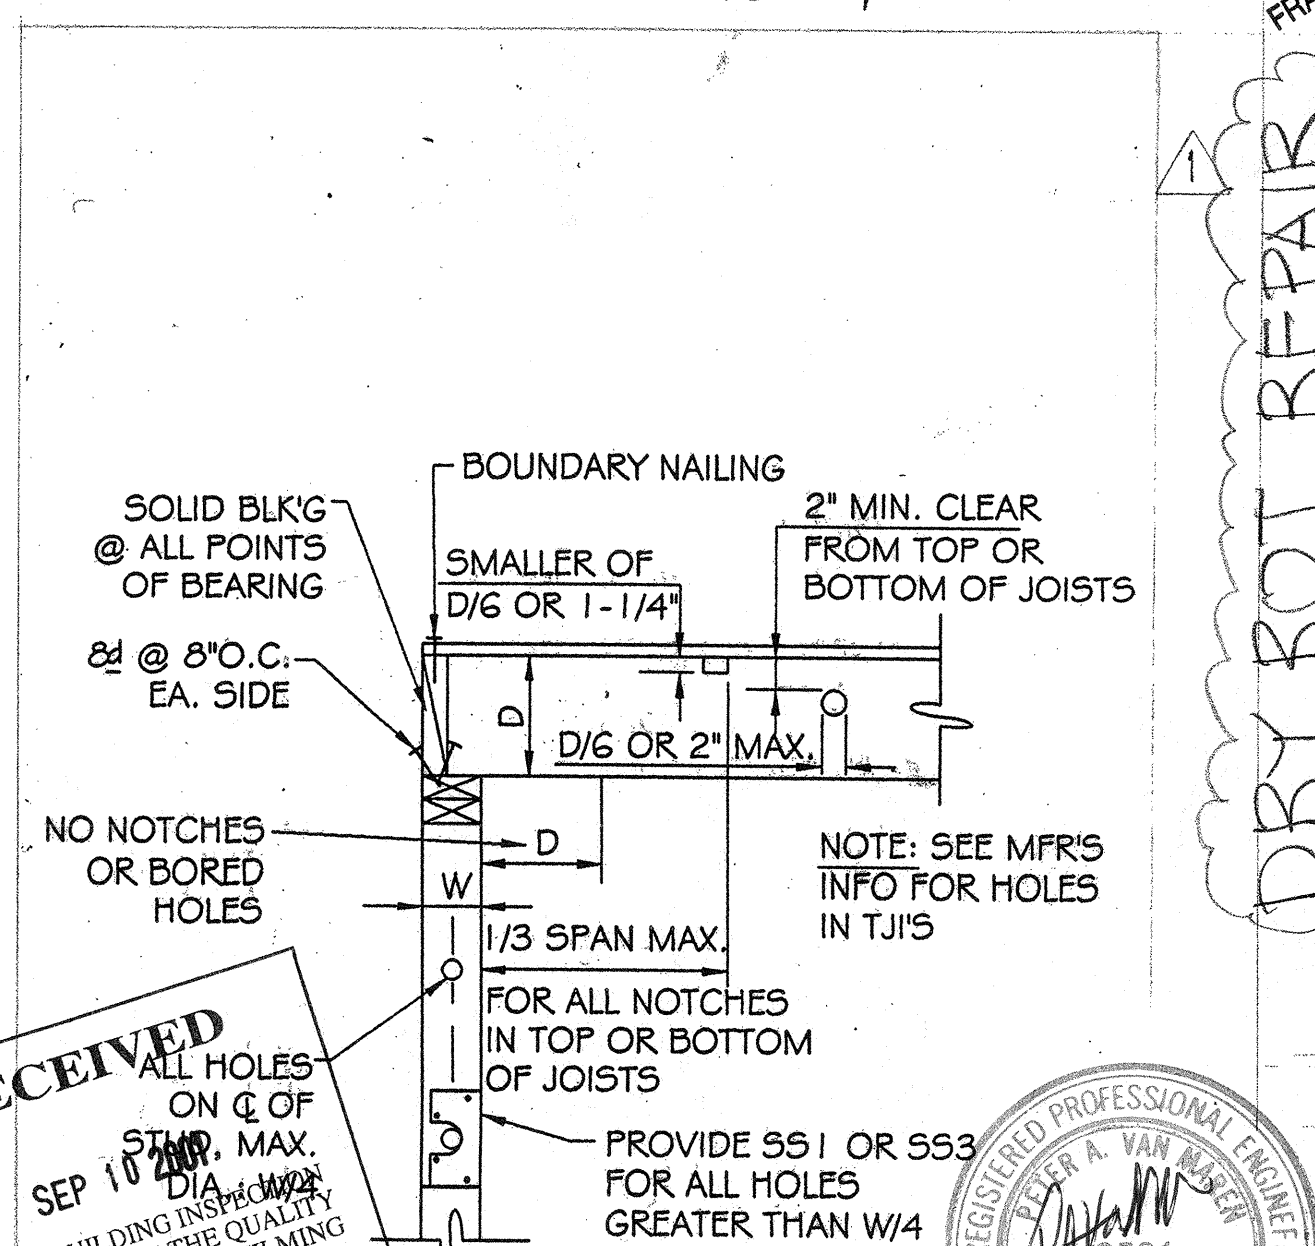

RECEIVED
SEP 10 2001
DEPT OF BUILDING INSPECTION
THIS PLAN MEETS THE QUALITY STANDARD FOR MICROFILMING
ACCEPT

REGISTERED PROFESSIONAL ENGINEER
STATE OF CALIFORNIA
SEP 11 2001

APPROVED
 DEPARTMENT OF BUILDING INSPECTION
 SEP 17 2001
 FRANK Y. CHIU, DIRECTOR


DOLPHIN CLUB
 SWIMMING & BOATING
 LOCKER ROOM & SHOWER EXPANSION
 PHASE 2
 SAN FRANCISCO
 ORGANIZED 1977



VAN MAREN & ASSOCIATES
 Consulting Civil and Structural Engineers
 460 Boulevard Way
 Oakland, CA 94610
 (510) 653-0675 fax: 653-2727





2ND FLOOR & ROOF FRAMING: DETAILS

PERMIT
 Date: DEC 2001
 Scale: AS NOTED
 Drawn:
 Job:
 Sheet:
 32
 OF 5 Sheets

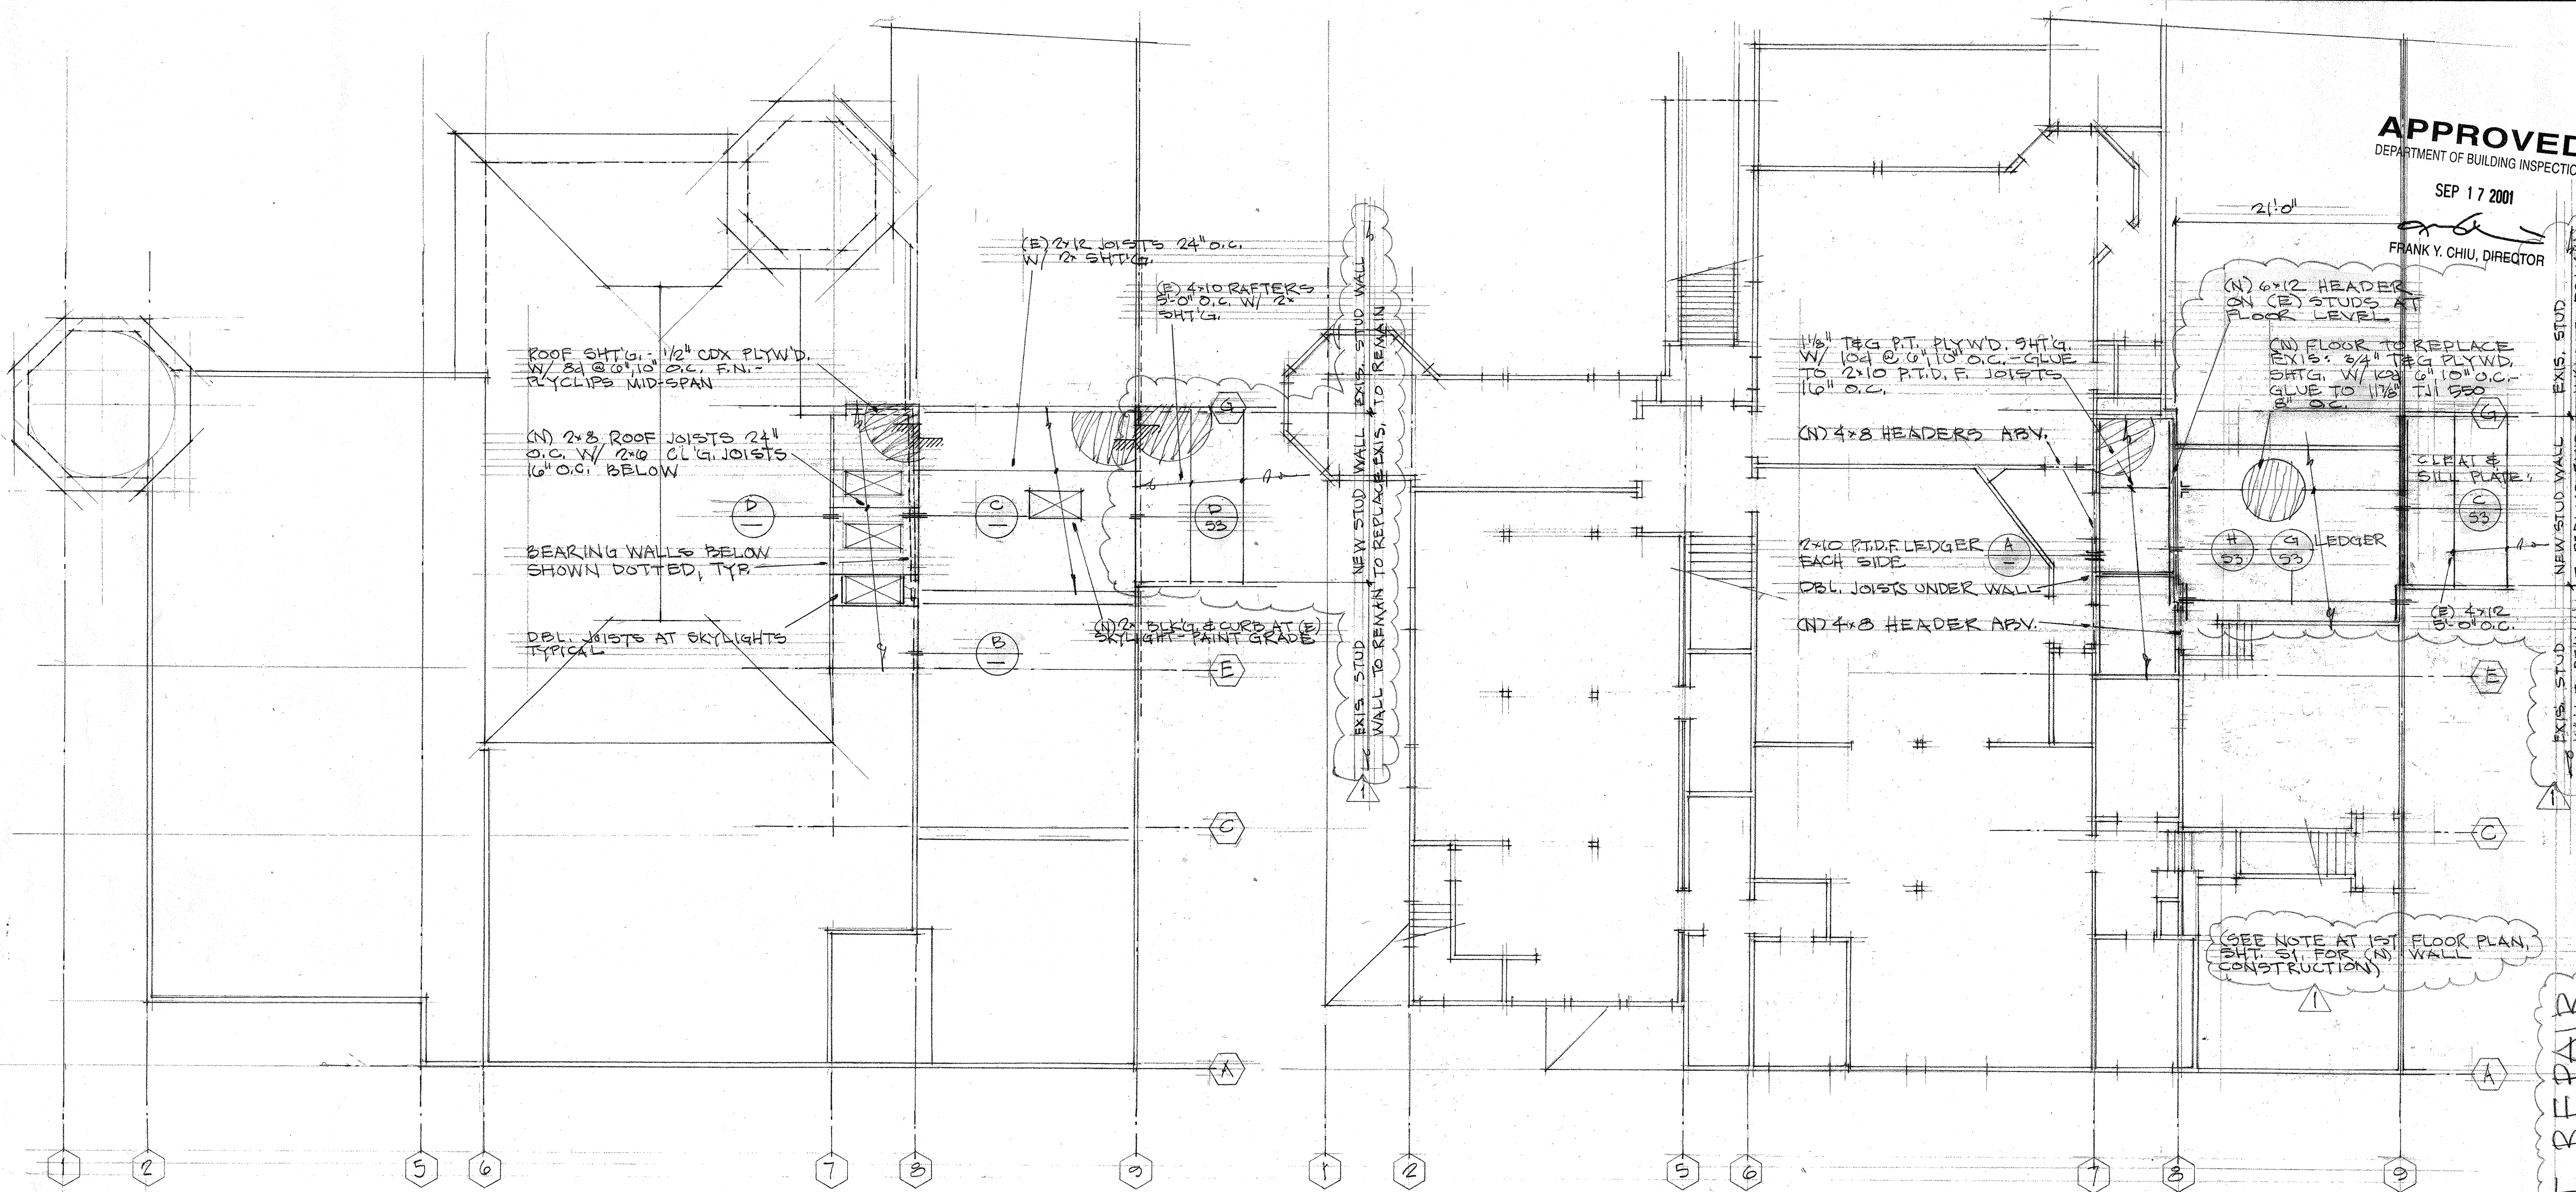

ROOF FRAMING PLAN

2ND FLOOR FRAMING PLAN

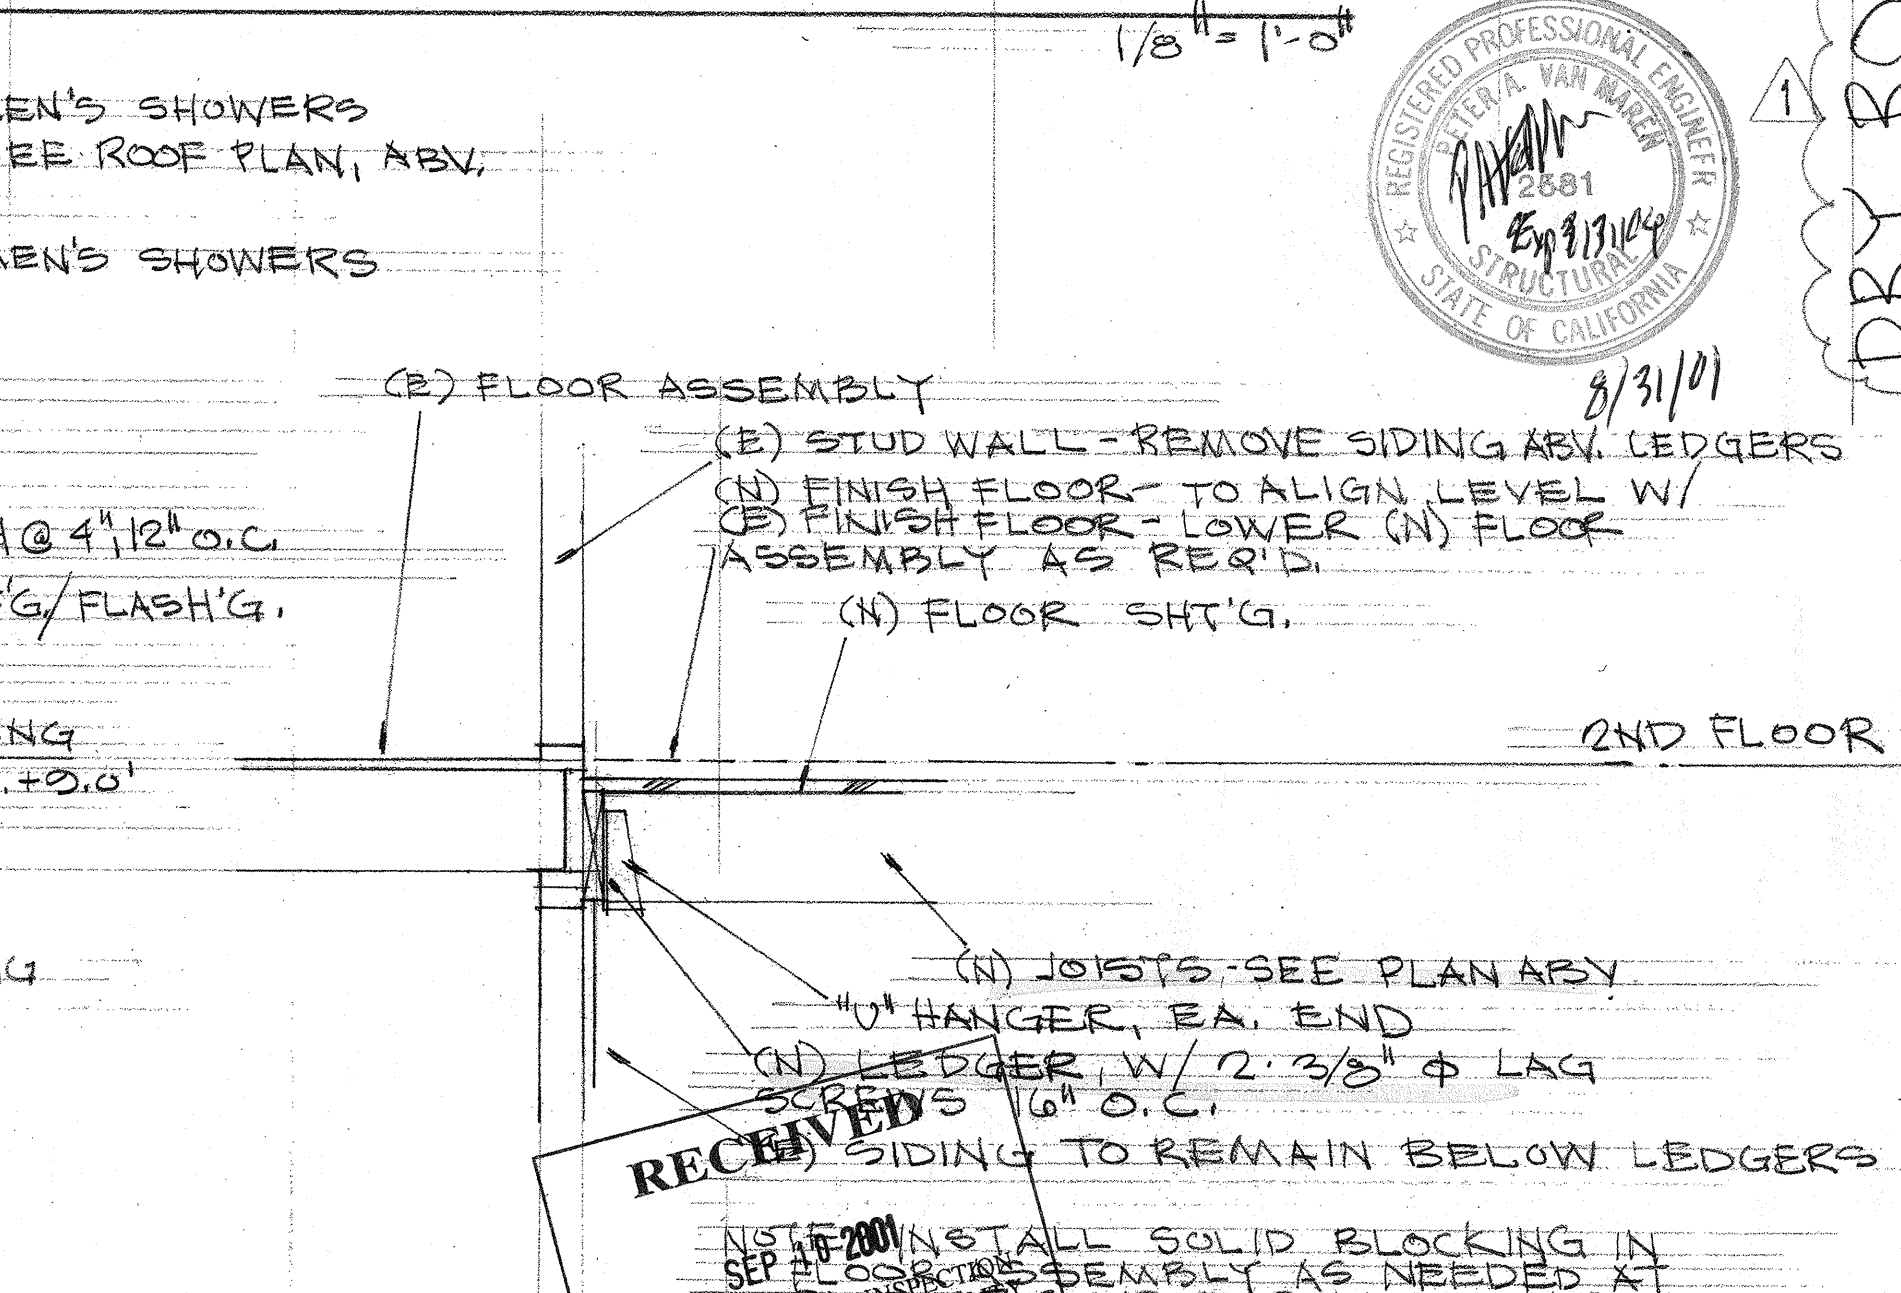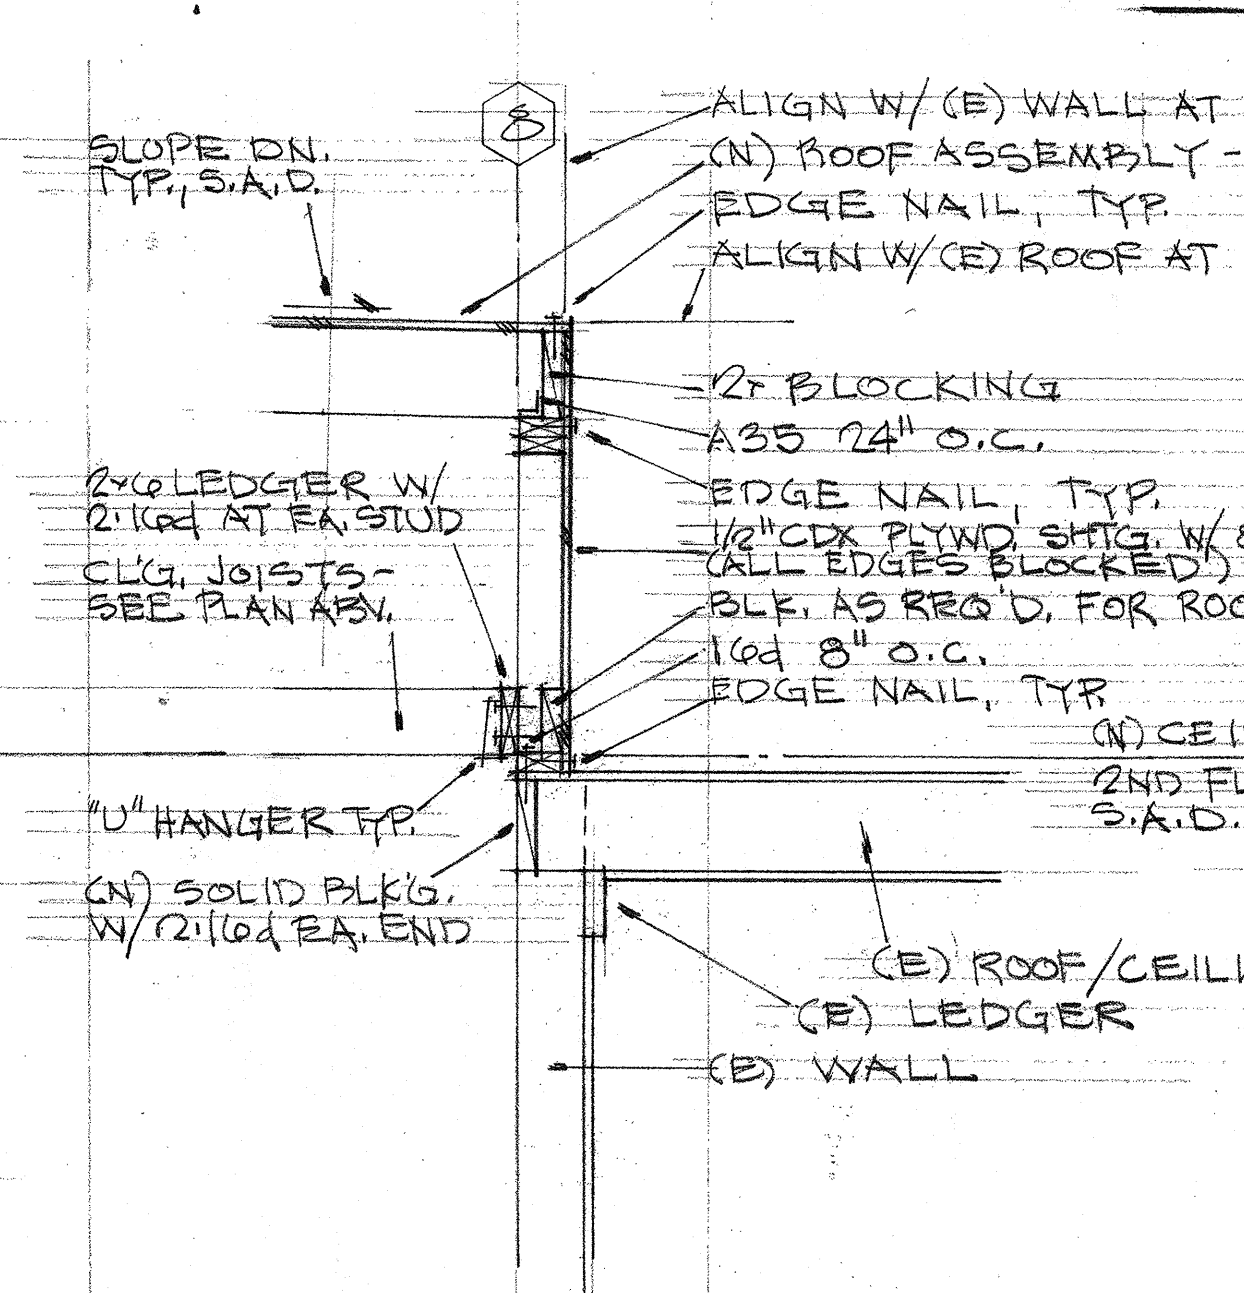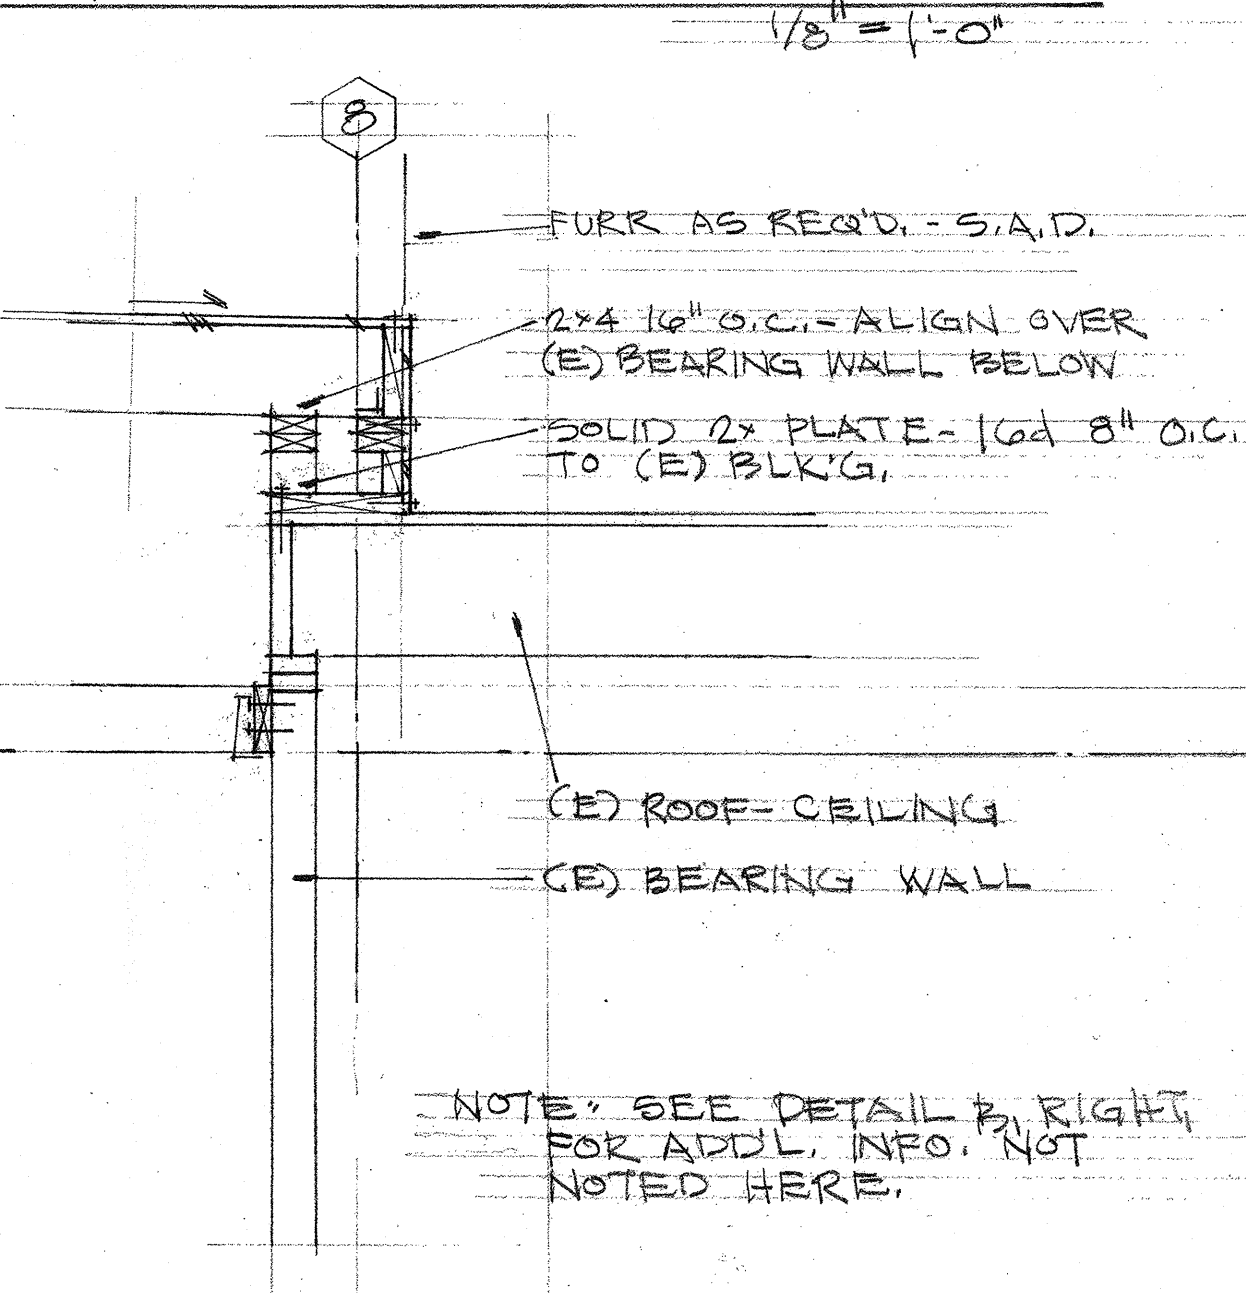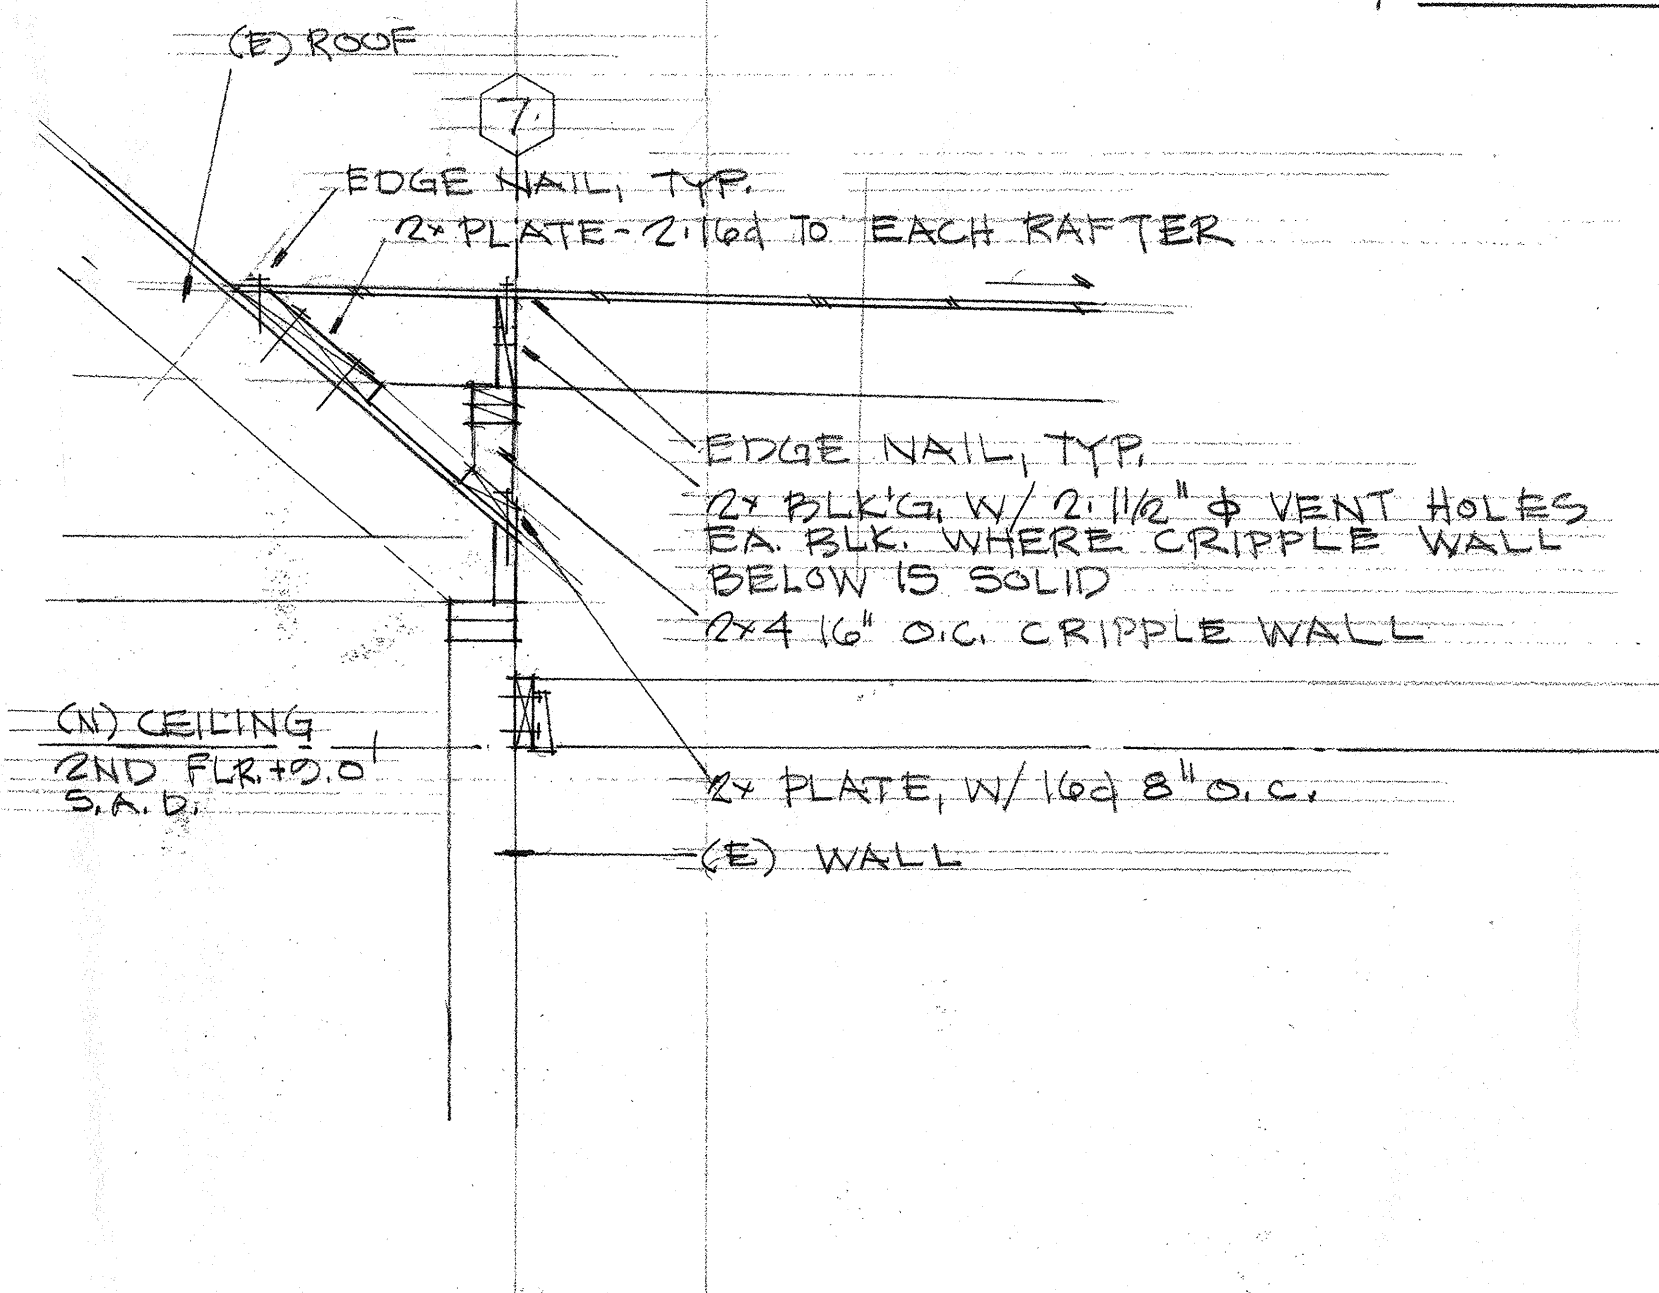


A ROOF FRAMING

B ROOF FRAMING

C ROOF FRAMING

D FLOOR FRAMING

RECEIVED
 SEP 17 2001
 DEPT. OF BUILDING INSPECTION
 THIS PLAN WISES THE BUILDING STUD FOR INSTALLATION
 STANDARD FOR MICROFILMING

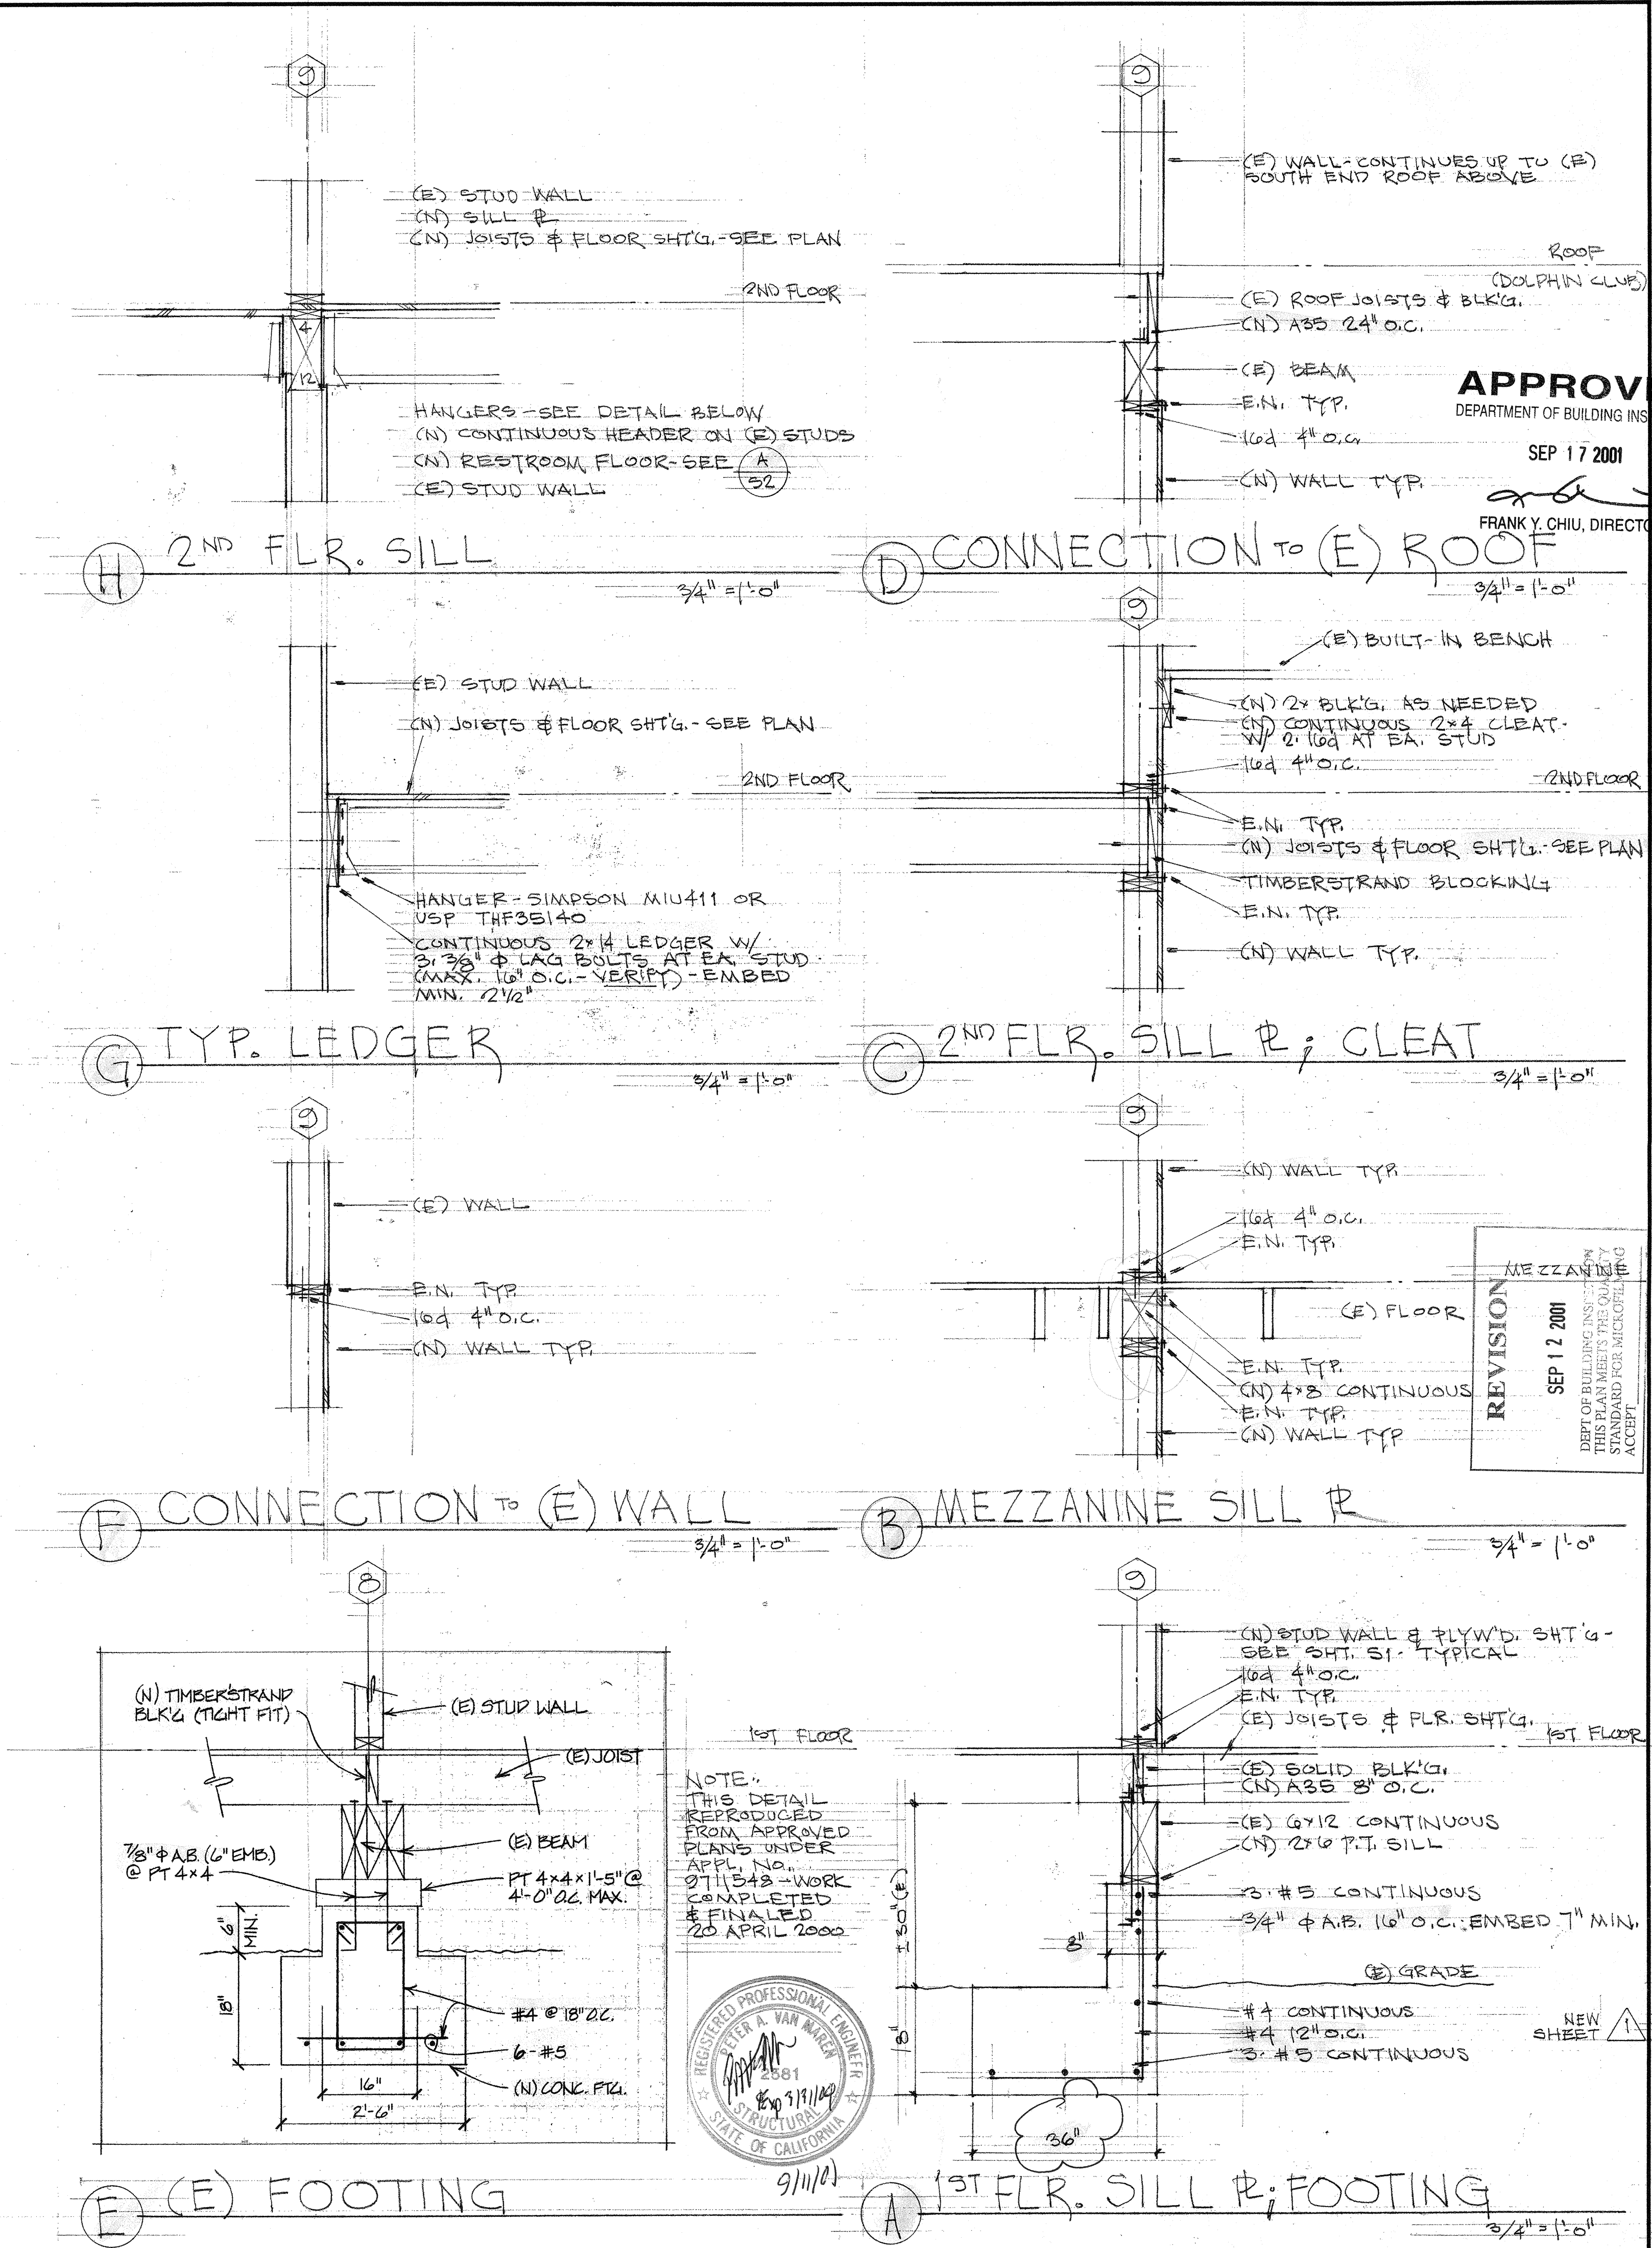

DOLPHIN CLUB
SWIMMING & BOATING
ORGANIZED BY
SAN FRANCISCO
LOCKER ROOM & SHOWER EXPANSION

2001/08/10/10/17/2002