
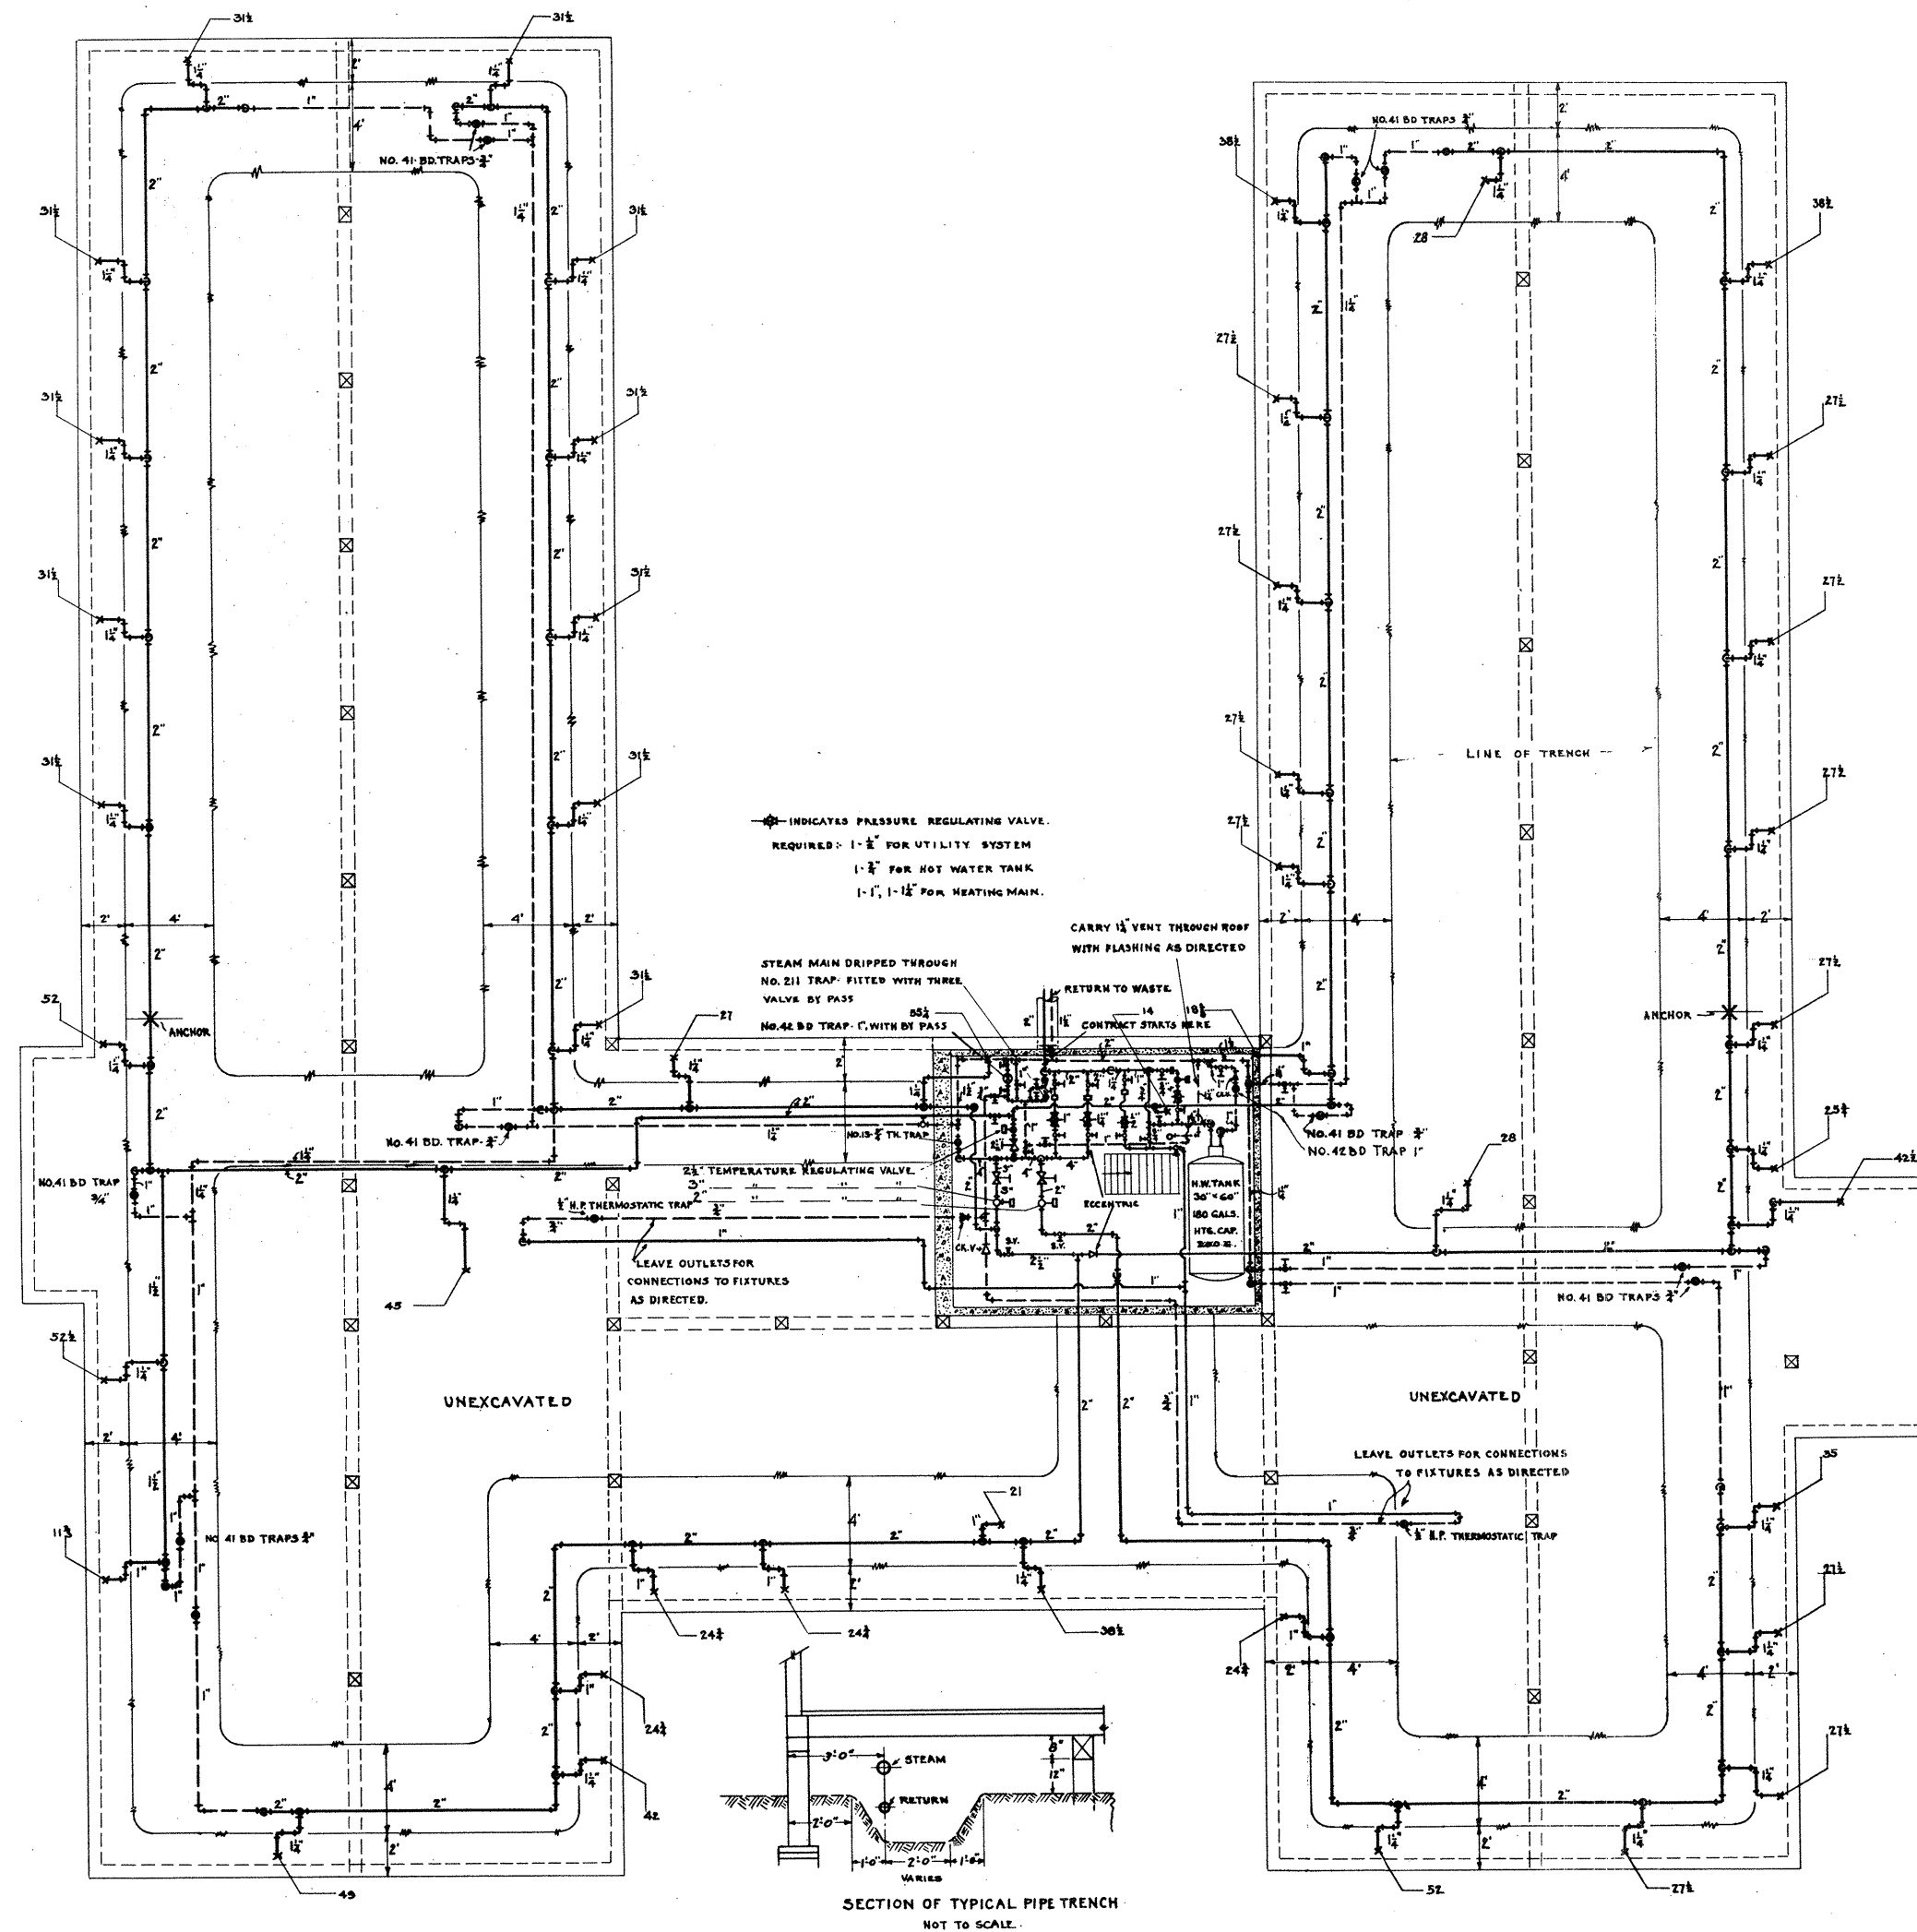
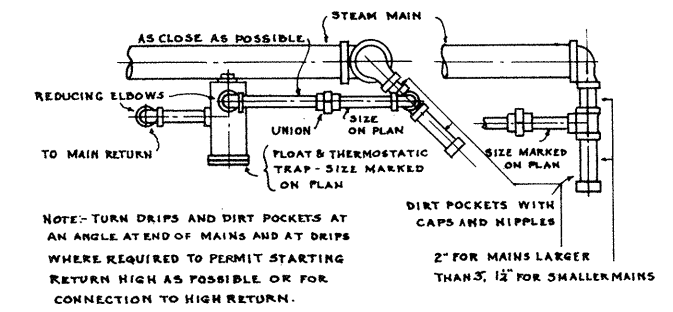
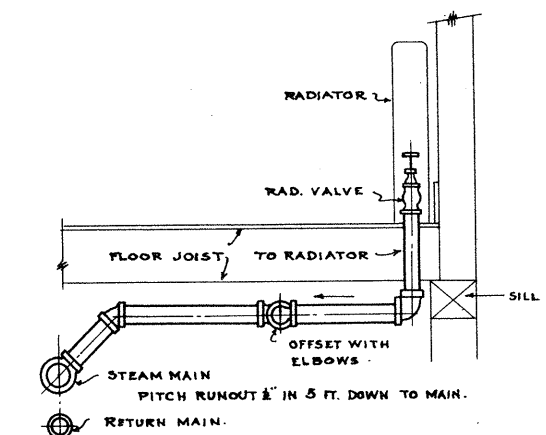


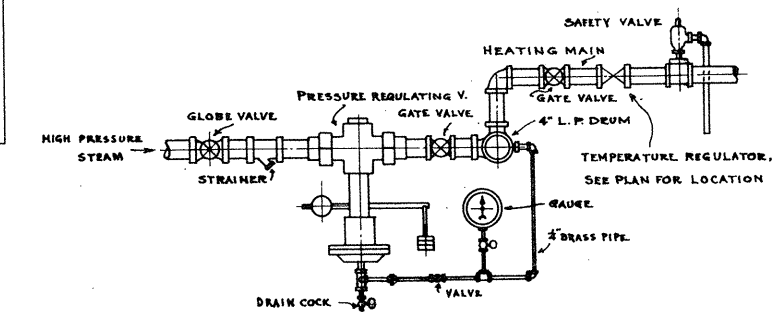

PIPE SPACE BELOW FIRST FLOOR

TYPICAL DRIP CONNECTION
NOT TO SCALETYPICAL RADIATOR RUNOUT
NOT TO SCALEPRESSURE REGULATING VALVE PIPING
NOT TO SCALE

HEATING

PASSAMAQUODDY BAY
TIDAL POWER DEVELOPMENT
TEMPORARY BUILDINGS

HOSPITAL
Sheet # 8 of 9 sheets Date Oct. '35
UNITED STATES ENGINEER OFFICE
EASTPORT, MAINE
JOHN P. THOMAS, ARCHITECT
THE FELS CO., HEATING ENGINEERS
PORTLAND, MAINE
Submitted by [Signature]
Approved [Signature]
MAJOR, U. S. ARMY
DISTRICT ENGINEER