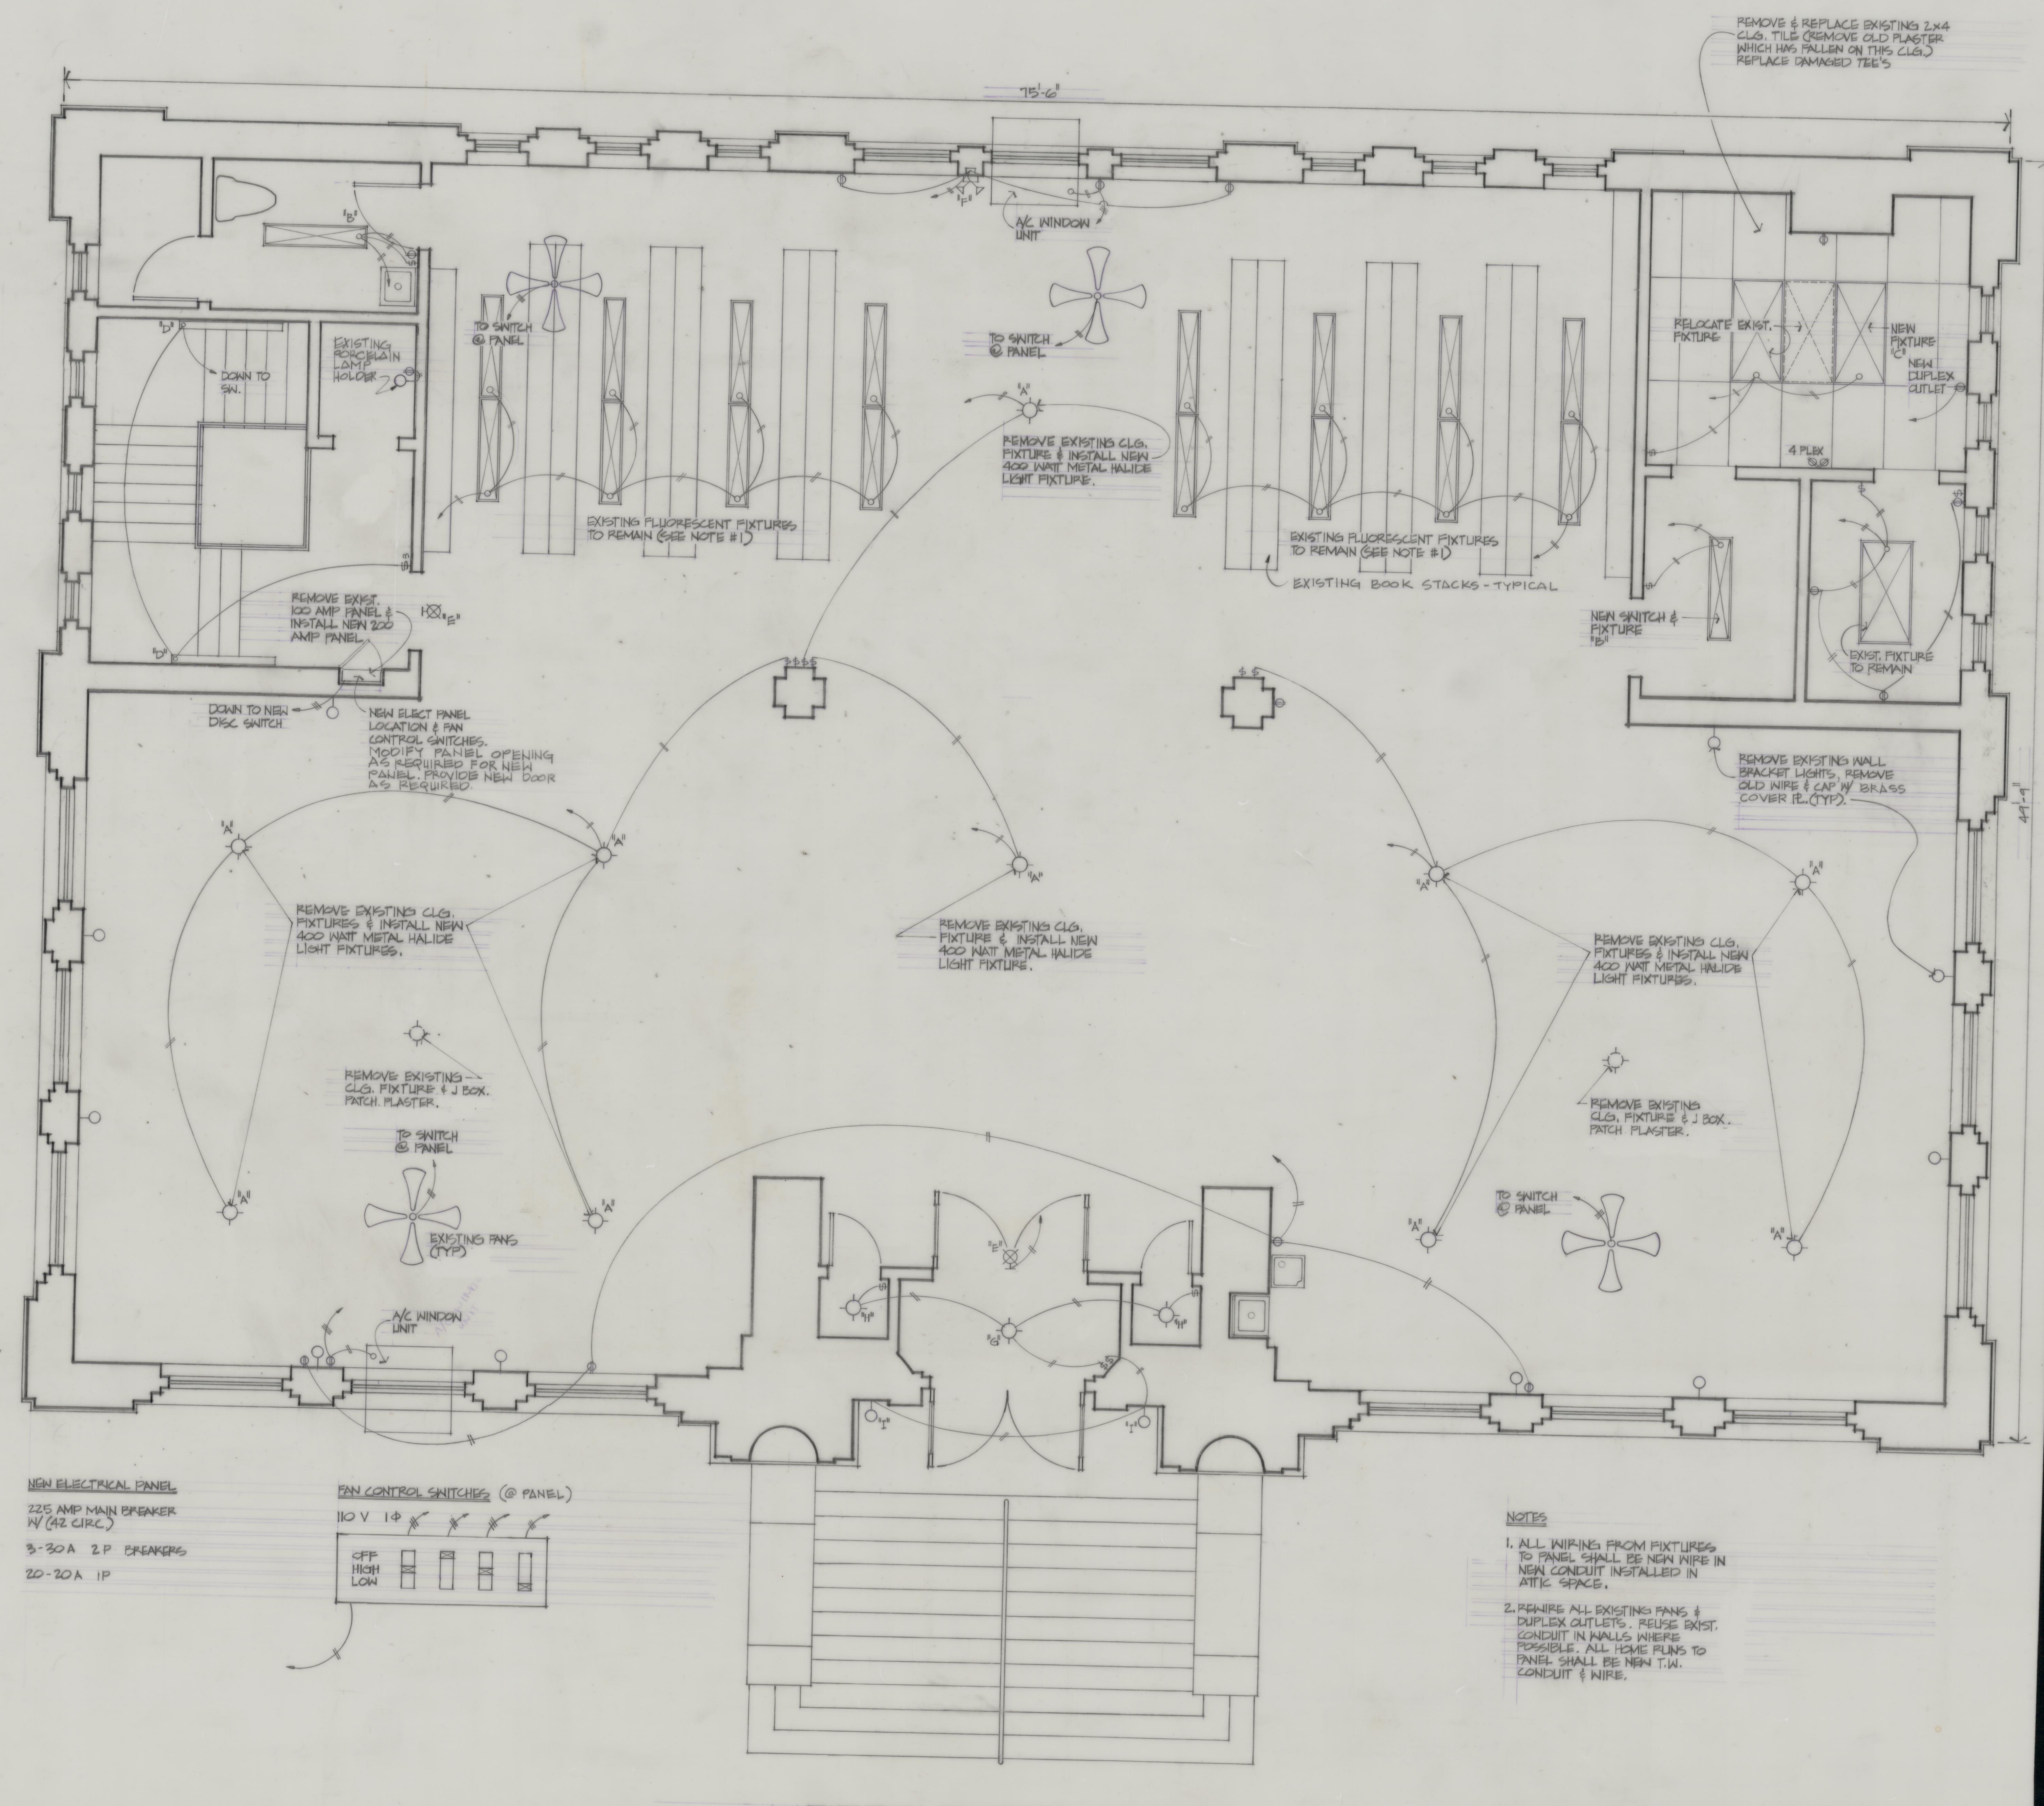

NEW ELECTRICAL PANEL

225 AMP MAIN BREAKER W/ (42 CIRC.)

3-30A 2P BREAKERS

20-20A 1P

FAN CONTROL SWITCHES (@ PANEL)

110 V 1Φ

OFF
HIGH
LOW

NOTES

1. ALL WIRING FROM FIXTURES TO PANEL SHALL BE NEW WIRE IN NEW CONDUIT INSTALLED IN ATTIC SPACE.
2. REWIRE ALL EXISTING FANS & DUPLEX OUTLETS. REUSE EXIST. CONDUIT IN WALLS WHERE POSSIBLE. ALL HOME RUNS TO PANEL SHALL BE NEW T.W. CONDUIT & WIRE.

FIRST FLOOR PLAN

1/4" = 1'-0"

Brunner & Brunner architects & engineers, inc.

ST. JOSEPH, MISSOURI 64501 (816) 279-0809

STATE OF MISSOURI WILLIAM A. BRUNNER NUMBER E-9246 REGISTERED PROFESSIONAL ENGINEER

STATE OF MISSOURI WILLIAM A. BRUNNER NUMBER A-2030 REGISTERED ARCHITECT

JOB NUMBER C803-2

DATE 12-30-86

DRAWN BY HOPKINS/FUSTON

CHECKED BY BRUNNER

REVISIONS

ELECTRICAL & WATERPROOFING ALTERATIONS TO WASHINGTON PARK LIBRARY

THIRD & MARKET ST. JOSEPH, MO

SHEET NUMBER 1

TOTAL SHEETS 2