Interior Light Fixture Schedule

Mark	Mfg	Catalog No	Lamp Type	Remarks
A	Lithonia	E12 100M CC 120	MS 400/SL/BU-only Metal Halide	Cut existing plaster clg — provide hangers for wood joist — new conduit & wiring
B	Lithonia (Equivalent Day Bright, Williams or Midwest Chandelier	LB 240A-120 ES	2-F-40T12 LW/ES 34 watt Fluorescent	Acrylic prismatic diffuser w/ gasket welded in. Mounted Ems Advance Mark II ES: Ballast
C	" " "	2GS240 RW A12	4-F-40T12 LW/ES Lamps	Acrylic prismatic lense 2'x4' Advance Mark III Class 'P' ES Ballast thermally protected
D	Day Bright	#52HOW utility-mounted fixture for 2-35W RS Lamps. Acrylic Prismatic bottom lens in hinged metal bracket door with spring loaded trigger type latches and ribbed acrylic top panel. Less connection receptacle. Finish baked white enamel		Note
E	Devine or Dynary	UB-1835EM-110V exit fixture with emergency battery pack. Provide for top, end or back mounting 110 Volt		
"F"	Dual Light Equipment Emergency on Big Beam	ALC-K-30-2 Long life lead Emergency lighting unit with (2) NE 500 Lamp Heads for 110 Volt connection		

THIS GIES TO SPEC

New Effet Panel

225 Amp Main Breaker w/ (42 Circ)

3-30 A 2P Breakers

20-20 A 1P

From Canteen Switches 110 V 1φ

OFF
HIGH
LOW

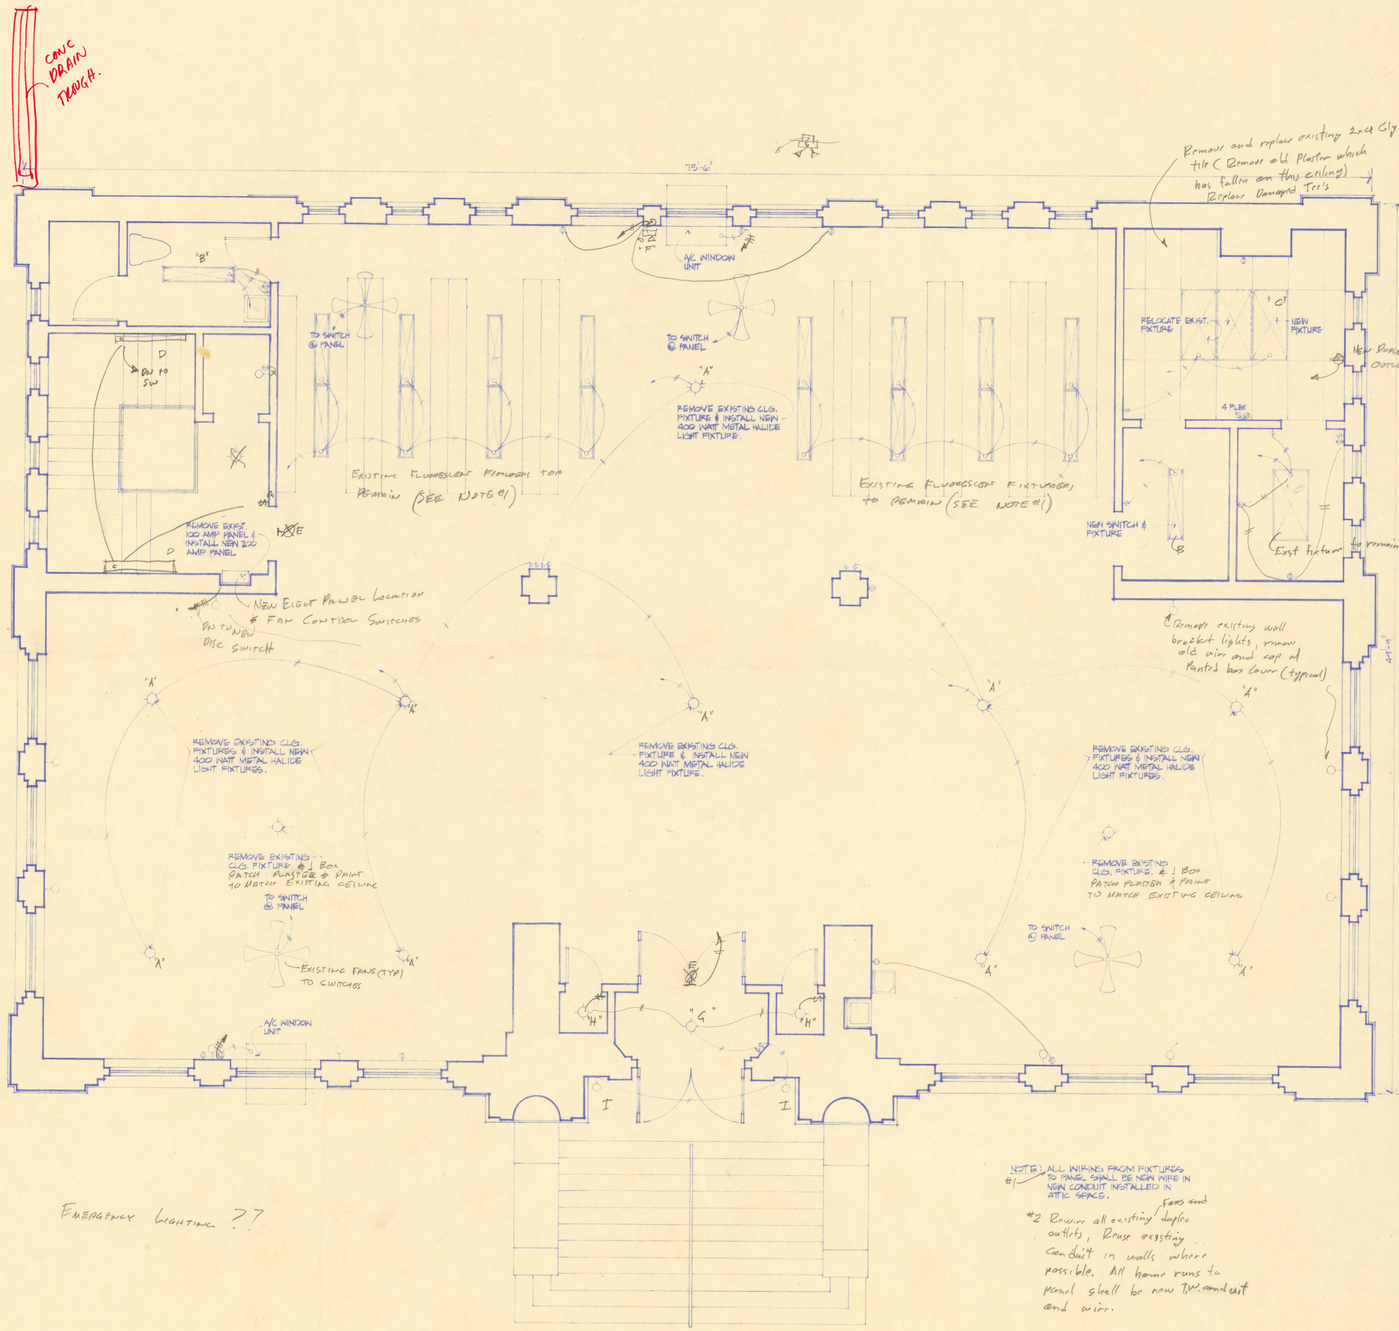

Emergency Lighting ??

NOTE: #1 ALL WIRING FROM FIXTURES TO PANEL SHALL BE NEW WIRE IN NEW CONDUIT INSTALLED IN ATTIC SPACE.

#2 Remove all existing duplex outlets, Reuse existing fans and conduit in walls where possible. All home runs to panel shall be new TW wire and conduit and wire.

FIRST FLOOR PLAN

1/4" = 1'-0"

Brunner & Brunner
architects & engineers, inc.
ST. JOSEPH, MISSOURI 64501 (816) 279-0809

ELECTRICAL RENOVATION

WASHINGTON PARK LIBRARY

THIRD & MARKET

ST. JOSEPH, MO

JOB NUMBER

DATE

DRAWN BY

CHECKED BY

REVISIONS

SHEET NUMBER 7

TOTAL SHEETS 8

2003.33.3810A