


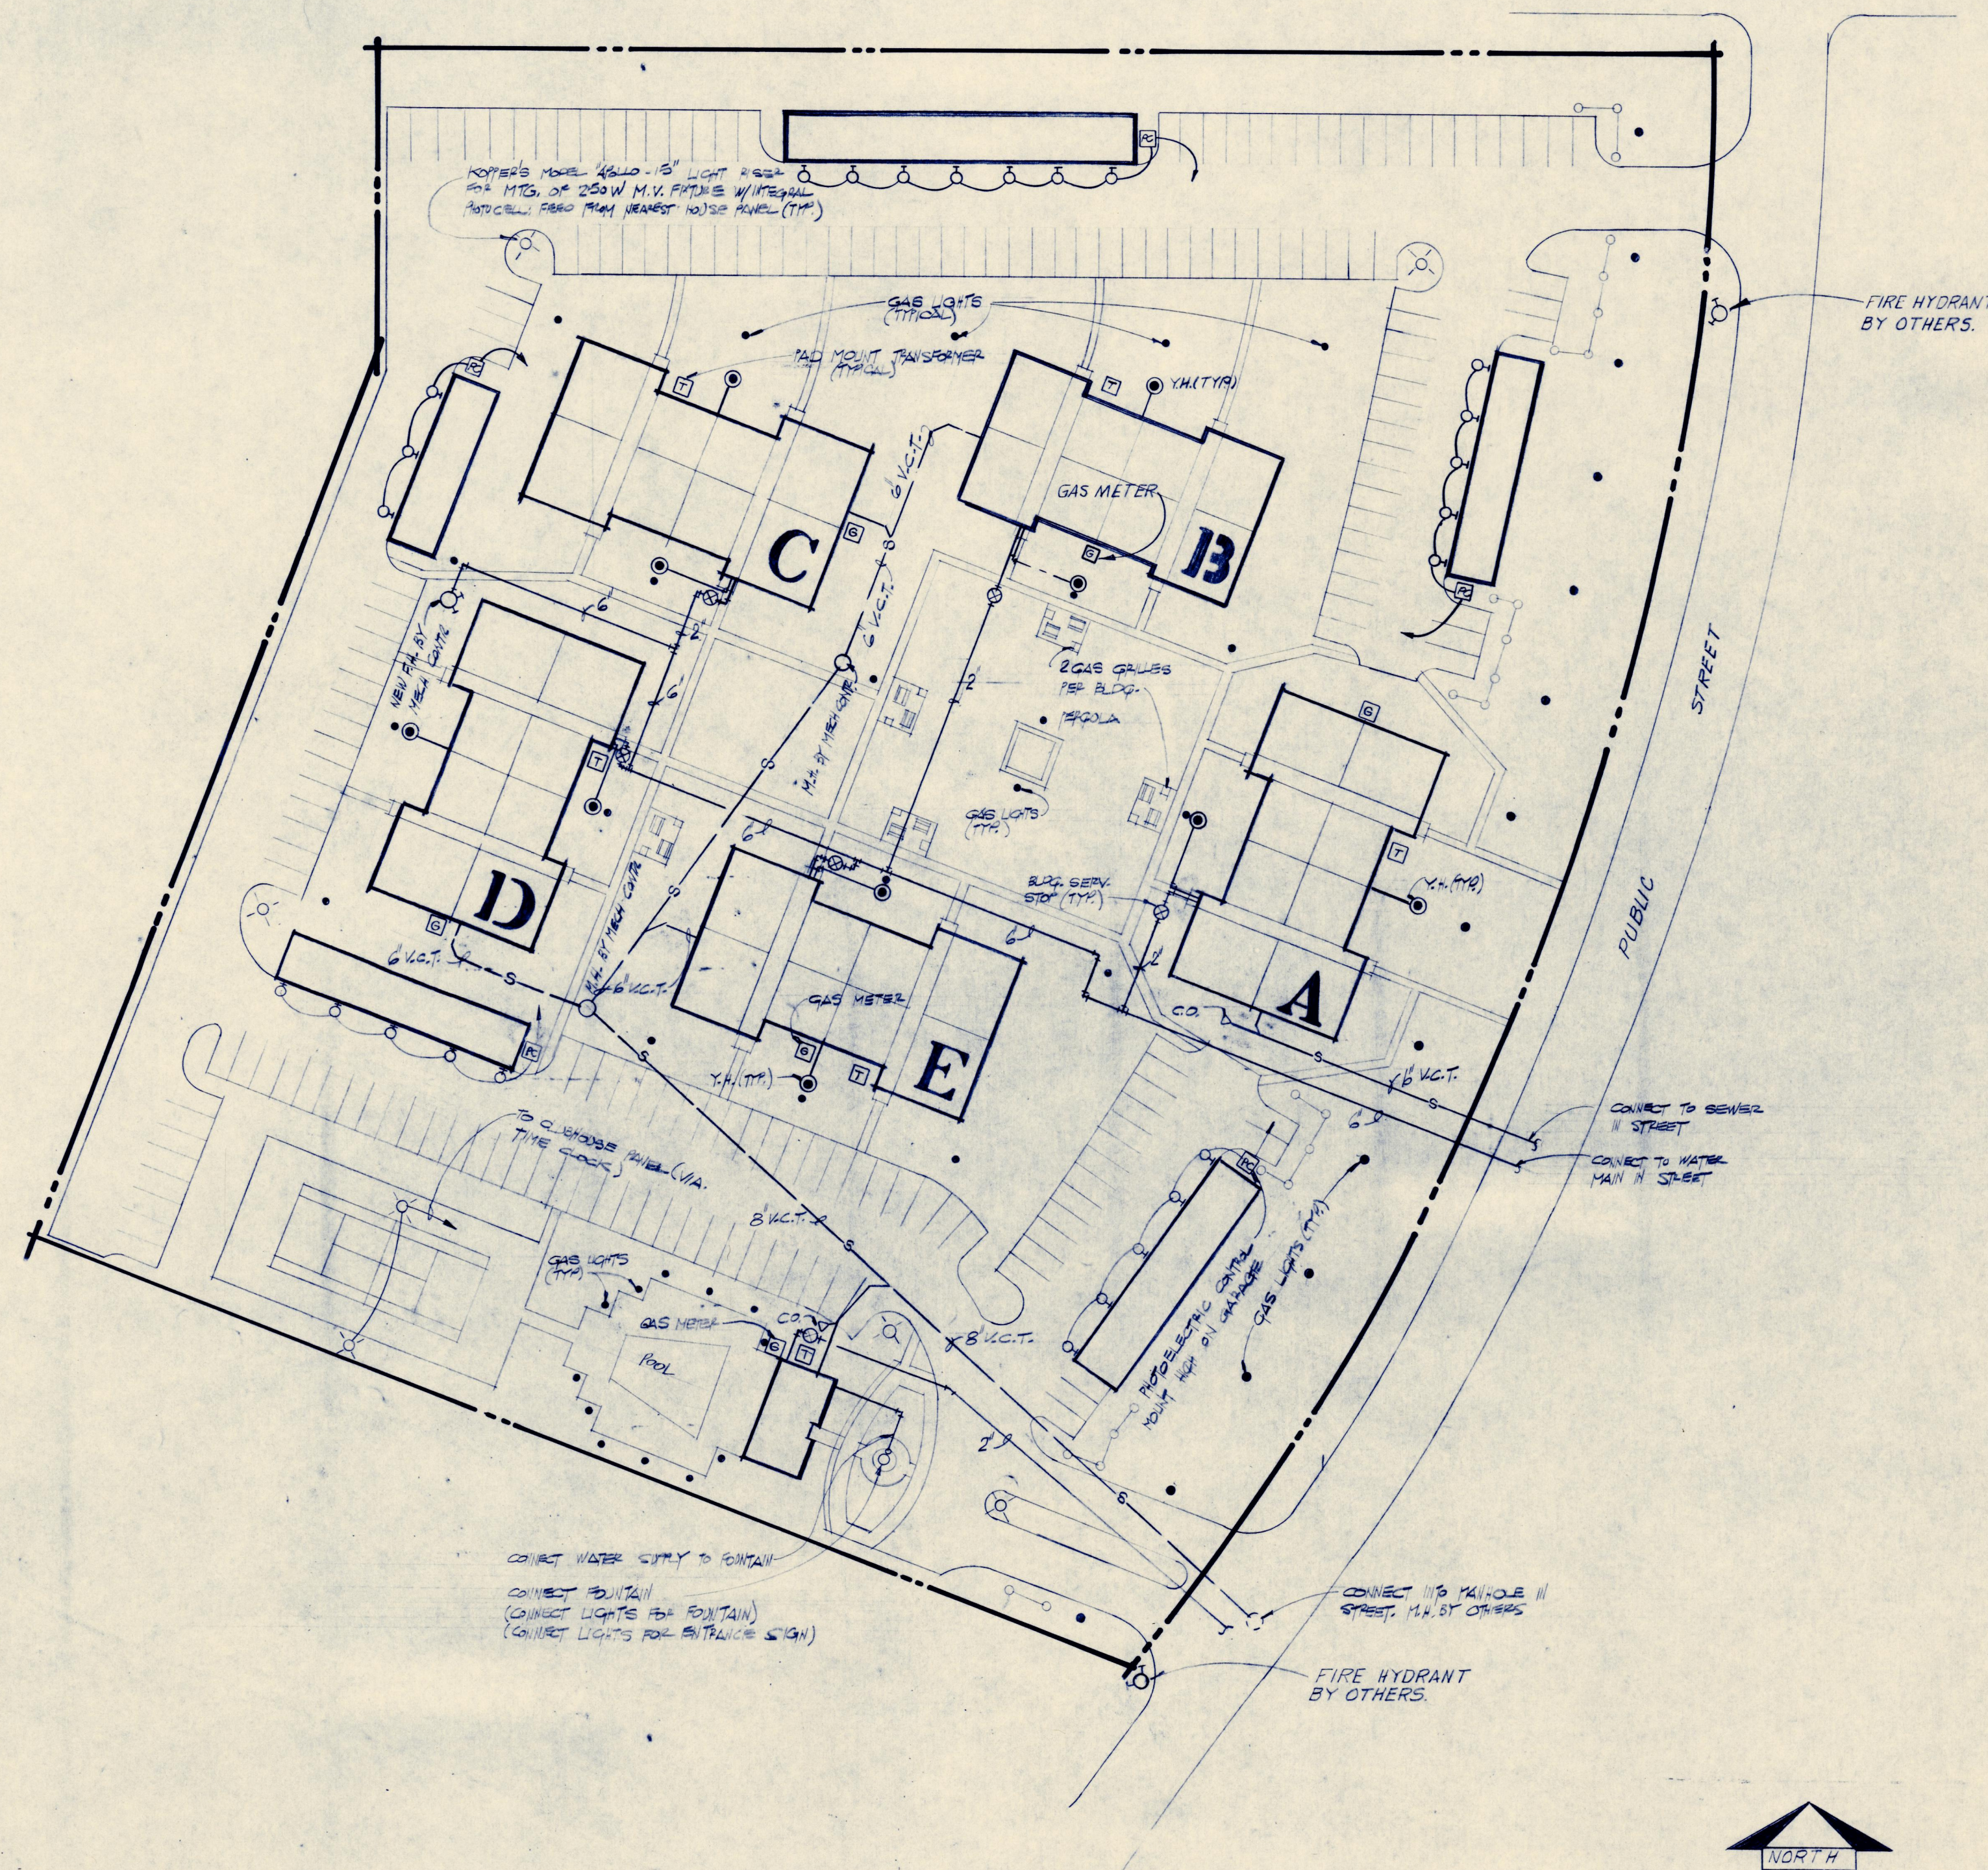

NOTE:
MECHANICAL SUB-CONTRACTOR SHALL PROVIDE SUB-OUT AND SHUTOFF VALVE @ EACH BUILDING FOR PEOPLES NATURAL GAS COMPANY REQUIREMENTS. GAS SERVICE TO BUILDING METERS, GAS METERS, GAS GAUGES AND GAS LIGHTS WILL BE FURNISHED AND INSTALLED BY PEOPLES NATURAL GAS COMPANY. GAS LINES TO LIGHTS AND GAUGES SHALL BE COATED PIPE AND BURNED.

ELECTRICAL SYMBOLS

○	INCANDESCENT CEILING OUTLET, LETTER INDICATES TYPE
⊗	BRACKET OUTLET
⊙	EXIT LIGHT
⊕	DUPLEX CONVENIENCE OUTLET
⊖	BRANCH RACEWAY CONCEALED IN CEILING OR WALL, CROSS LINES INDICATE NO. OF WIRES
⊖	BRANCH RACEWAY CONCEALED IN FLOOR
⊖	HOMERUN TO PANEL, NO. OF ARROWS INDICATES NO. OF CIRCUITS
⊖	SINGLE POLE SWITCH
⊖	3-WAY SWITCH
⊖	4-WAY SWITCH
⊖	600 W DIMMING SWITCH
⊖	TELEPHONE OUTLET
⊖	LOAD CENTER
⊖	POWER PANEL
⊖	DISCONNECT SWITCH
⊖	MOTOR - NO INDICATES HORSEPOWER
⊖	FUSTAT
⊖	WEATHERPROOF
⊖	TELEVISION OUTLET

MECHANICAL SYMBOLS

— G —	GAS PIPING
— C.W. —	COLD WATER (C.W.)
— H.W. —	HOT WATER (H.W.)
— H.W.R. —	HOT WATER RECIRCULATION
— S.D. —	WASTE-SOIL DRAIN BELOW SLAB OR UNDERGROUND
— S.D. —	WASTE-SOIL DRAIN VENT (V.)
⊙ S.D.	SITE DRAIN FOR COILS CONDENSATE
⊙ F.D.	FLOOR DRAIN
⊙ G.V.	GATE VALVE
⊙ G.V.	GLOBE VALVE
⊙ P.V.	PLUG VALVE
⊙ T.	THERMOSTAT
⊙ Y.H.	YARD HYDRANT
⊙ G.B.G.	GAS BARB GRILLE
⊙ C.	CLEANOUT
⊙ S.H.	SHOWER
⊙ D.U.	DUCT ABOVE OR AT CEIL, CENTER-LINE
⊙ B.D.T.	BRANCH DUCT TAKE-OFF ON TOP OF MAIN DUCT
⊙ D.V.D.	DUCT WITH VOLUME DAMPER
⊙ S.A.D.S.	SUPPLY AIR DUCT SECTION
⊙ R.E.D.S.	RETURN OR EXHAUST DUCT SECTION
⊙ E.R.A.F.	EXHAUST OR RETURN AIR FLOW
⊙ S.A.F.	SUPPLY AIR FLOW
⊙ S.D.	SPLITTER DAMPER
⊙ C.V.	CHECK VALVE
⊙ B.J.	BETWEEN JOISTS

JOB NUMBER
312 A

DATE
6-7-71

JOB CAPTAIN
FUSTON

DRAWN BY
E.A.

CHECKED BY
FUSTON

REVISIONS
10-7-71

(402) 397-7557

OMAHA, NEBRASKA 68106

6969 GROVER STREET

2001.33.2326 D

ENGINEERING ASSOCIATES, INC.
CONSULTING ENGINEERS

SHEET NUMBER
3
TOTAL SHEETS