

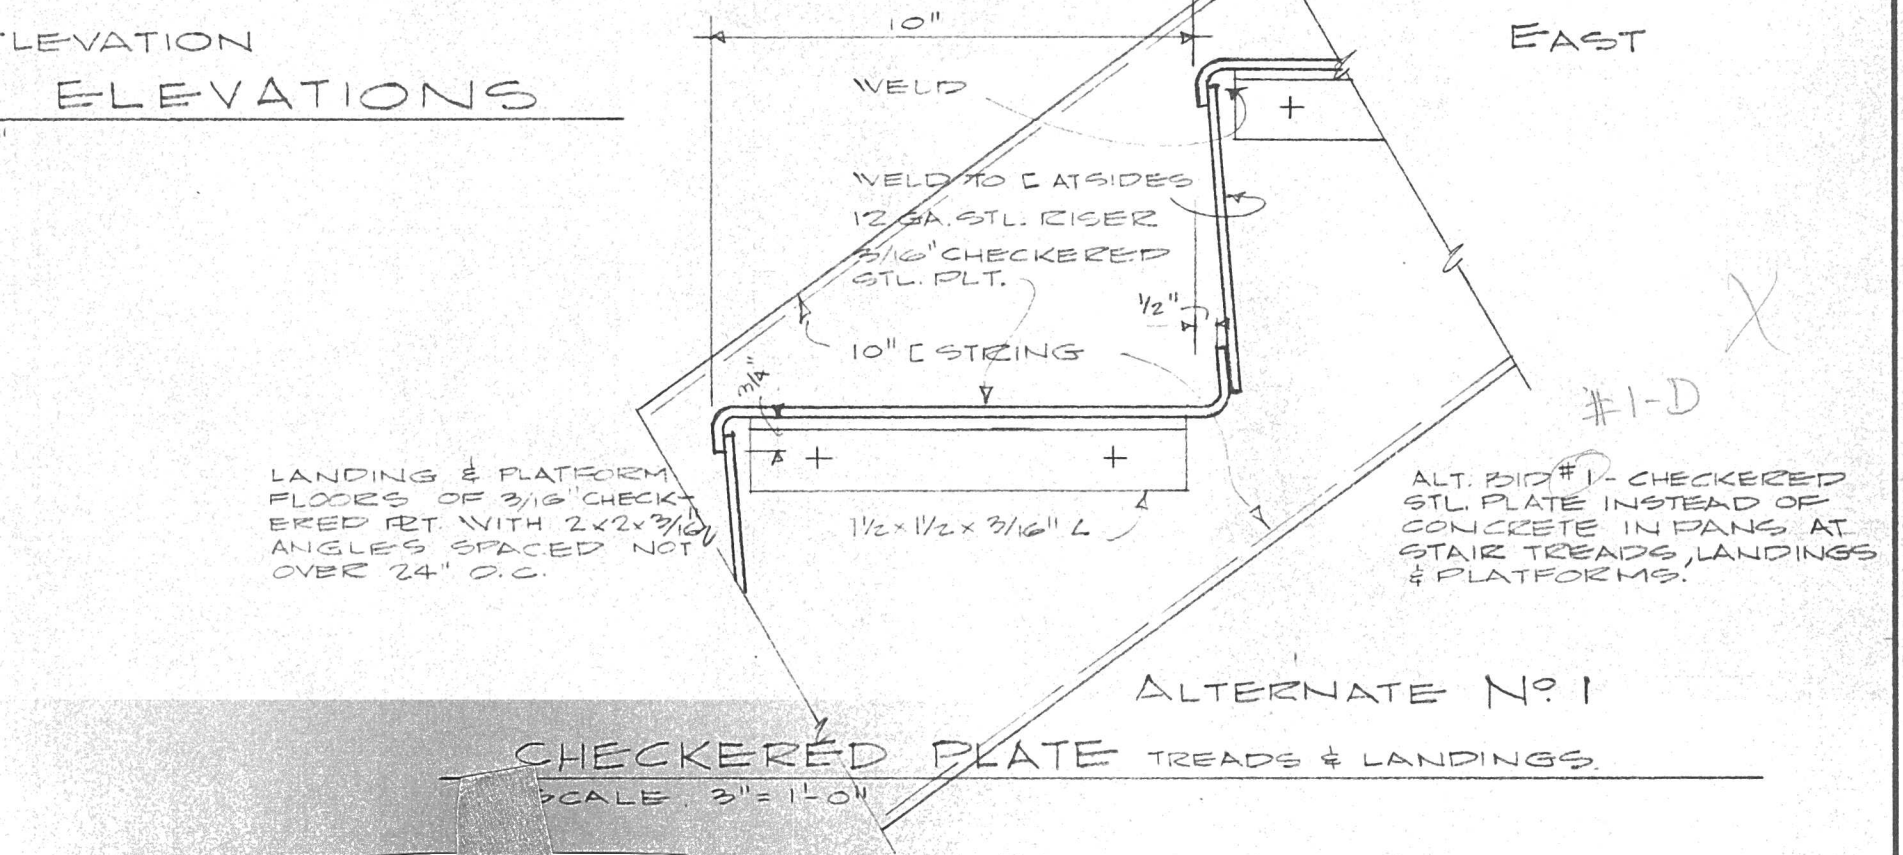
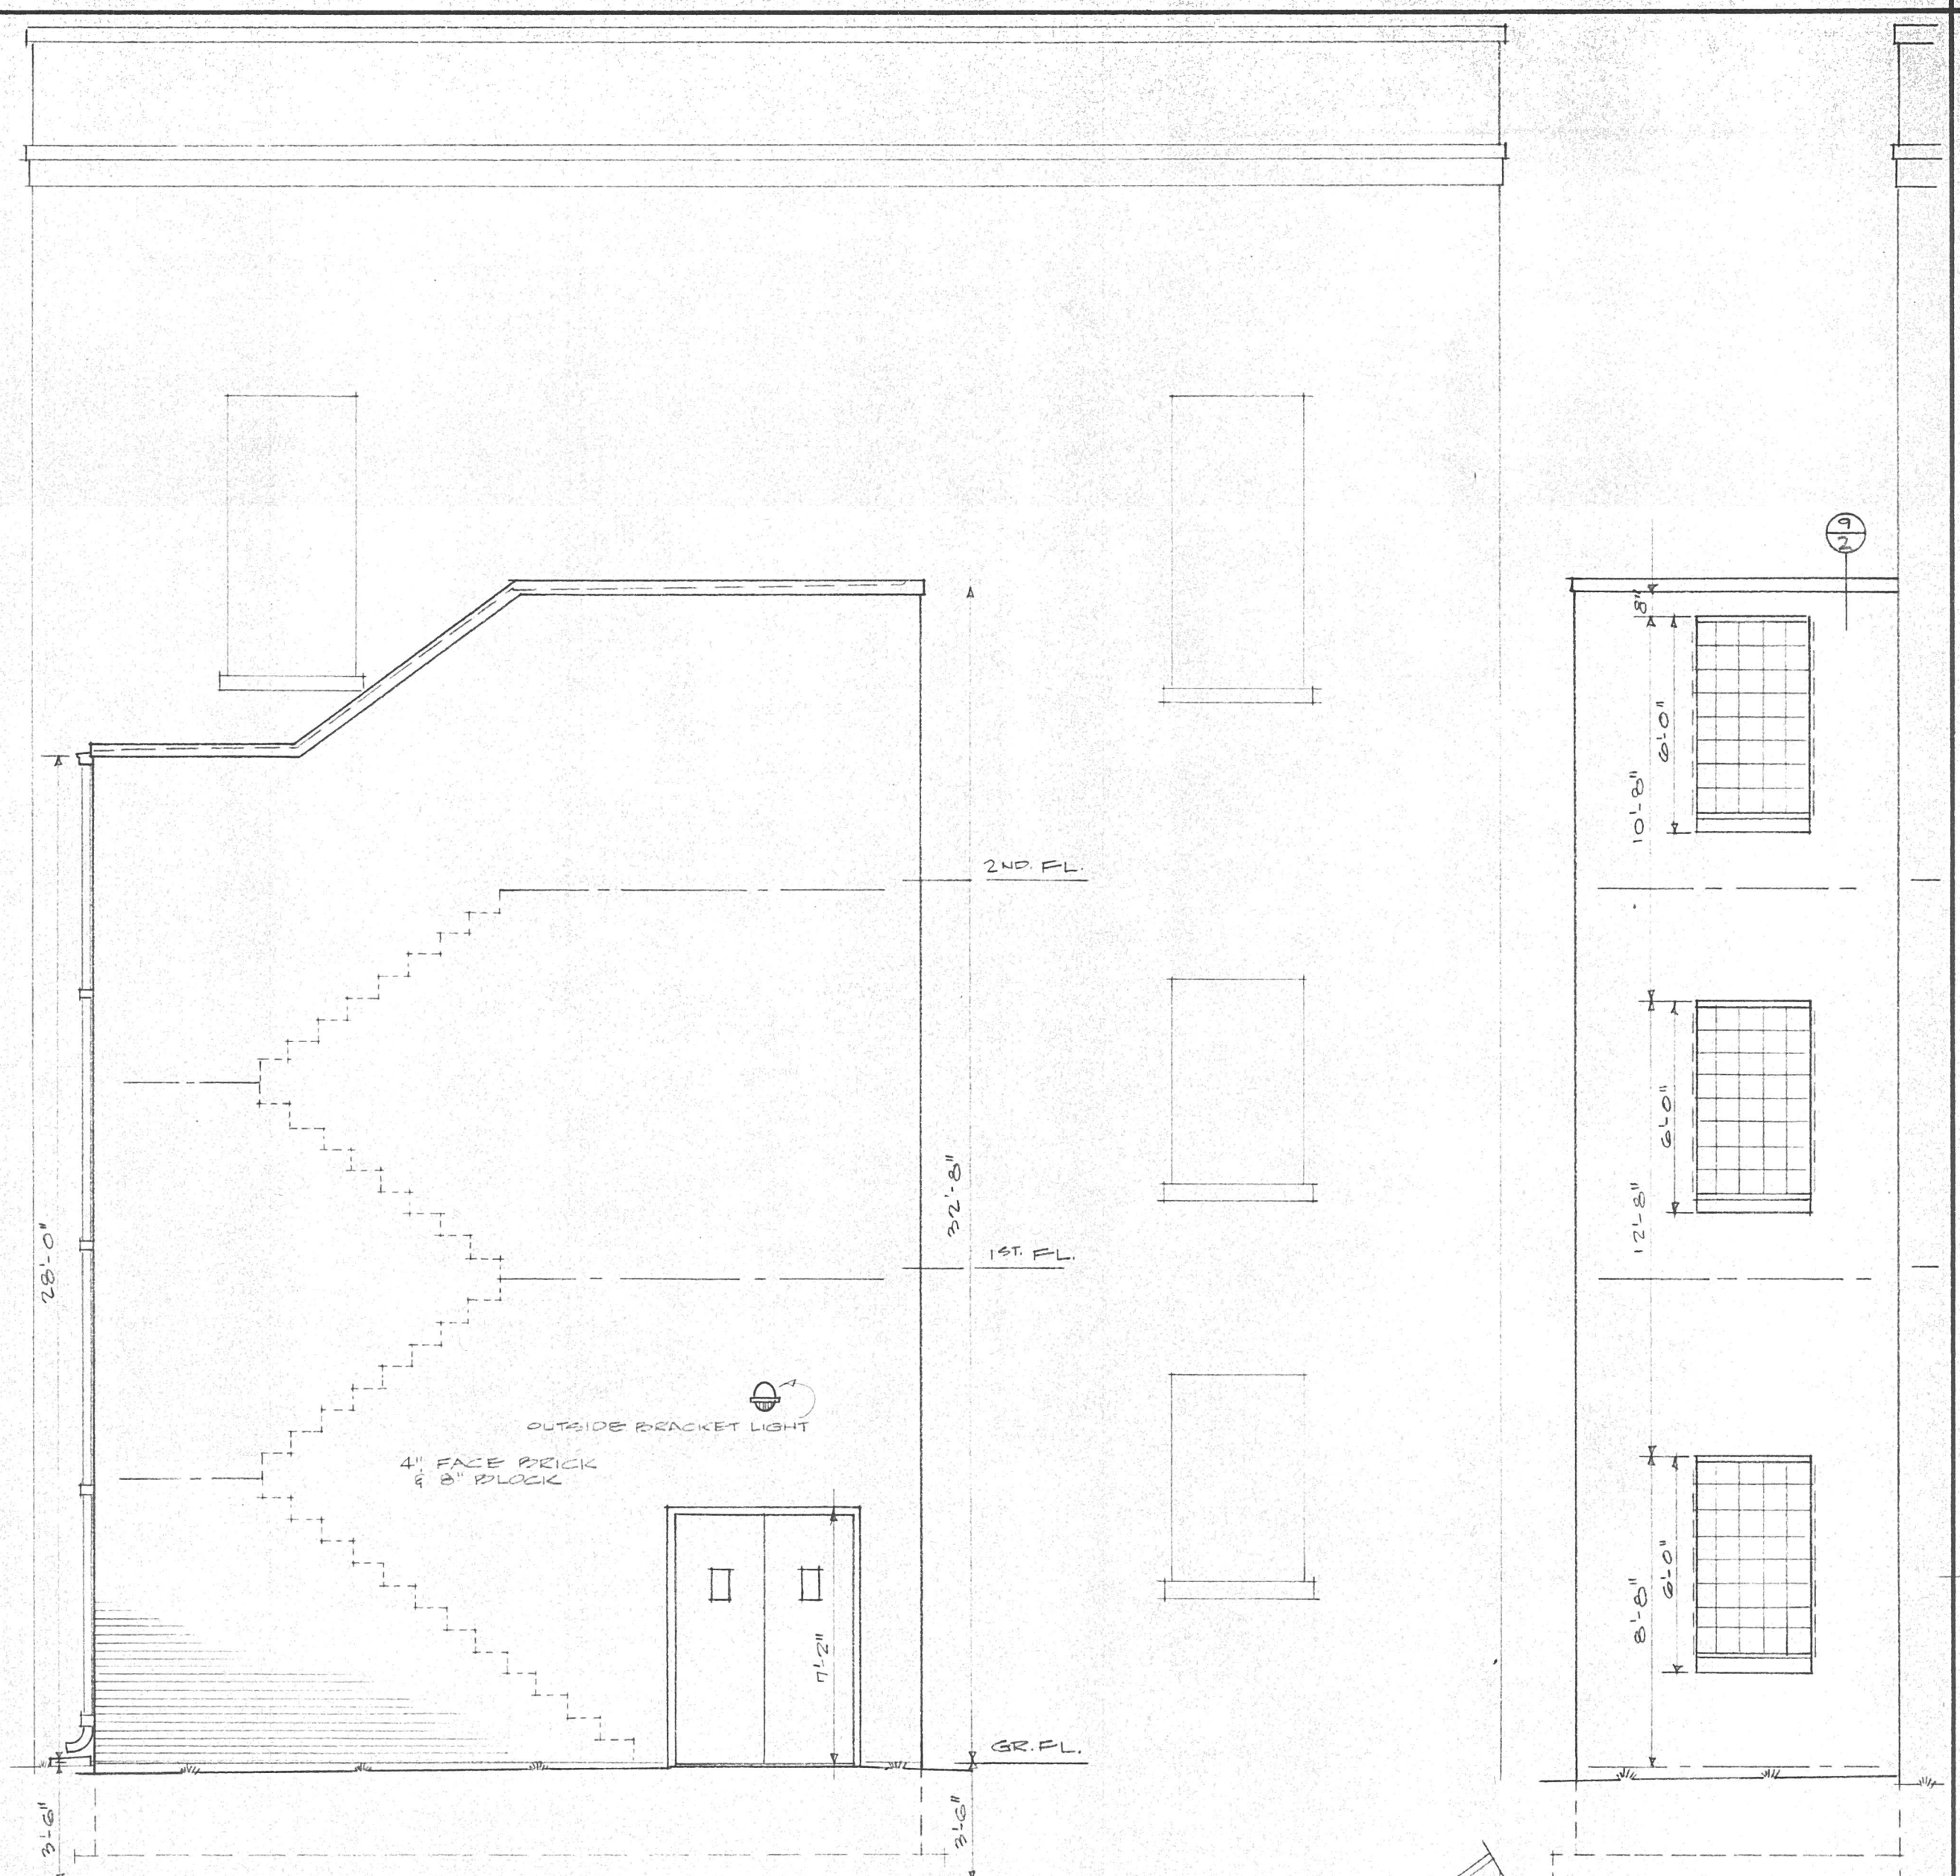
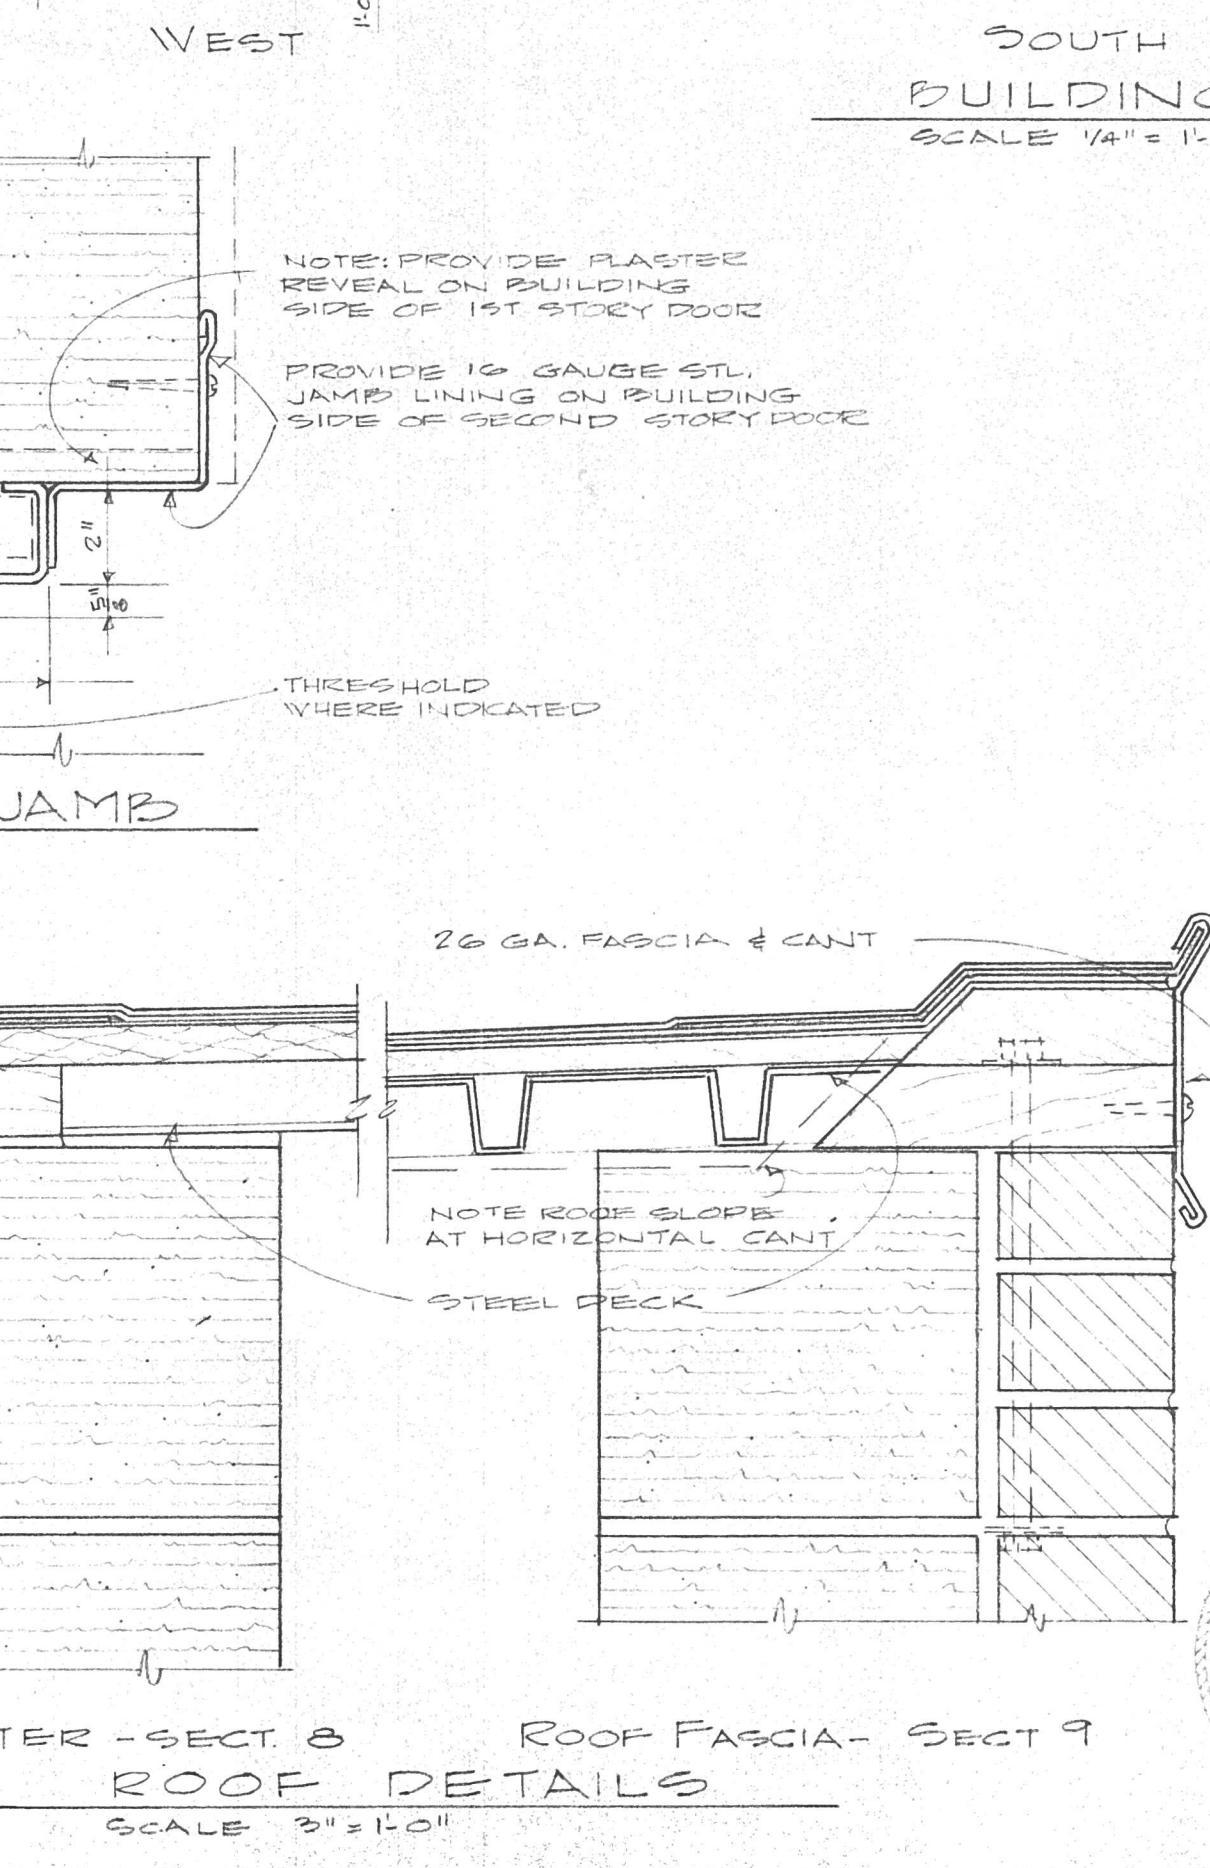
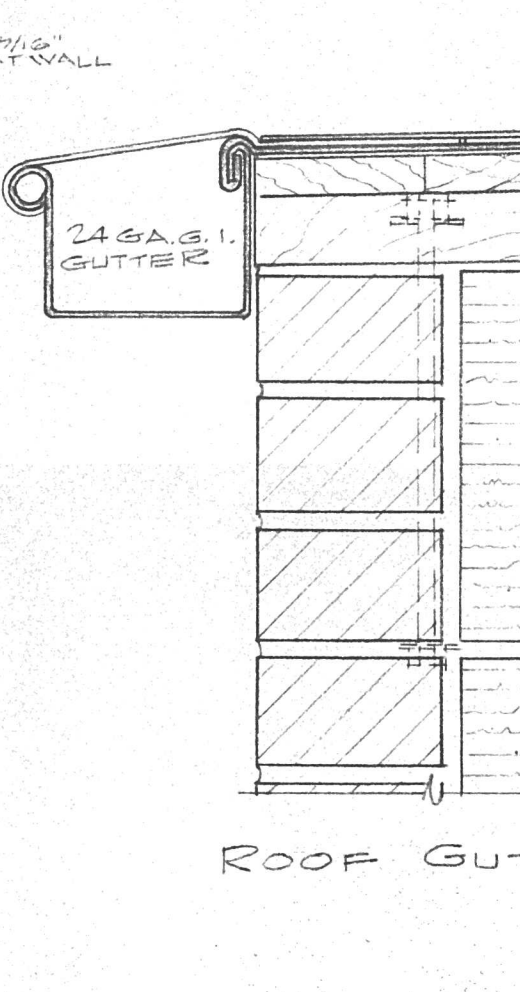
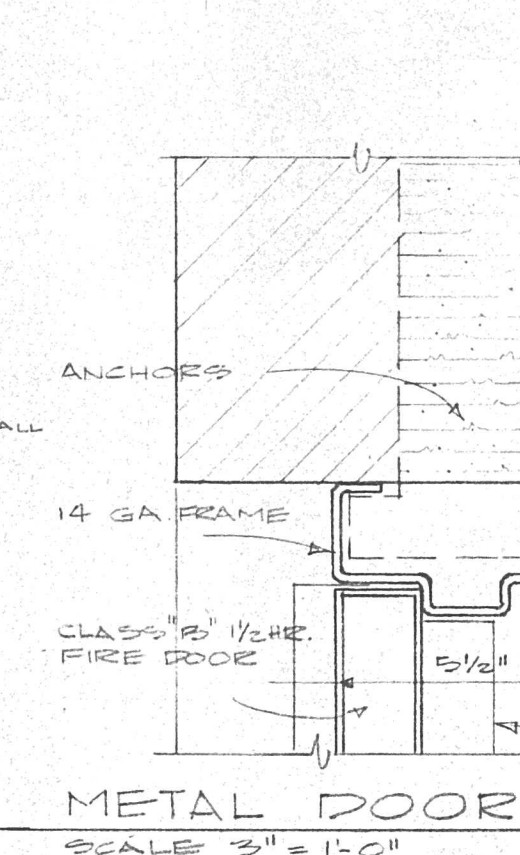
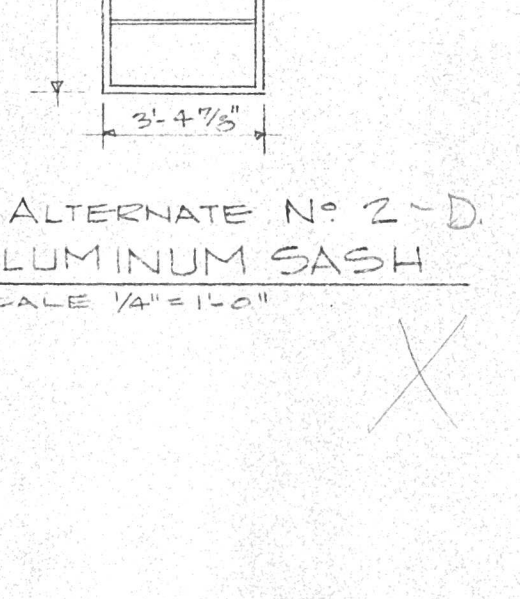
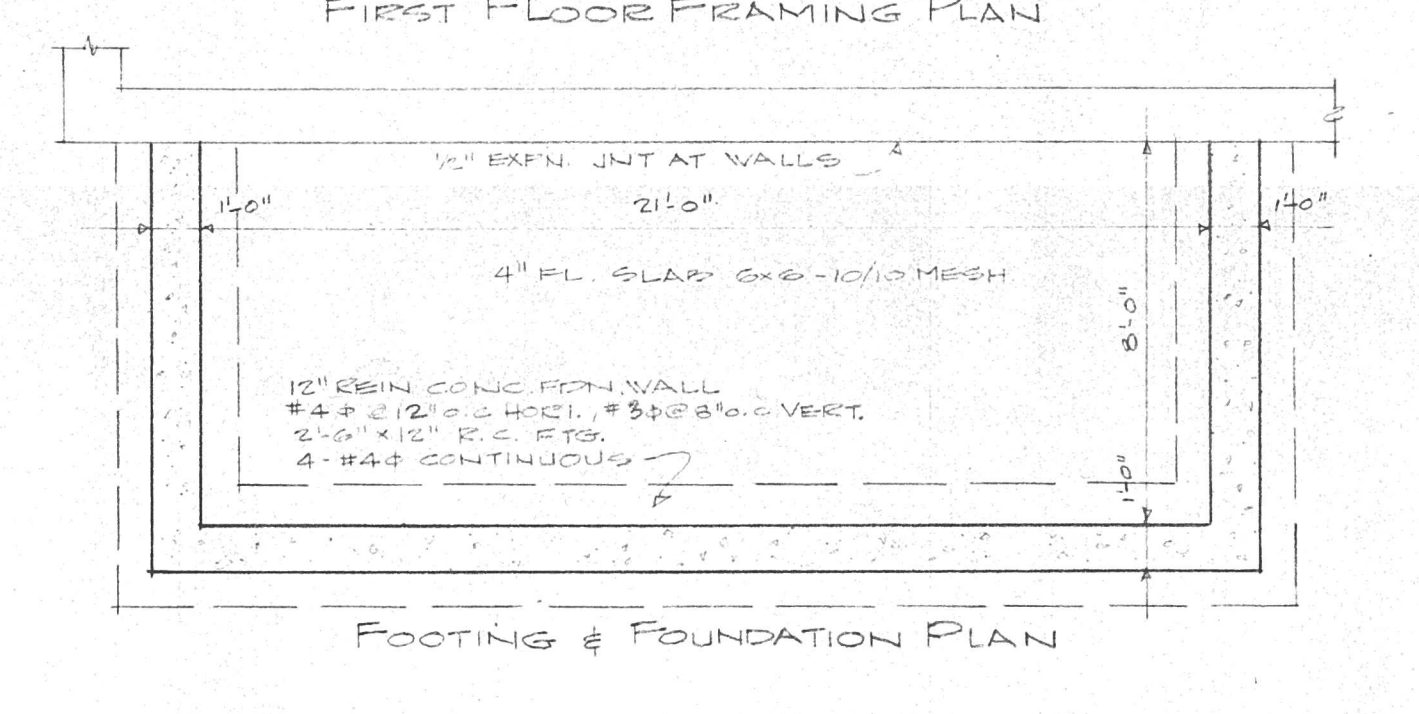
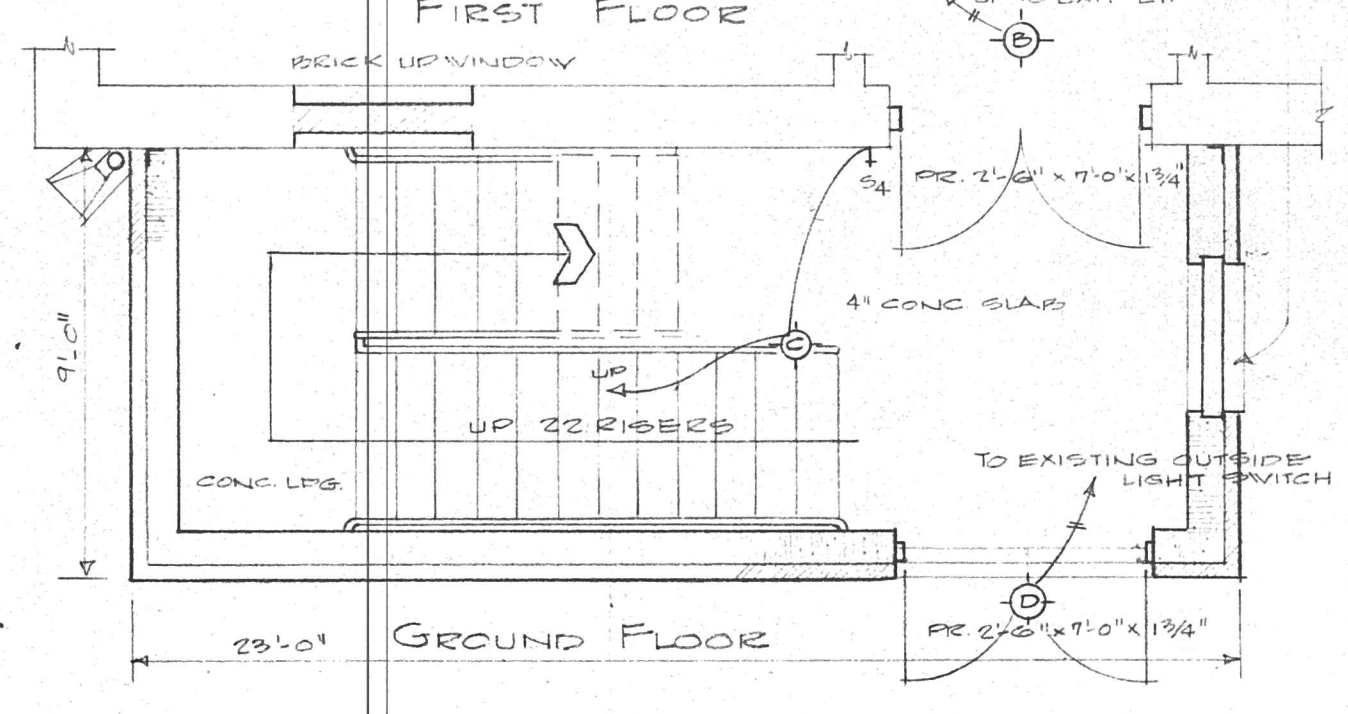
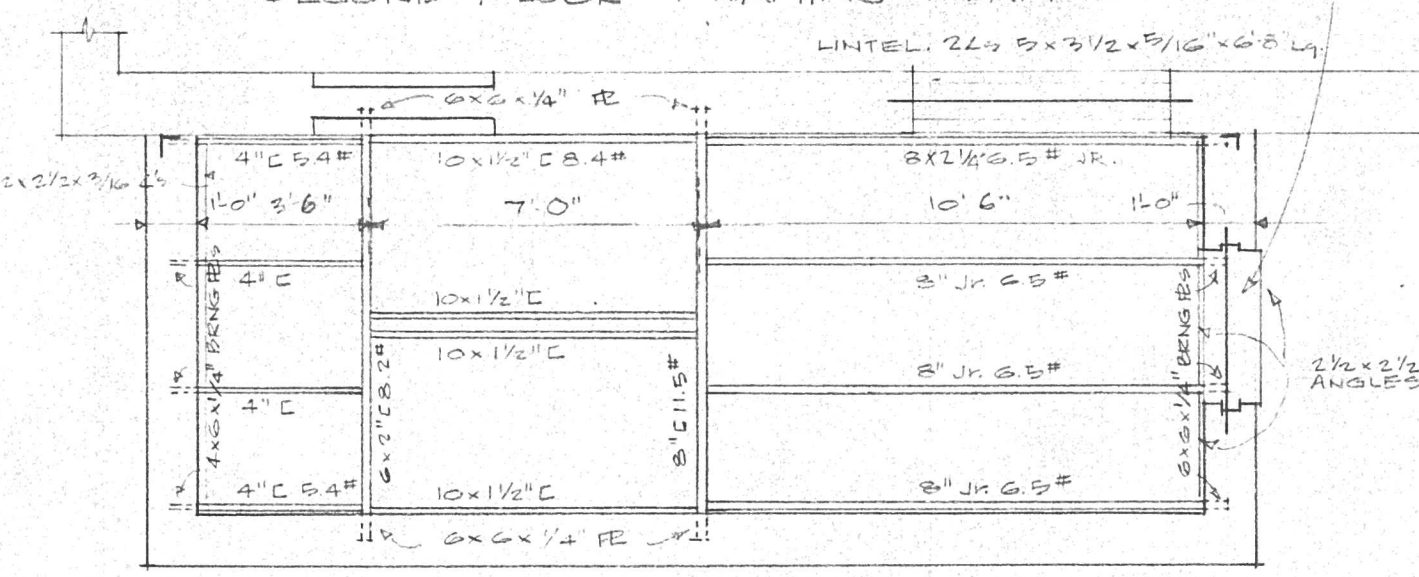
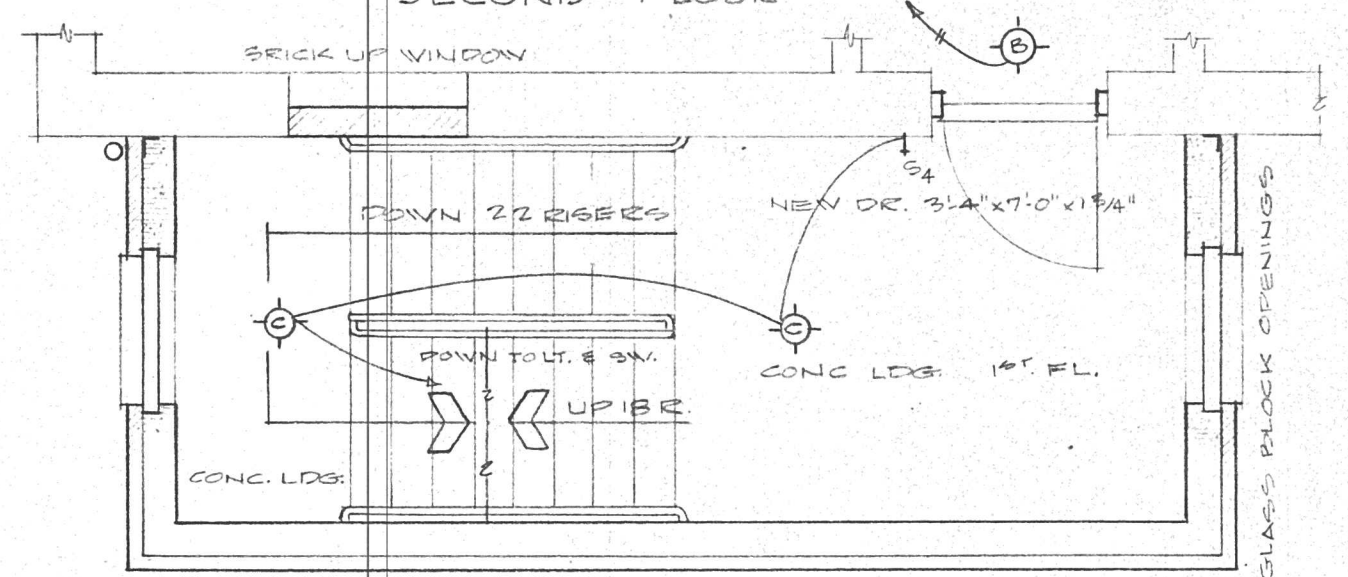
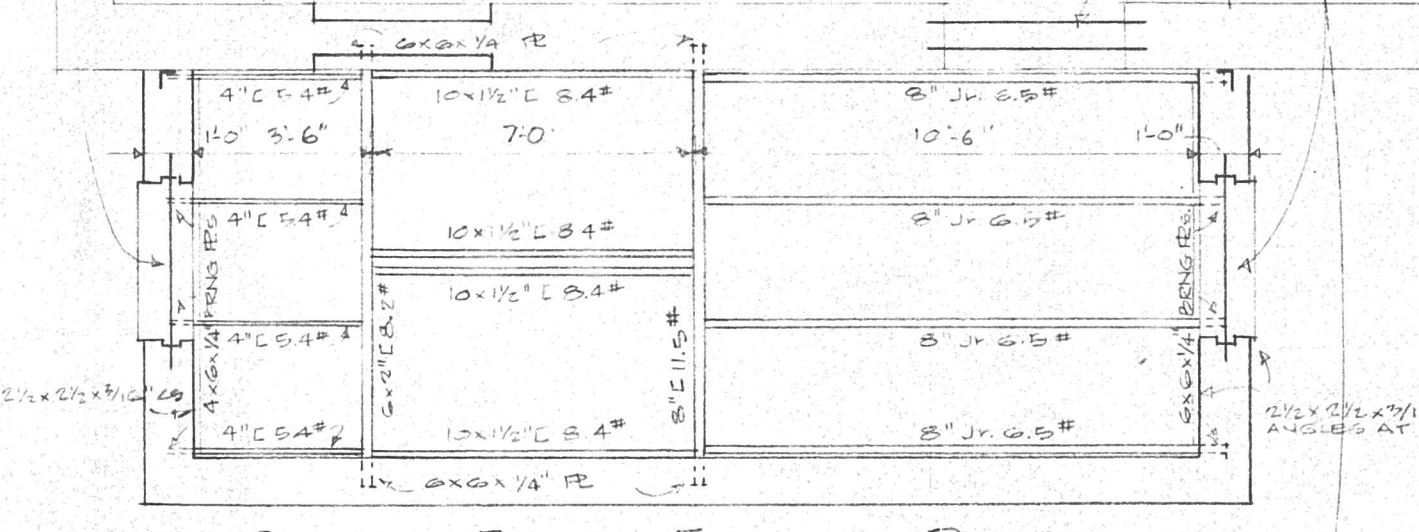
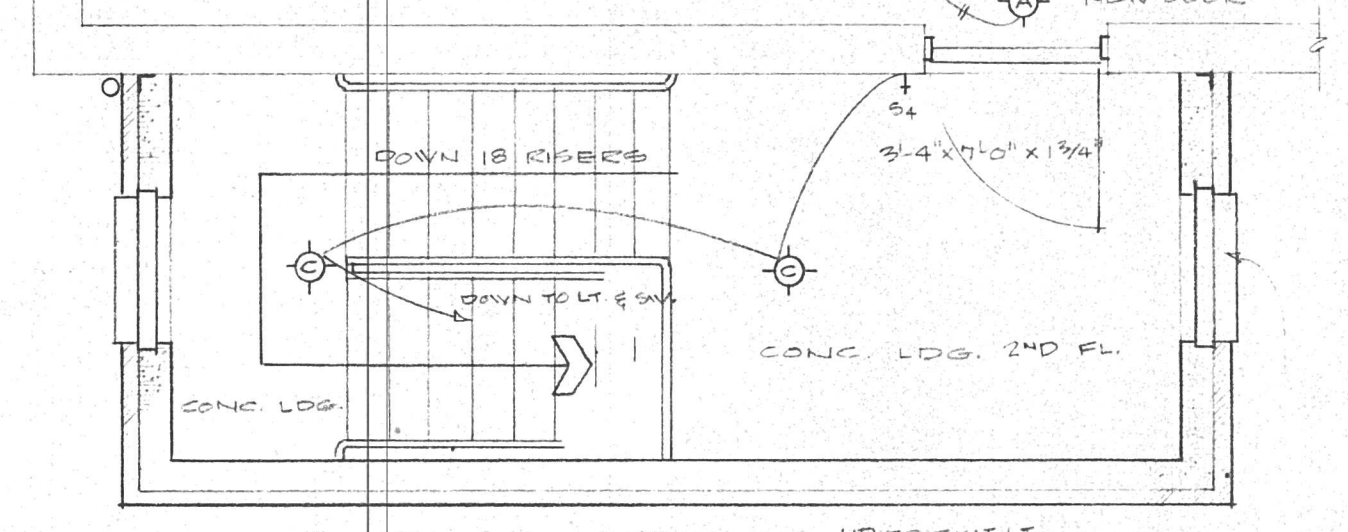
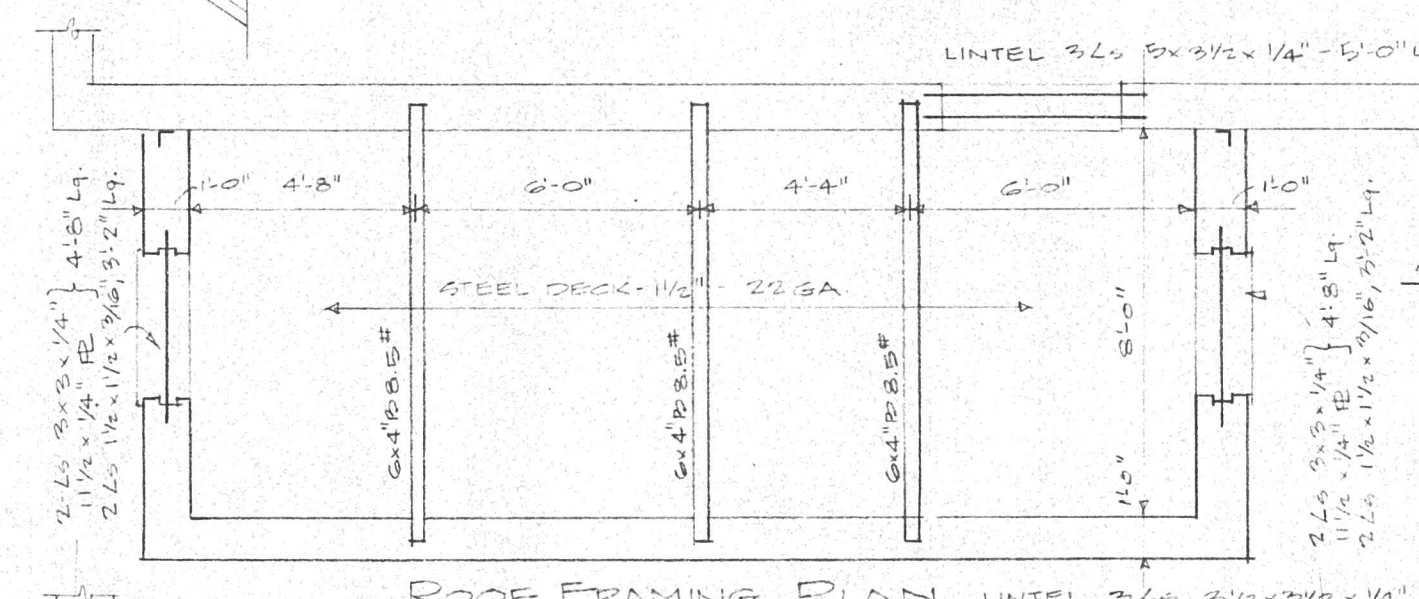
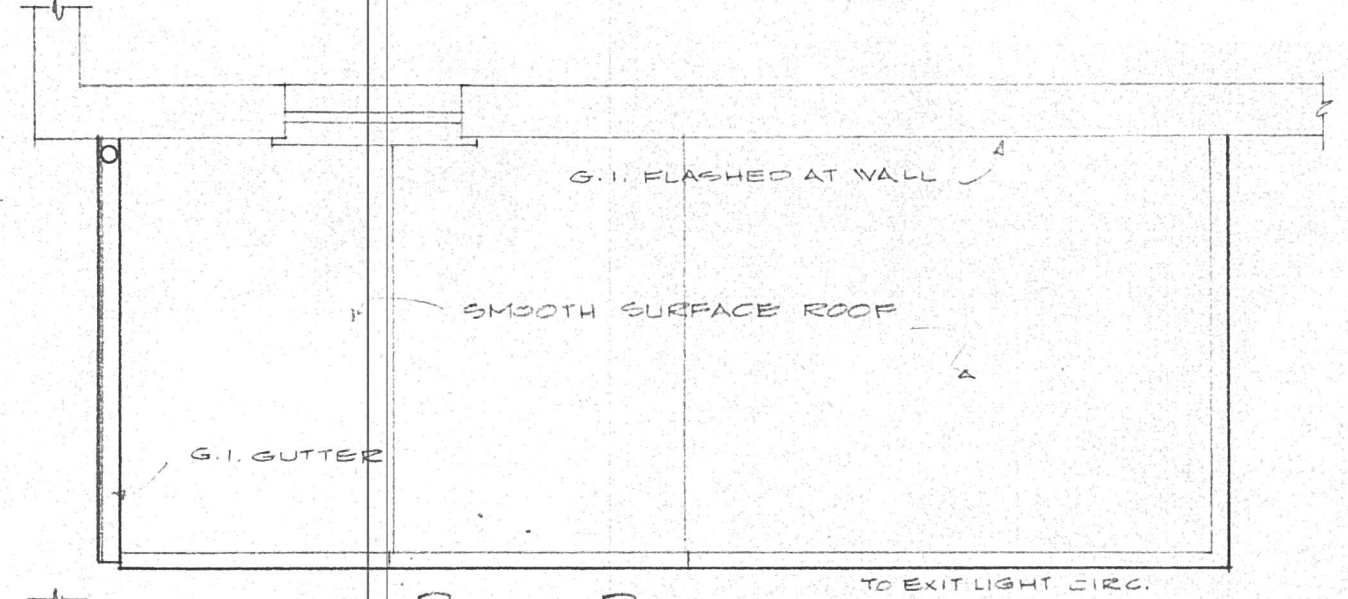
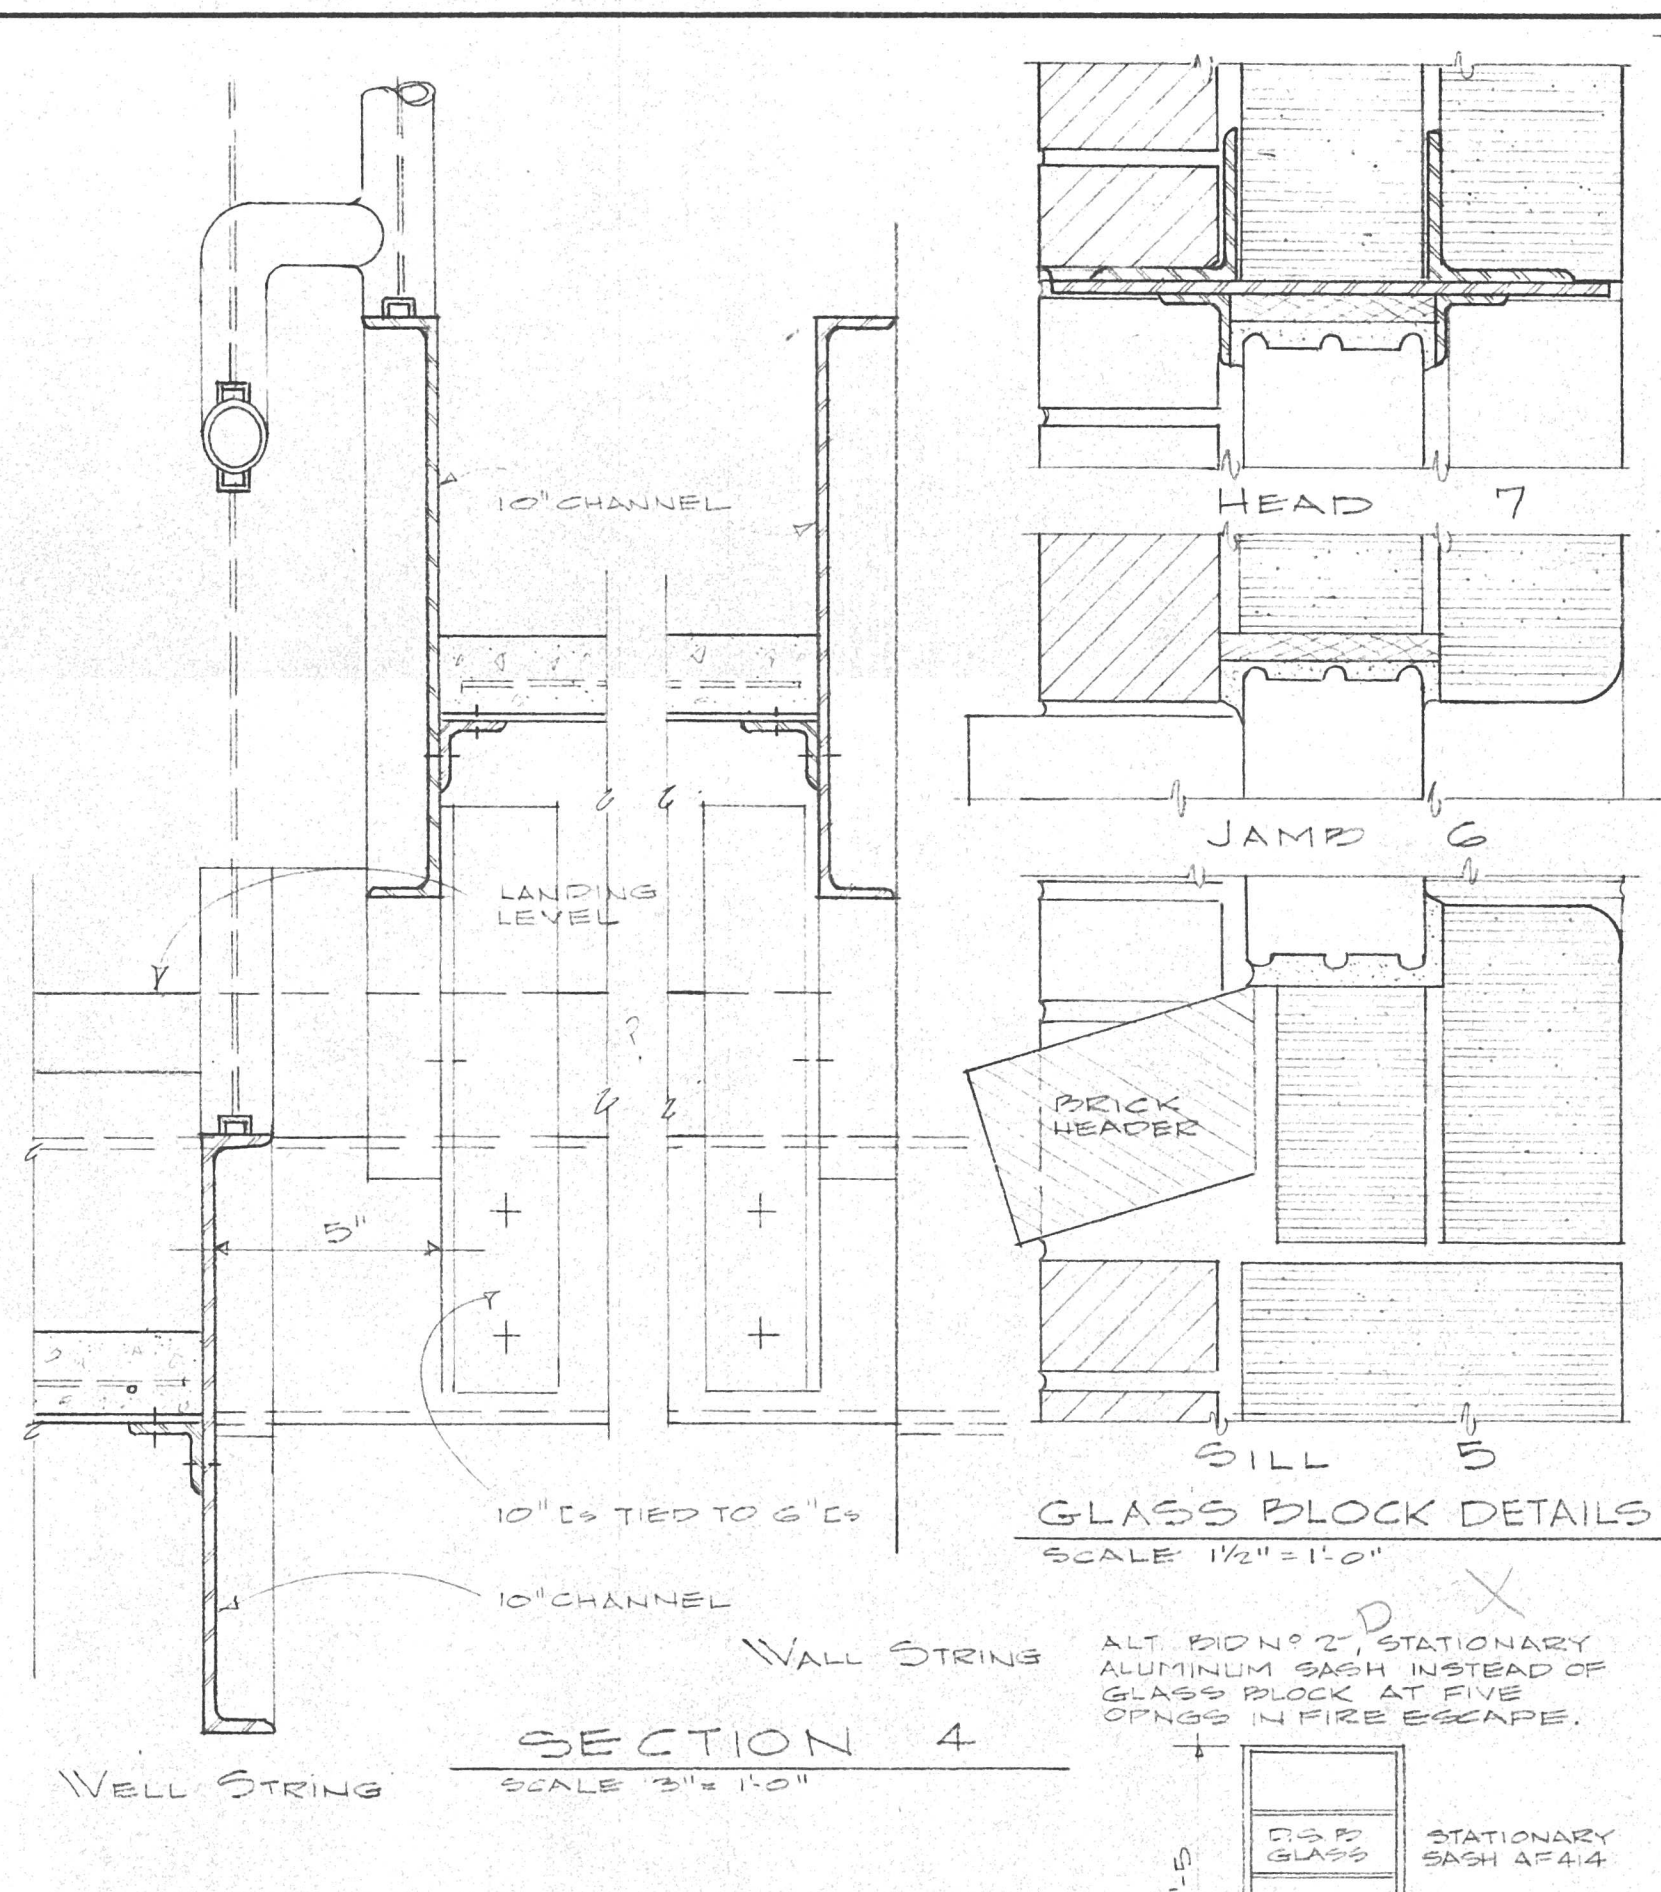


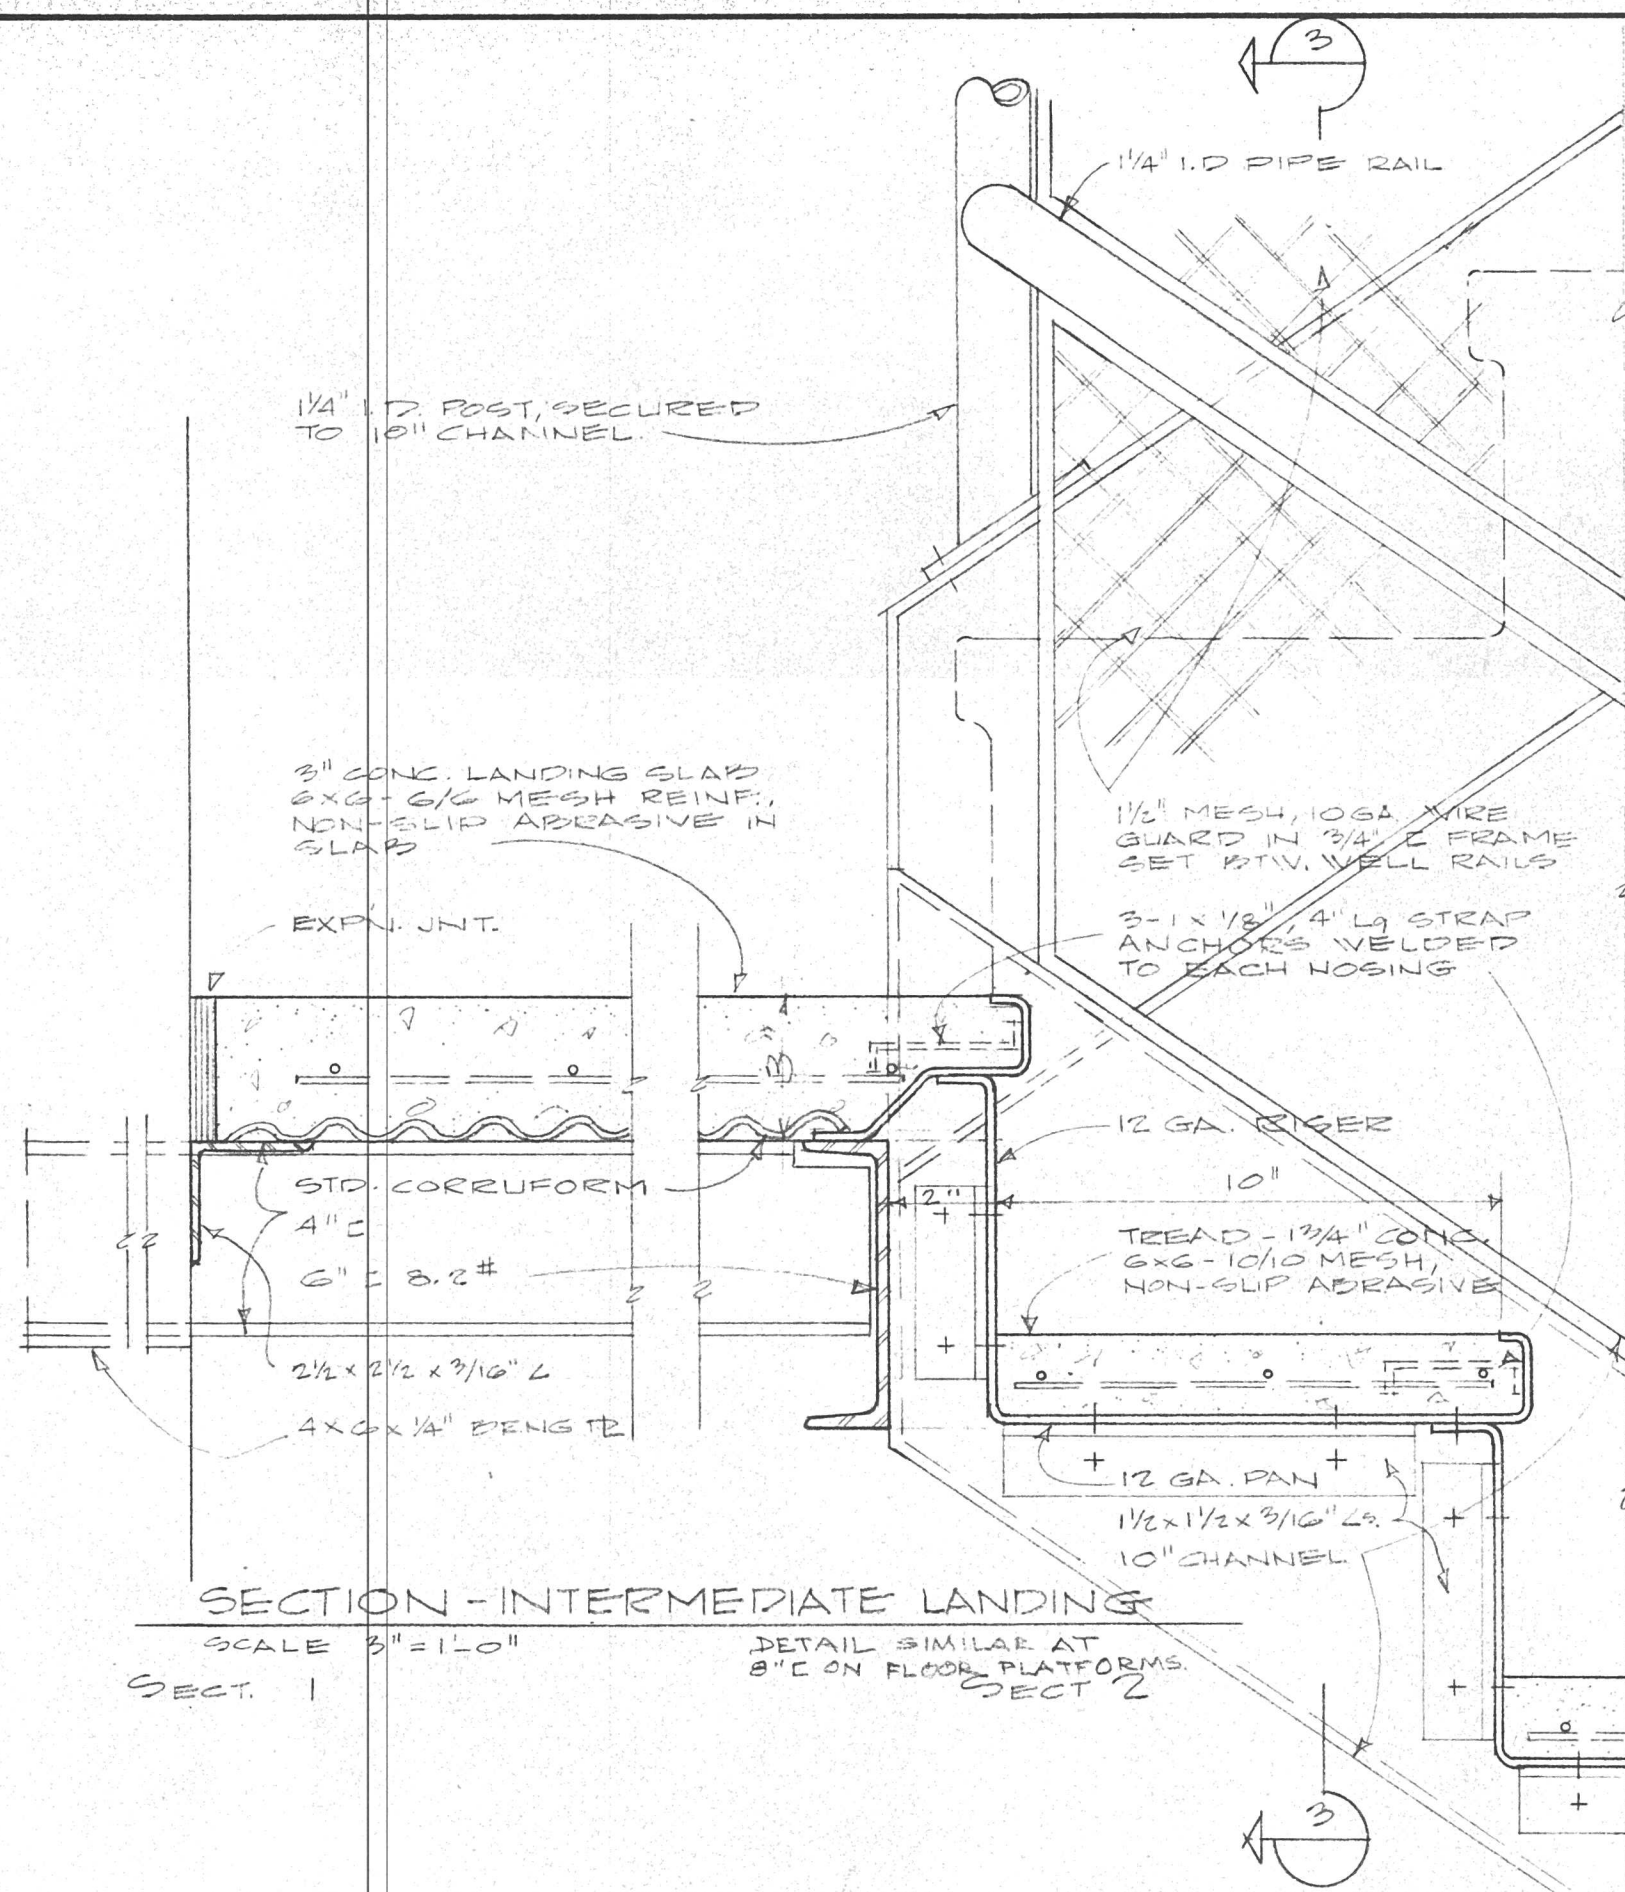

PROJECT "D"

FIXTURE SCHEDULE				
TYPE	STYLE	CAT. NO.	SIZE	WATTAGE
A	RECESSED EXIT	B1401 VGS	2-25 WATT	GUTH
B	FLUORESCENT EXIT	B1405 SF	2-25 WATT	GUTH
C	GLASS DECK	G02	2-75 WATT	ART METAL
D	OUTSIDE BRACKET	415	150 WATT	NULPHANE

ELECT. CONTR. TO NOTE THAT CONDUIT MAY BE RUN EXPOSED IN STAIRWAY BUT ALL CONDUIT TO BE CHASED INTO WALLS & CEILINGS AS REQD. IN CASE OF BUILDING EXISTING OUTSIDE BRACKET LIGHTS TO BE REMOVED & COVER BOXES AS DIRECTED BY ARCHITECT.

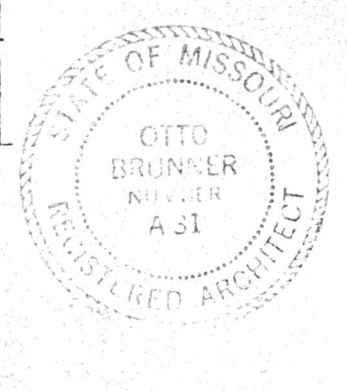

FIRE ESCAPE **WOODSON BUILDING**

MISSOURI STATE HOSPITAL NO. 2 ST. JOSEPH, MISSOURI

date: FEB 10, 1964
REVISED: APR 30, 64

HON. JOHN M. DALTON GOVERNOR

BRUNNER & BRUNNER
1105 CORBY BLDG.
ARCHITECTS & ENGINEERS
ST. JOSEPH, MISSOURI

APPROVED: DIRECTOR DEPT. OF HEALTH & WELFARE

APPROVED: CHIEF PLANNING & CONSTRUCTION

sheet 2 OF 3