


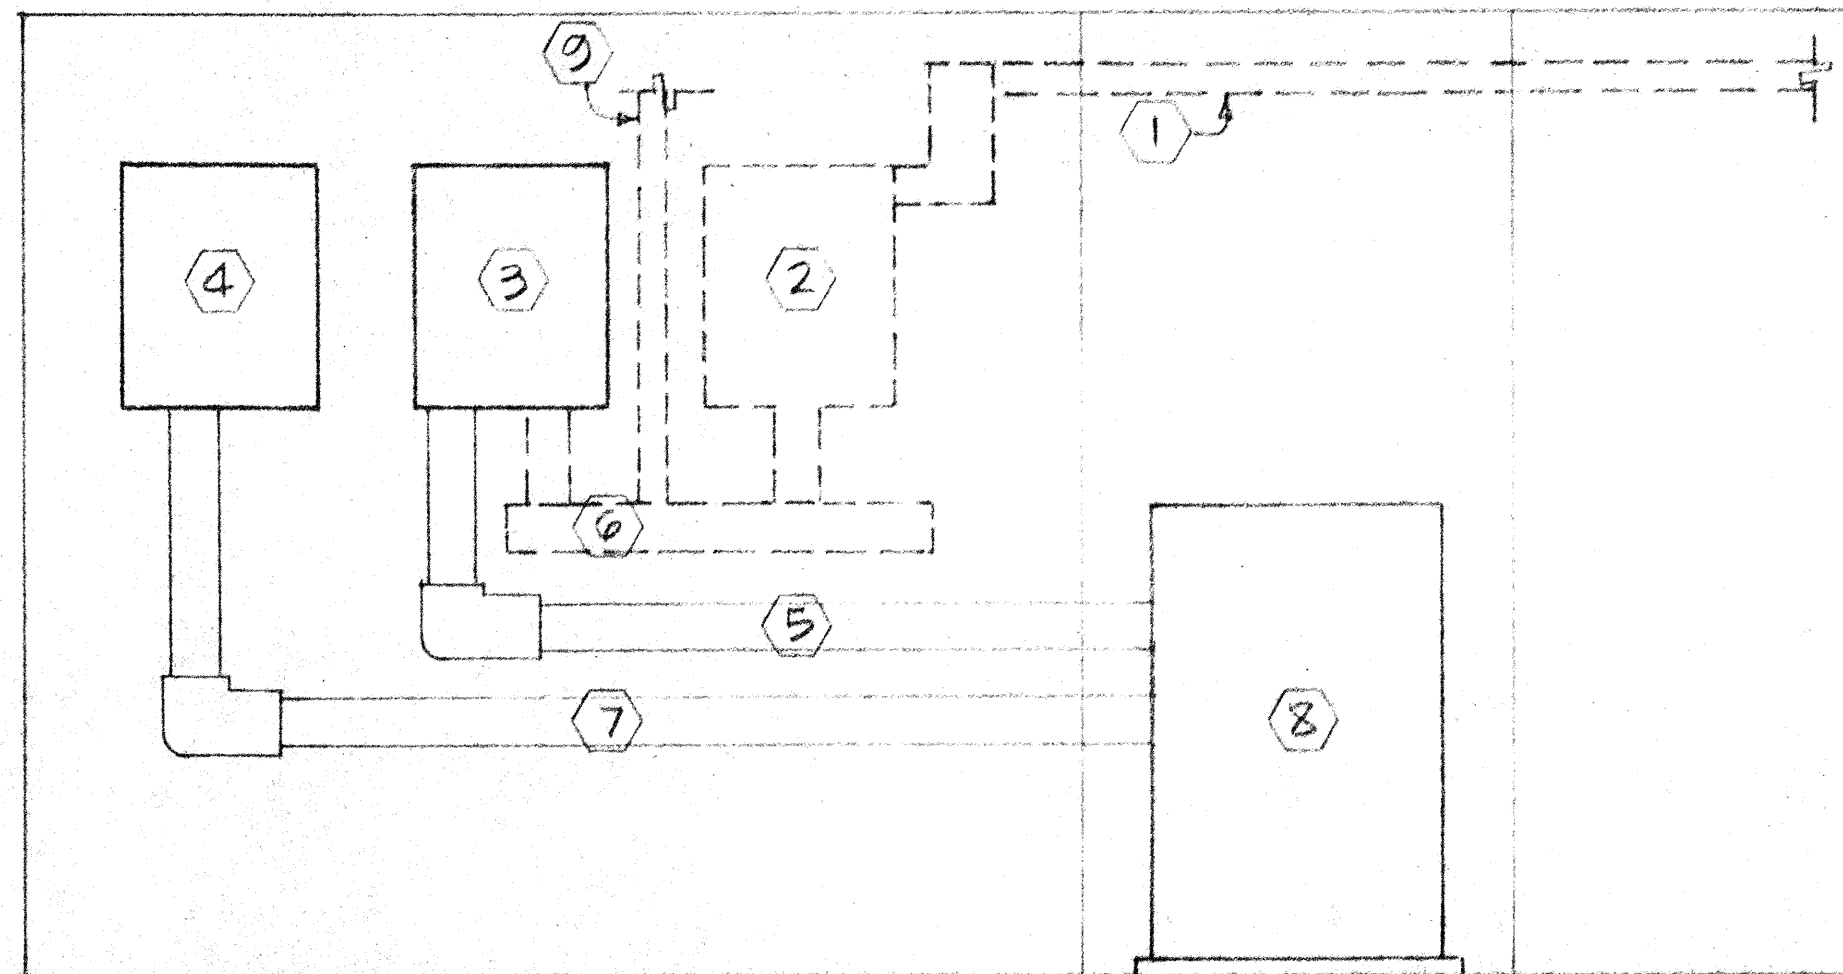


DETAIL "A"
N.T.S.

NOTES:

- ① INCOMING 400 AMP 480 V, 3 phase, 4 W SERVICE EXISTING TO REMAIN.
- ② MAIN 400 AMP FUSED DISCONNECT SWITCH EXISTING TO REMAIN.

NOTES - CONT'N.

- ③ NEW 400 AMP 480 V, 3 phase, 4 W PANEL.
- ④ NEW 400 AMP 208 V, 3 phase, 4 W PANEL.
- ⑤ NEW FEEDER TO TRANSFORMER (3) # 2/0 THW AND (1) # 2 THW, 2 1/2" C.
- ⑥ EXISTING 6" X 6" SCREW COVER GUTTER TO REMAIN.
- ⑦ NEW FEEDER FROM TRANSFORMER (2) # 500 MCM, THW AND (1) # 3/0 THW, 3 1/2" C.
- ⑧ NEW 12.5 KVA TRANSFORMER 480/277 V, 3 phase TO 208 V/120 V, 3 phase, 4 W, DRY VENTILATED TYPE.
- ⑨ EXISTING FEEDER UP TO 480 V, 1 phase TO 120/240 V, 1 phase TRANSFORMER TO BE REMOVED.

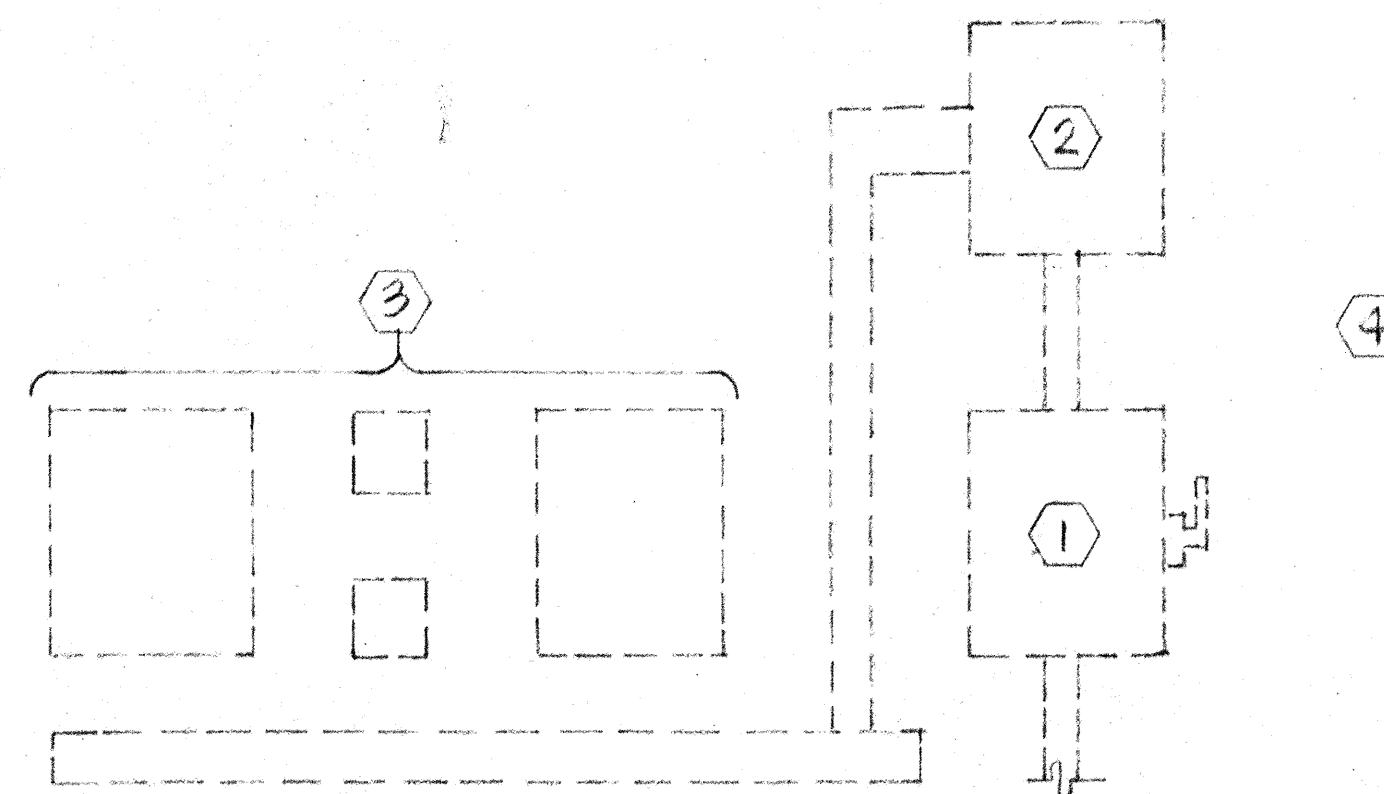

DETAIL "B"
N.T.S.

NOTES:


- ① EXISTING DISCONNECT SWITCH TO BE REMOVED.
- ② EXISTING 480 V, 1 phase, TO 120/240 V, 1 phase 30 KVA TRANSFORMER TO BE REMOVED.
- ③ ALL EXISTING TO BE REMOVED.
- ④ SEE DETAIL "C" FOR NEW CONFIGURATION.

DETAIL "C"
N.T.S.

- ① SEE PANEL SCHEDULE "D"

NOTES:

- ① EXISTING INCOMING SERVICE SWITCH ON DOCK, NO CHANGE.
- ② EXISTING 400 AMP FUSED SWITCH AT END OF PASSAGEWAY ON LOWER DECK, NO CHANGE.
- ③ NEW 480 V, 3 phase, 4 W PANEL. SEE PANEL "A" SCHEDULE.
- ④ NEW 480 V, 3 phase, 4 W, 12.5 KVA TRANSFORMER. DRY VENTILATED TYPE.
- ⑤ NEW 208 V, 3 phase, 4 W PANEL. SEE PANEL "B" SCHEDULE.
- ⑥ NEW 208 V, 3 phase, 4 W PANEL. SEE PANEL "C" SCHEDULE.
- ⑦ NEW 208 V, 3 phase, 4 W PANEL. SEE PANEL "D" SCHEDULE.
- ⑧ NEW 208 V, 1 phase, 3 W PANEL. SEE PANEL "E" SCHEDULE.
- ⑨ NEW 208 V, 1 phase, 3 W PANEL. SEE PANEL "F" SCHEDULE.
- ⑩ NEW 208 V, 1 phase, 3 W PANEL. SEE PANEL "G" SCHEDULE.
- ⑪ NEW 208 V, 1 phase, 3 W PANEL. SEE PANEL "H" SCHEDULE.
- ⑫ NEW 12" X 12" X 12" DEEP SCREW COVER JUNCTION BOX WITH 4" X 4" SCREW COVER GUTTER.
- ⑬ NEW 208 V, 1 phase, 3 W PANEL. SEE PANEL "I" SCHEDULE.

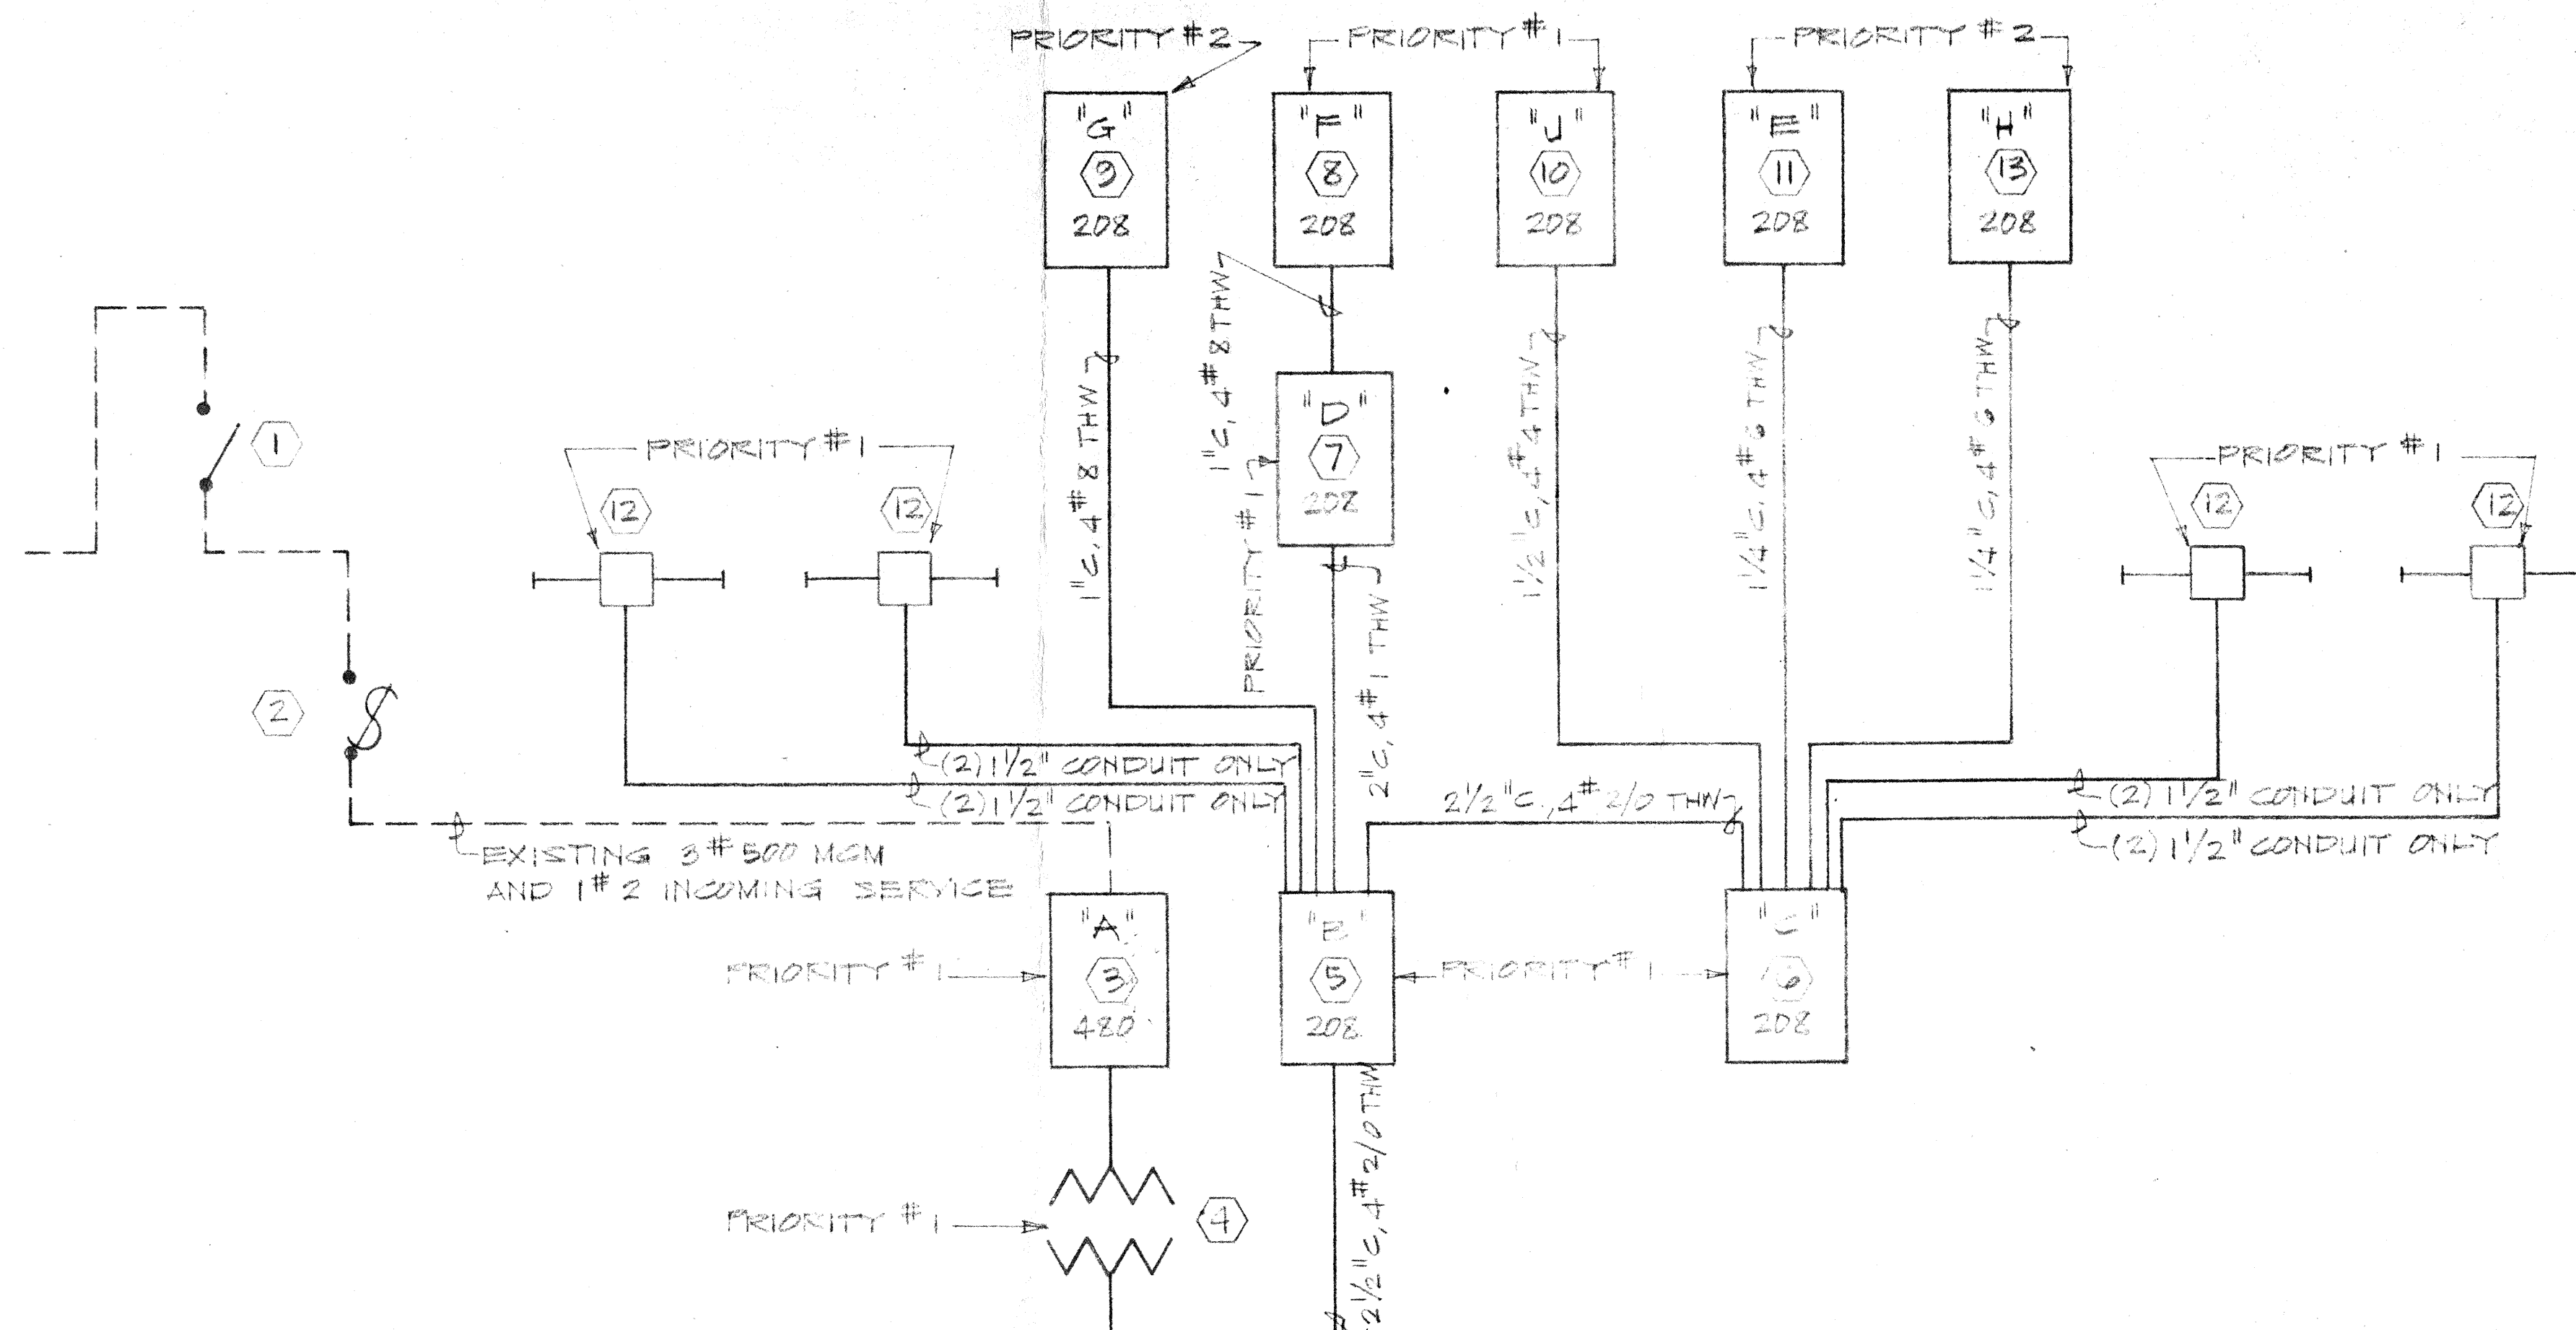

BLOCK DISTRIBUTION DIAGRAM
NOT TO SCALE